


# DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



## Daily Curtailment Report of PV Generation

<b>Date of Curtailment</b>	04/07/2024
<b>Start of Curtailment</b>	11:30
<b>End of Curtailment</b>	13:30
<b>Instruction from TSOC</b>	YES
<b>Reason of Curtailment</b>	RES-E Generation Restriction due to low loading of the electrical system
<b>Total Estimated Energy of the day:</b>	2027.9 MWh
<b>Total Estimated Curtailed Energy:</b>	67.6 MWh
<b>Percentage of Curtailed Energy</b>	3.3%

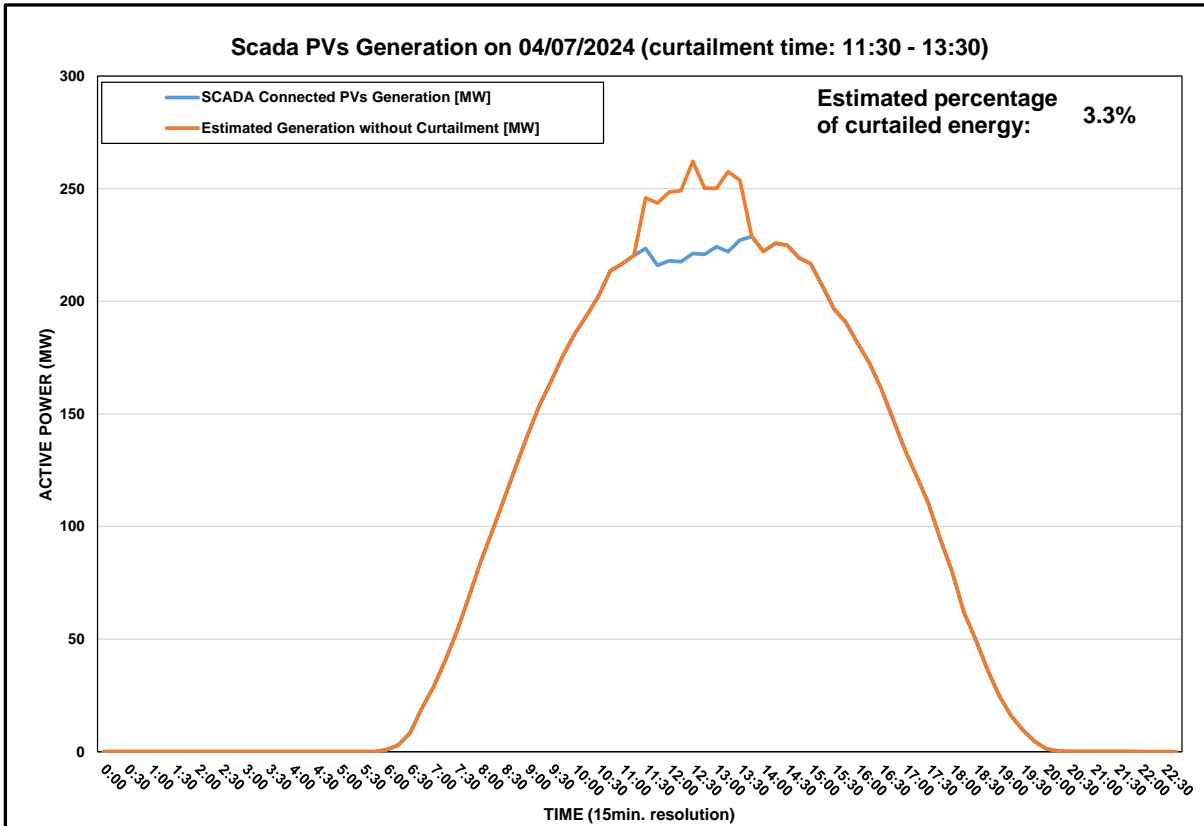


# DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



## Daily Curtailment Report of PV Generation

<b>Date of Curtailment</b>	05/07/2024
<b>Start of Curtailment</b>	11:00
<b>End of Curtailment</b>	15:15
<b>Instruction from TSOC</b>	YES
<b>Reason of Curtailment</b>	RES-E Generation Restriction due to low loading of the electrical system
<b>Total Estimated Energy of the day:</b>	2086.3 MWh
<b>Total Estimated Curtailed Energy:</b>	305.6 MWh
<b>Percentage of Curtailed Energy</b>	14.6%

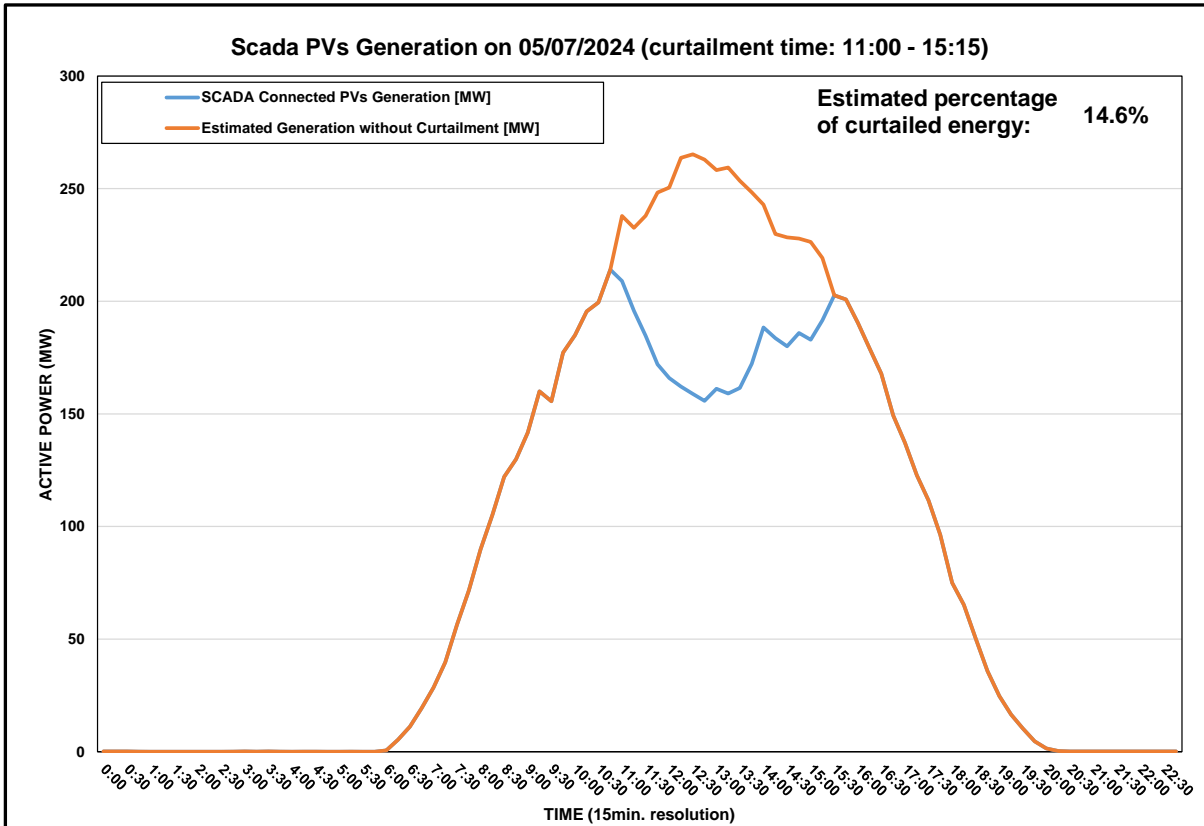


# DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



## Daily Curtailment Report of PV Generation

<b>Date of Curtailment</b>	06/07/2024
<b>Start of Curtailment</b>	10:15
<b>End of Curtailment</b>	15:00
<b>Instruction from TSOC</b>	YES
<b>Reason of Curtailment</b>	RES-E Generation Restriction due to low loading of the electrical system
<b>Total Estimated Energy of the day:</b>	2169.9 MWh
<b>Total Estimated Curtailed Energy:</b>	350 MWh
<b>Percentage of Curtailed Energy</b>	16.1%

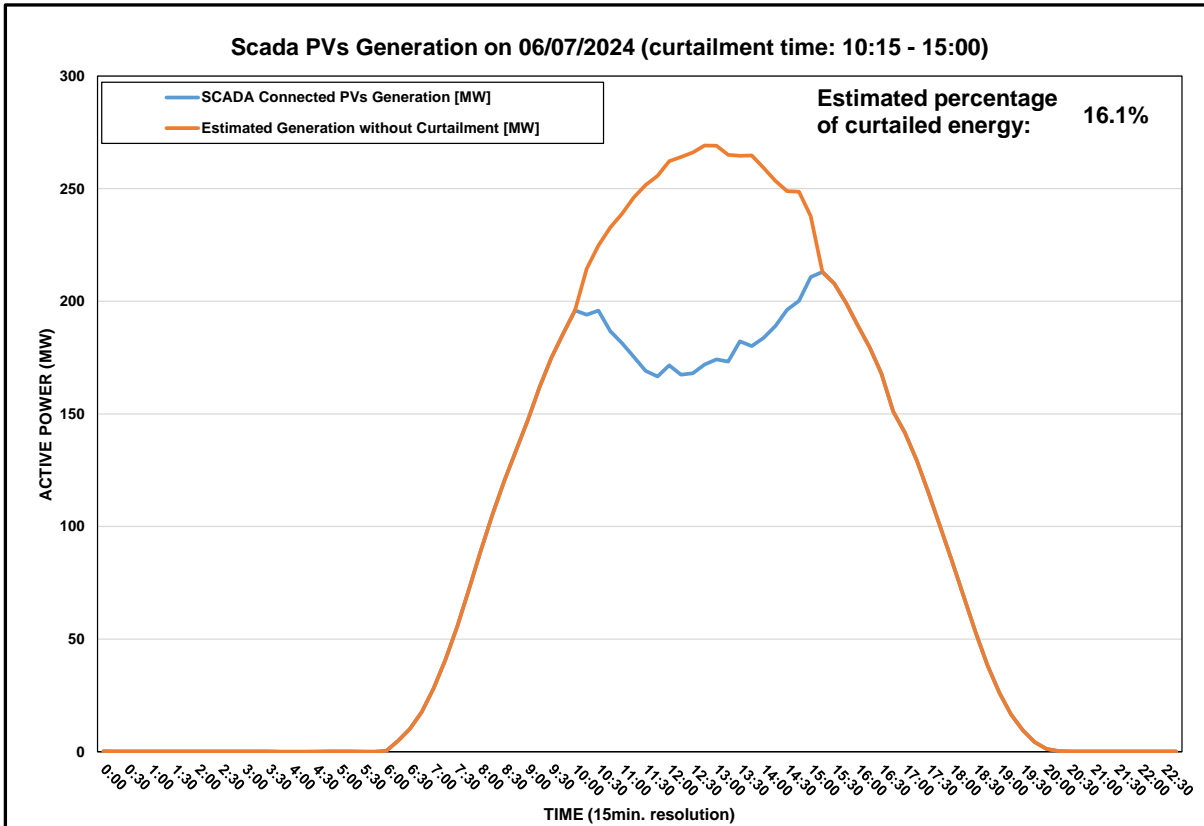


# DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



## Daily Curtailment Report of PV Generation

<b>Date of Curtailment</b>	07/07/2024
<b>Start of Curtailment</b>	9:00
<b>End of Curtailment</b>	15:00
<b>Instruction from TSOC</b>	YES
<b>Reason of Curtailment</b>	RES-E Generation Restriction due to low loading of the electrical system
<b>Total Estimated Energy of the day:</b>	2189.7 MWh
<b>Total Estimated Curtailed Energy:</b>	591.1 MWh
<b>Percentage of Curtailed Energy</b>	27.0%

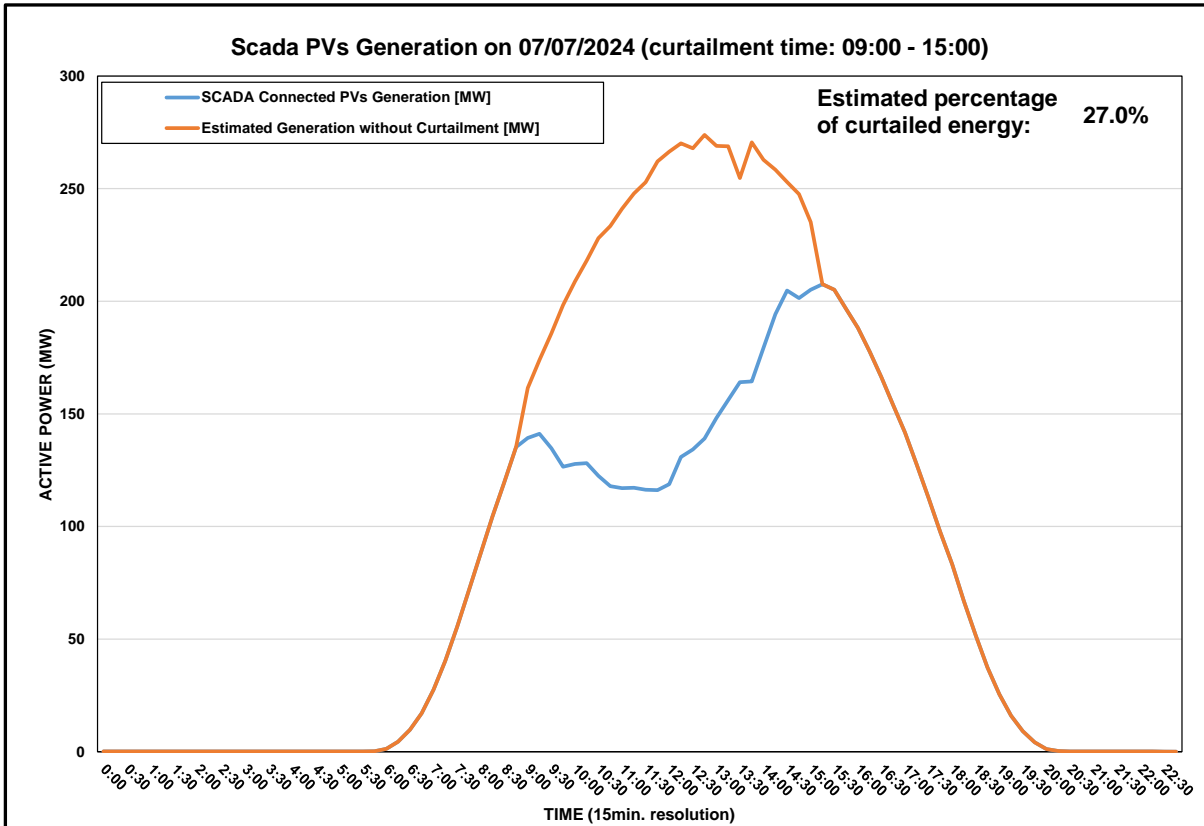


**DISTRIBUTION SYSTEM OPERATOR  
SYSTEM OPERATION**



**Daily Curtailment Report of PV Generation**

Date of Curtailment	12/07/2024
Start of Curtailment	11:45
End of Curtailment	13:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1998 MWh
Total Estimated Curtailed Energy:	20 MWh
Percentage of Curtailed Energy	1.0%

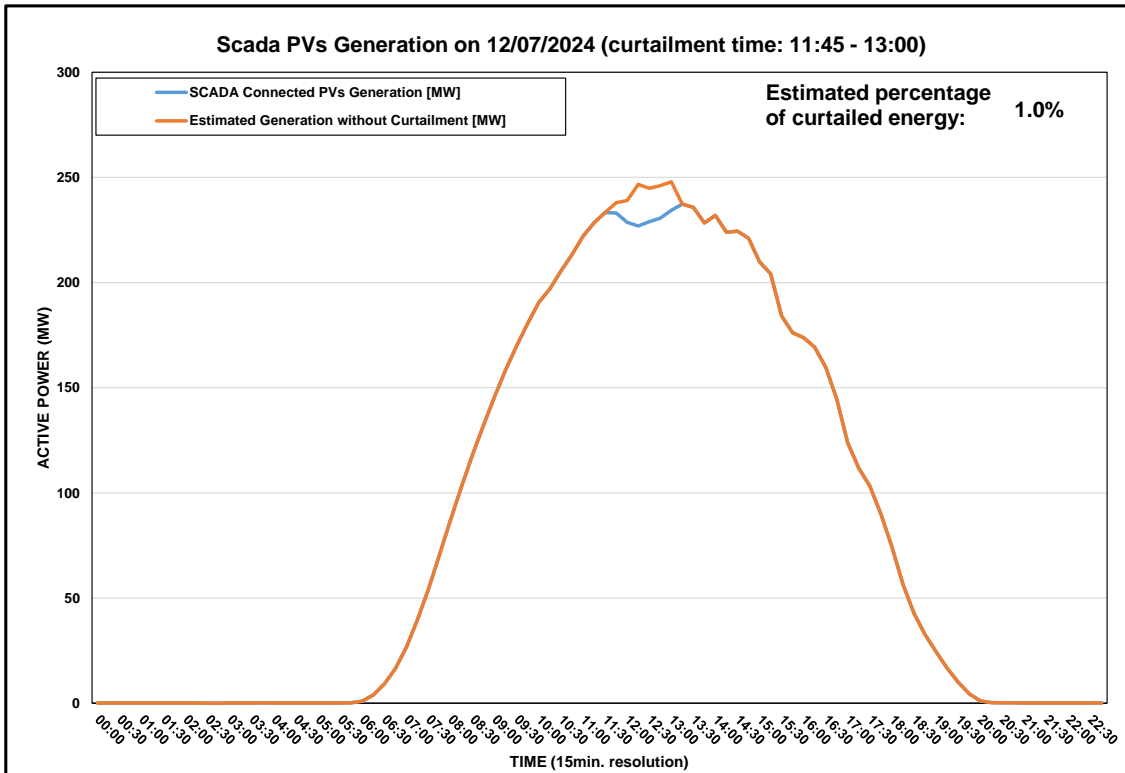


**DISTRIBUTION SYSTEM OPERATOR  
SYSTEM OPERATION**



**Daily Curtailment Report of PV Generation**

Date of Curtailment	13/07/2024
Start of Curtailment	11:45
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2074.7 MWh
Total Estimated Curtailed Energy:	27.7 MWh
Percentage of Curtailed Energy	1.3%

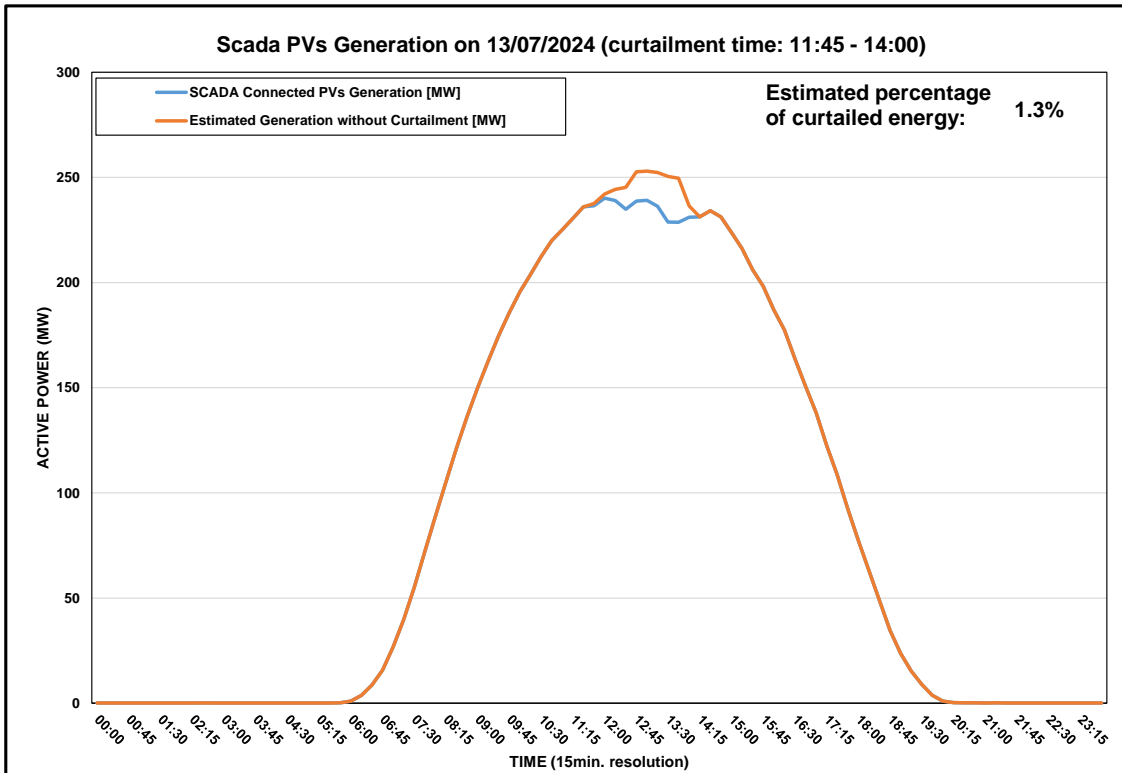


**DISTRIBUTION SYSTEM OPERATOR  
SYSTEM OPERATION**



**Daily Curtailment Report of PV Generation**

Date of Curtailment	14/07/2024
Start of Curtailment	09:30
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2016.3 MWh
Total Estimated Curtailed Energy:	452.9 MWh
Percentage of Curtailed Energy	22.5%

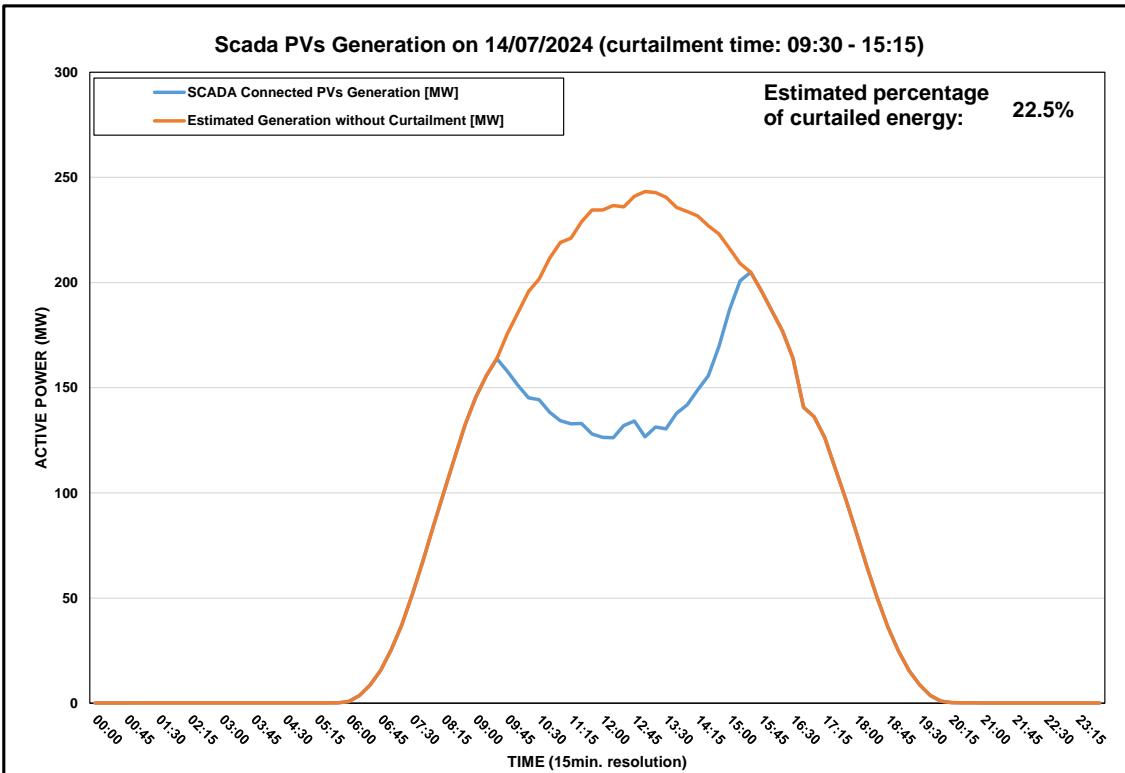


# DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



## Daily Curtailment Report of PV Generation

Date of Curtailment	16/07/2024
Start of Curtailment	11:00
End of Curtailment	11:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2019.5 MWh
Total Estimated Curtailed Energy:	0.5 MWh
Percentage of Curtailed Energy	0.0%

Scada PVs Generation on 16/07/2024 (curtailment time: 11:00 - 11:30)

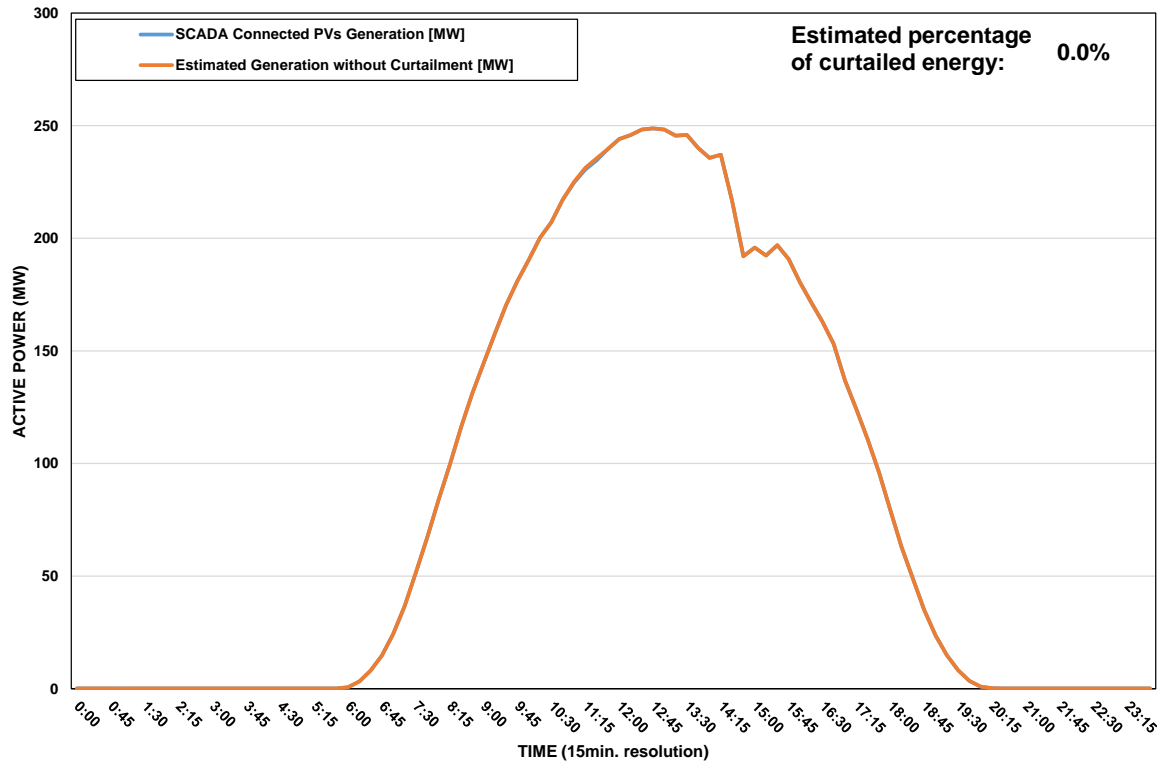




**DISTRIBUTION SYSTEM OPERATOR  
SYSTEM OPERATION**



**Daily Curtailment Report of PV Generation**

Date of Curtailment	17/07/2024
Start of Curtailment	11:00
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2083.7 MWh
Total Estimated Curtailed Energy:	80.8 MWh
Percentage of Curtailed Energy	3.9%

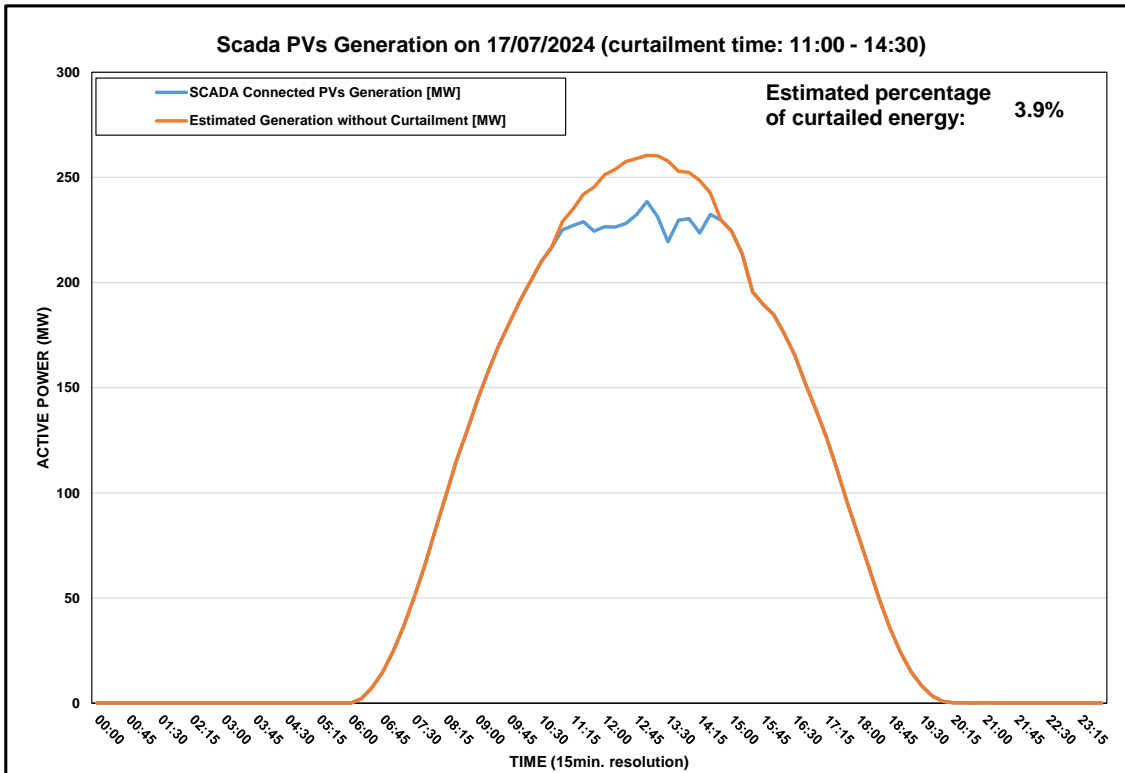


# DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



## Daily Curtailment Report of PV Generation

<b>Date of Curtailment</b>	18/07/2024
<b>Start of Curtailment</b>	11:45
<b>End of Curtailment</b>	12:15
<b>Instruction from TSOC</b>	YES
<b>Reason of Curtailment</b>	RES-E Generation Restriction due to low loading of the electrical system
<b>Total Estimated Energy of the day:</b>	2051.3 MWh
<b>Total Estimated Curtailed Energy:</b>	8.4 MWh
<b>Percentage of Curtailed Energy</b>	0.4%

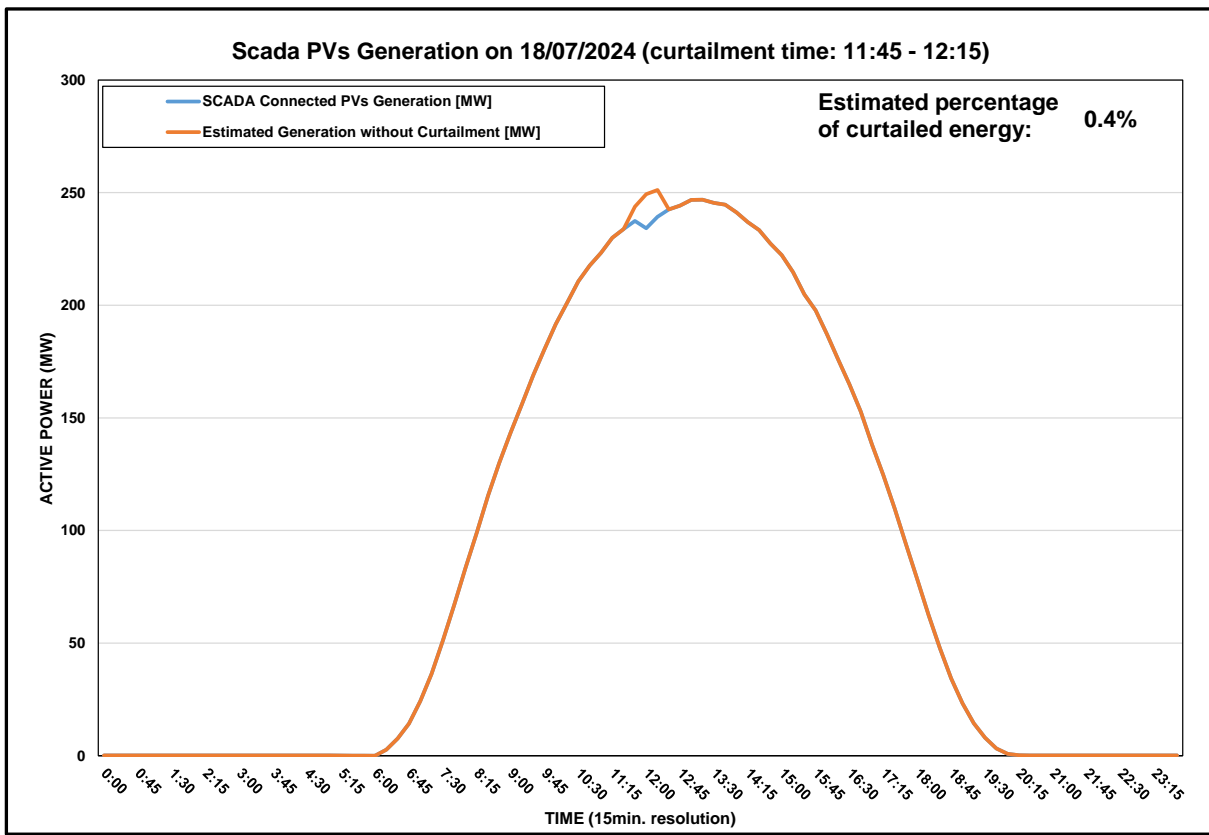


# DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



## Daily Curtailment Report of PV Generation

Date of Curtailment	20/07/2024
Start of Curtailment	11:00
End of Curtailment	12:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2038.5 MWh
Total Estimated Curtailed Energy:	3.6 MWh
Percentage of Curtailed Energy	0.2%

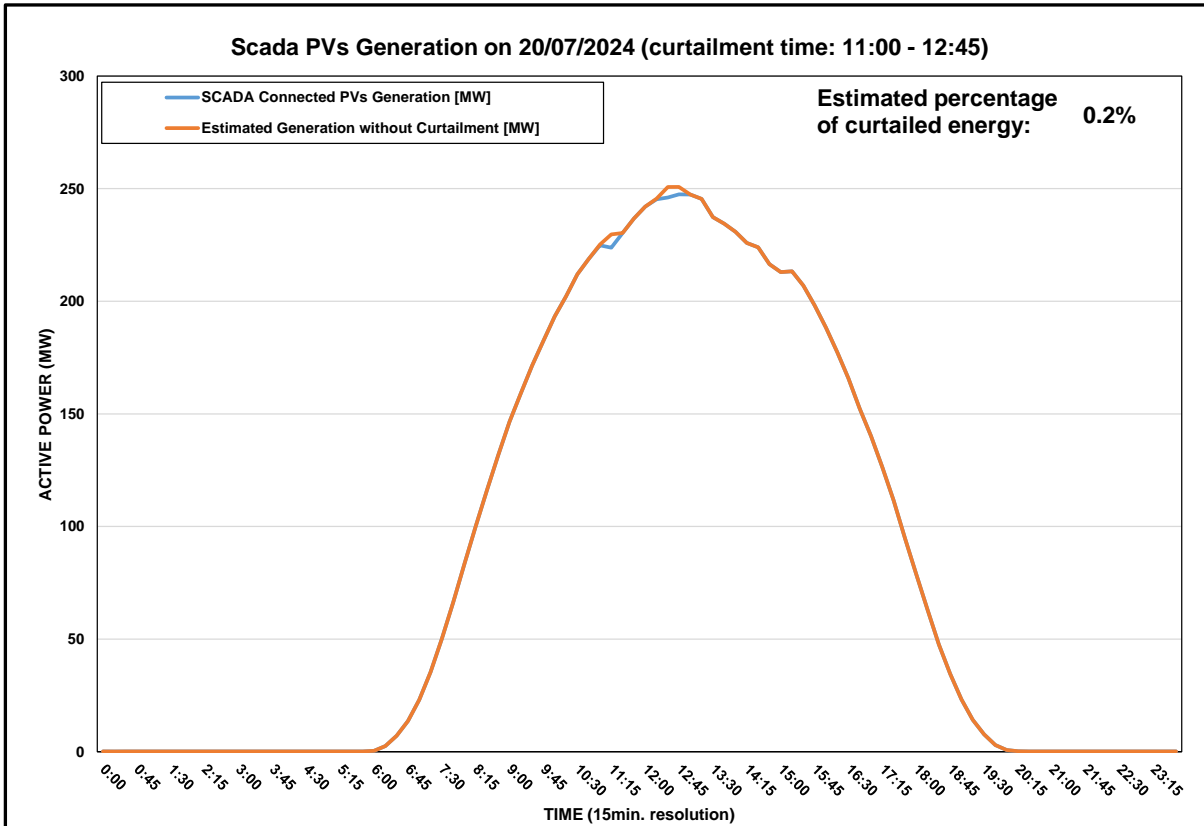


# DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



## Daily Curtailment Report of PV Generation

<b>Date of Curtailment</b>	21/07/2024
<b>Start of Curtailment</b>	9:15
<b>End of Curtailment</b>	14:00
<b>Instruction from TSOC</b>	YES
<b>Reason of Curtailment</b>	RES-E Generation Restriction due to low loading of the electrical system
<b>Total Estimated Energy of the day:</b>	2033.8 MWh
<b>Total Estimated Curtailed Energy:</b>	252.8 MWh
<b>Percentage of Curtailed Energy</b>	12.4%

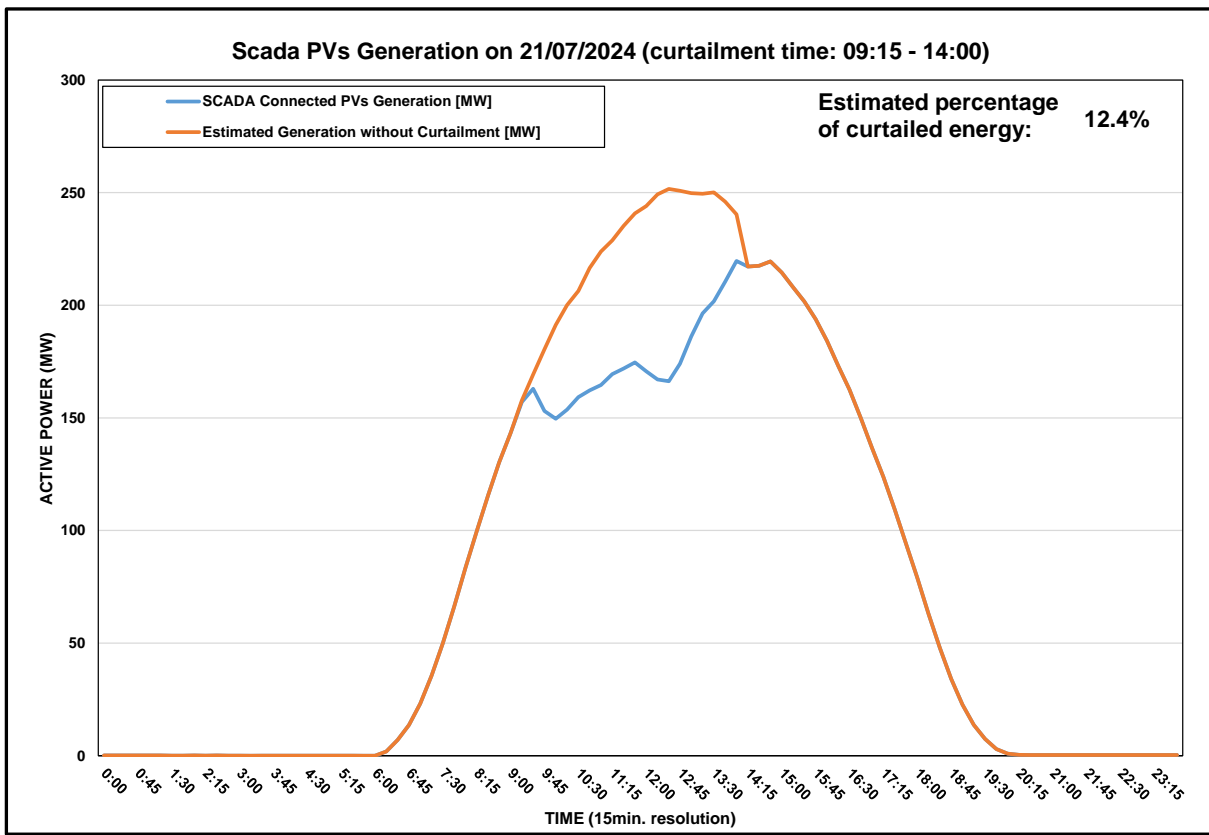


# DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



## Daily Curtailment Report of PV Generation

<b>Date of Curtailment</b>	27/07/2024
<b>Start of Curtailment</b>	11:00
<b>End of Curtailment</b>	12:30
<b>Instruction from TSOC</b>	YES
<b>Reason of Curtailment</b>	RES-E Generation Restriction due to low loading of the electrical system
<b>Total Estimated Energy of the day:</b>	1853.7 MWh
<b>Total Estimated Curtailed Energy:</b>	45.8 MWh
<b>Percentage of Curtailed Energy</b>	2.5%

**Scada PVs Generation on 27/07/2024 (curtailment time: 11:00 - 12:30)**

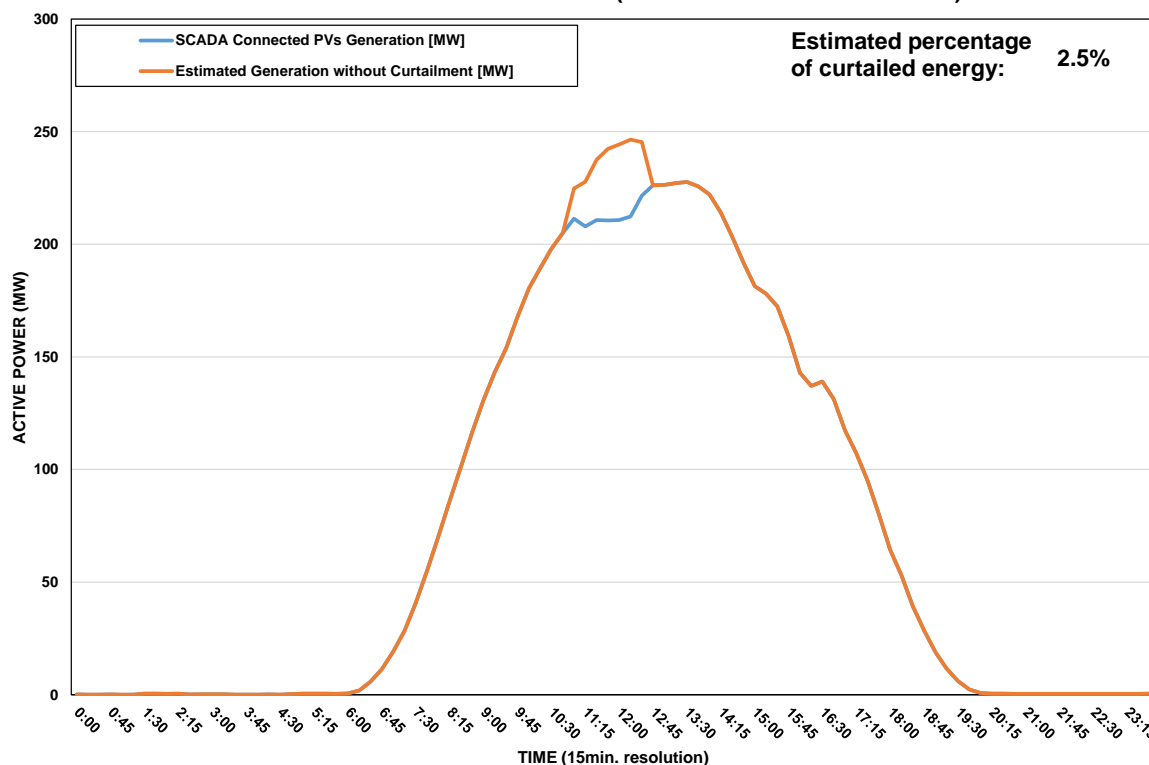

# DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



## Daily Curtailment Report of PV Generation

<b>Date of Curtailment</b>	<b>28/07/2024</b>
<b>Start of Curtailment</b>	<b>8:30</b>
<b>End of Curtailment</b>	<b>15:15</b>
<b>Instruction from TSOC</b>	<b>YES</b>
<b>Reason of Curtailment</b>	<i>RES-E Generation Restriction due to low loading of the electrical system</i>
<b>Total Estimated Energy of the day:</b>	<b>2132.4 MWh</b>
<b>Total Estimated Curtailed Energy:</b>	<b>886 MWh</b>
<b>Percentage of Curtailed Energy</b>	<b>41.5%</b>

