


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	03/08/2024
Start of Curtailment	11:00
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2124.9 MWh
Total Estimated Curtailed Energy:	116 MWh
Percentage of Curtailed Energy	5.5%

Scada PVs Generation on 03/08/2024 (curtailment time: 11:00 - 14:00)

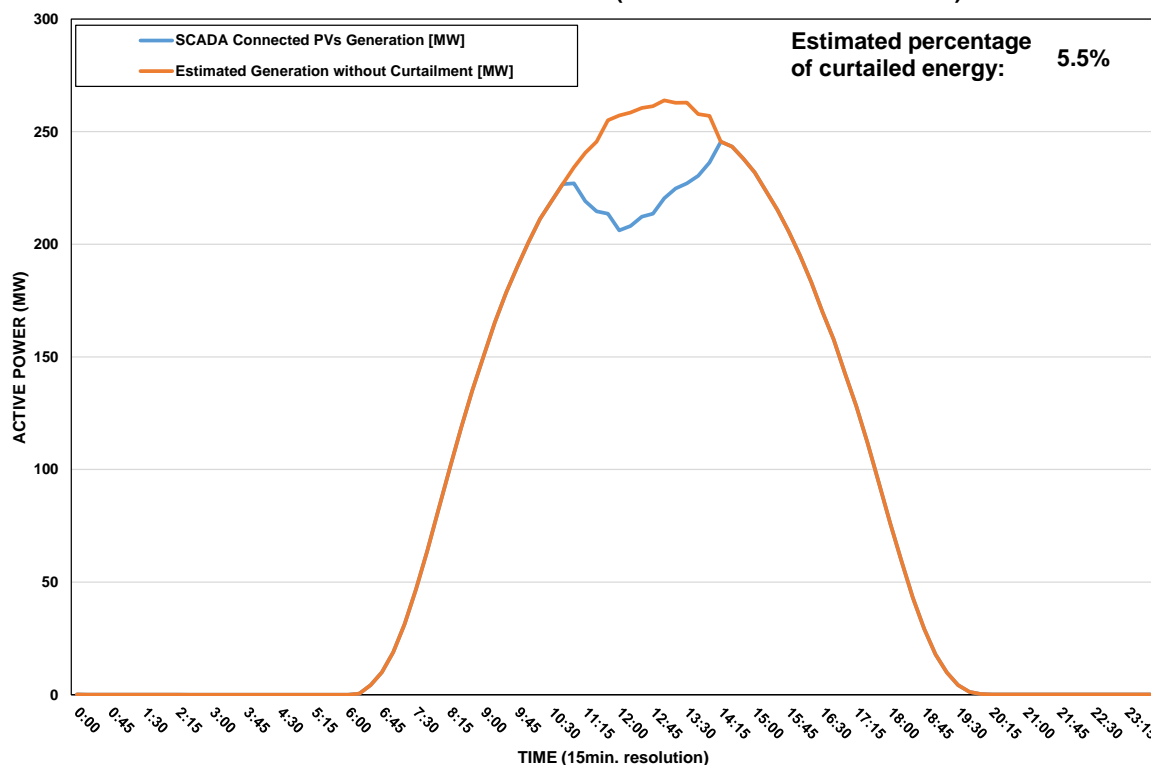


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	04/08/2024
Start of Curtailment	9:30
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2089.4 MWh
Total Estimated Curtailed Energy:	410.5 MWh
Percentage of Curtailed Energy	19.6%

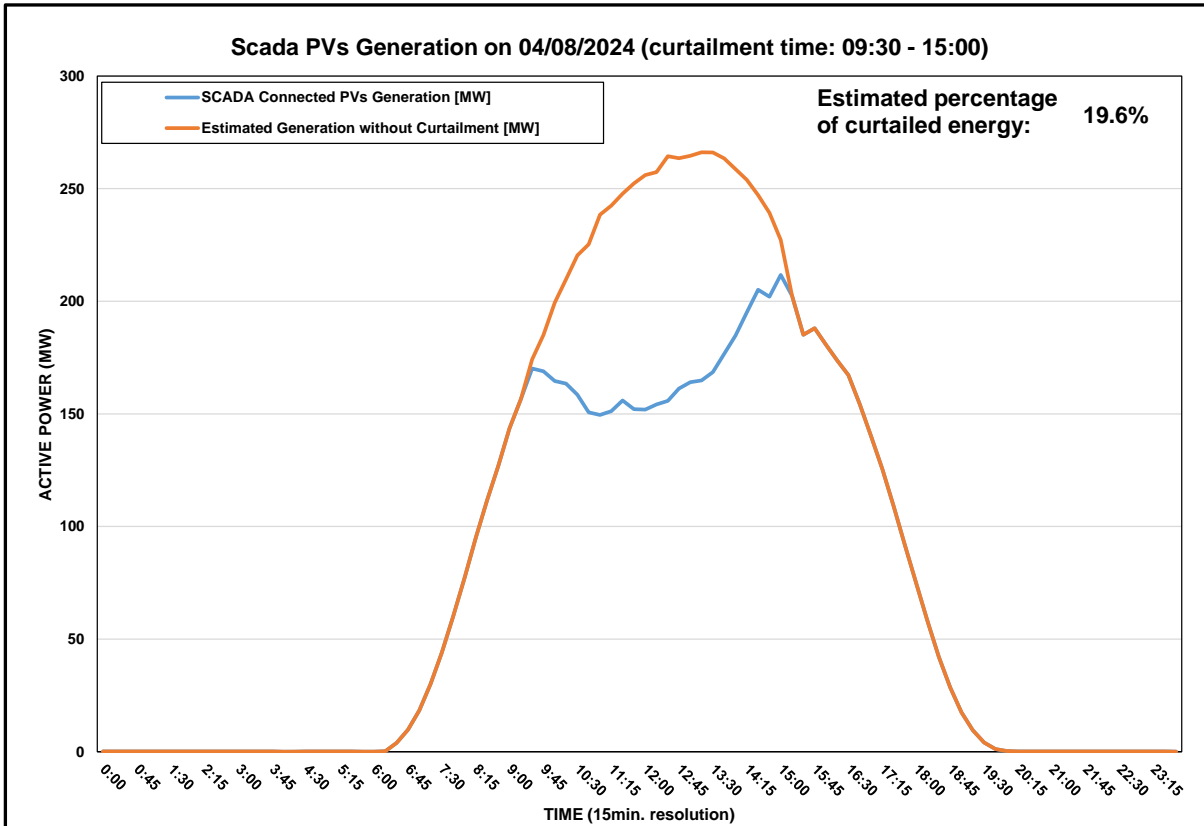


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	05/08/2024
Start of Curtailment	12:00
End of Curtailment	13:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2086.3 MWh
Total Estimated Curtailed Energy:	29.9 MWh
Percentage of Curtailed Energy	1.4%

Scada PVs Generation on 05/08/2024 (curtailment time: 12:00 - 13:30)

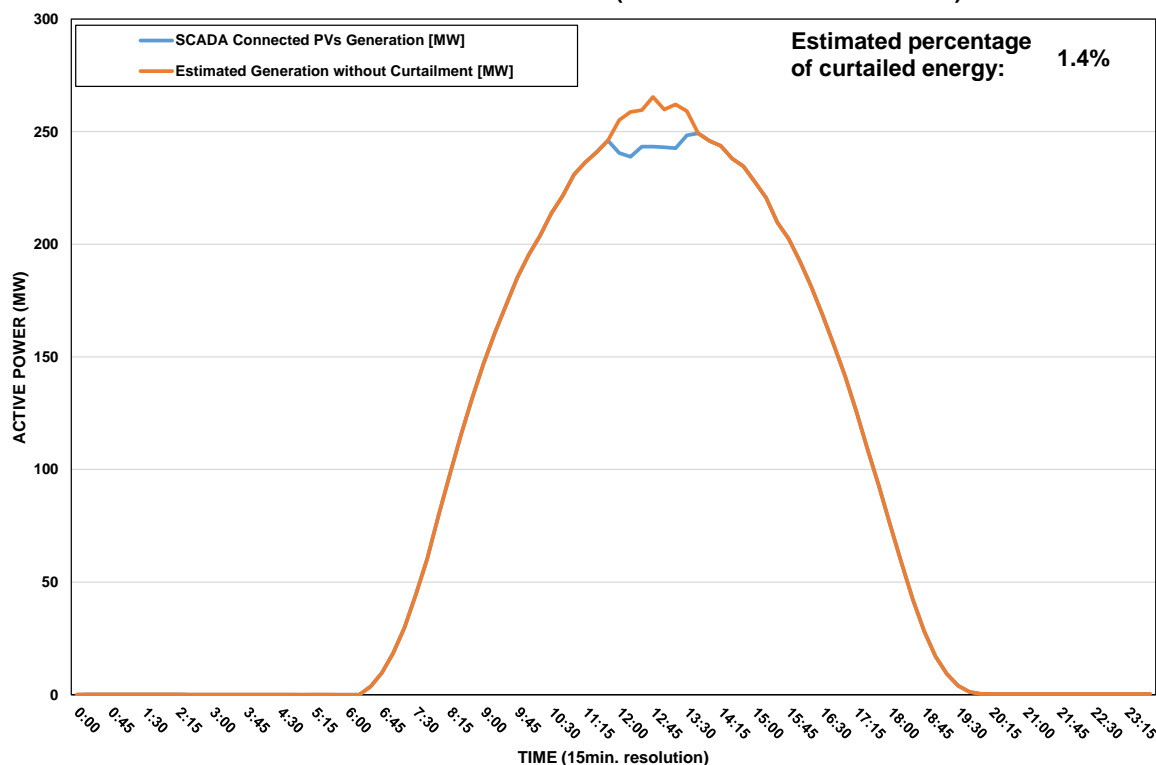


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	10/08/2024
Start of Curtailment	10:00
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2019.7 MWh
Total Estimated Curtailed Energy:	229.2 MWh
Percentage of Curtailed Energy	11.3%

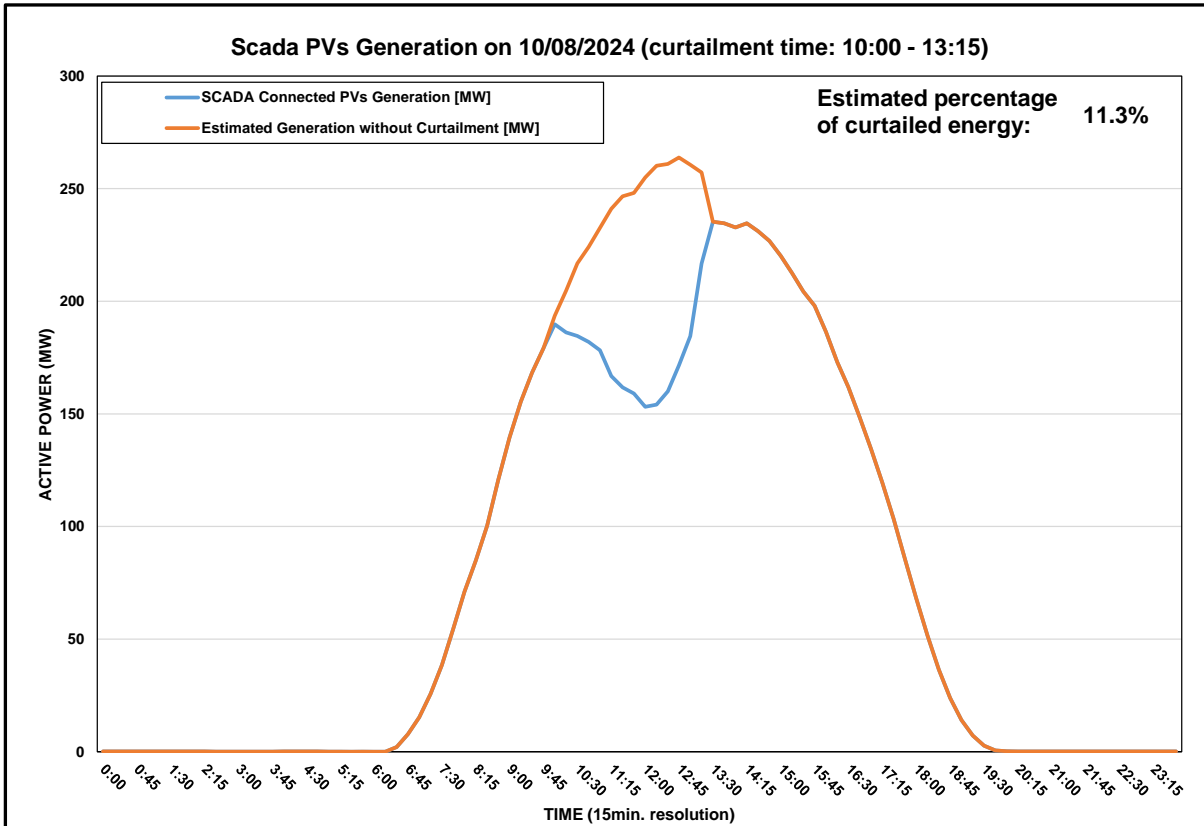


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	11/08/2024
Start of Curtailment	10:00
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1970.6 MWh
Total Estimated Curtailed Energy:	214 MWh
Percentage of Curtailed Energy	10.9%

Scada PVs Generation on 11/08/2024 (curtailment time: 10:00 - 14:00)

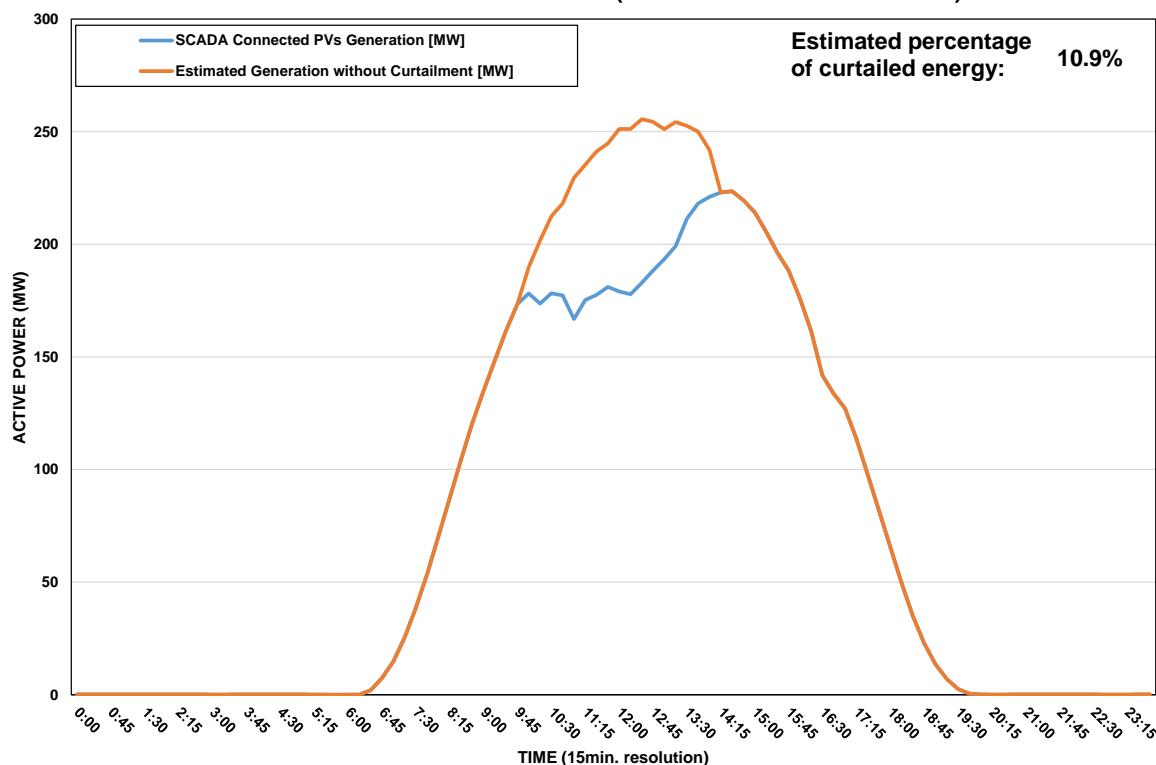


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	12/08/2024
Start of Curtailment	10:30
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2031.7 MWh
Total Estimated Curtailed Energy:	200.6 MWh
Percentage of Curtailed Energy	9.9%

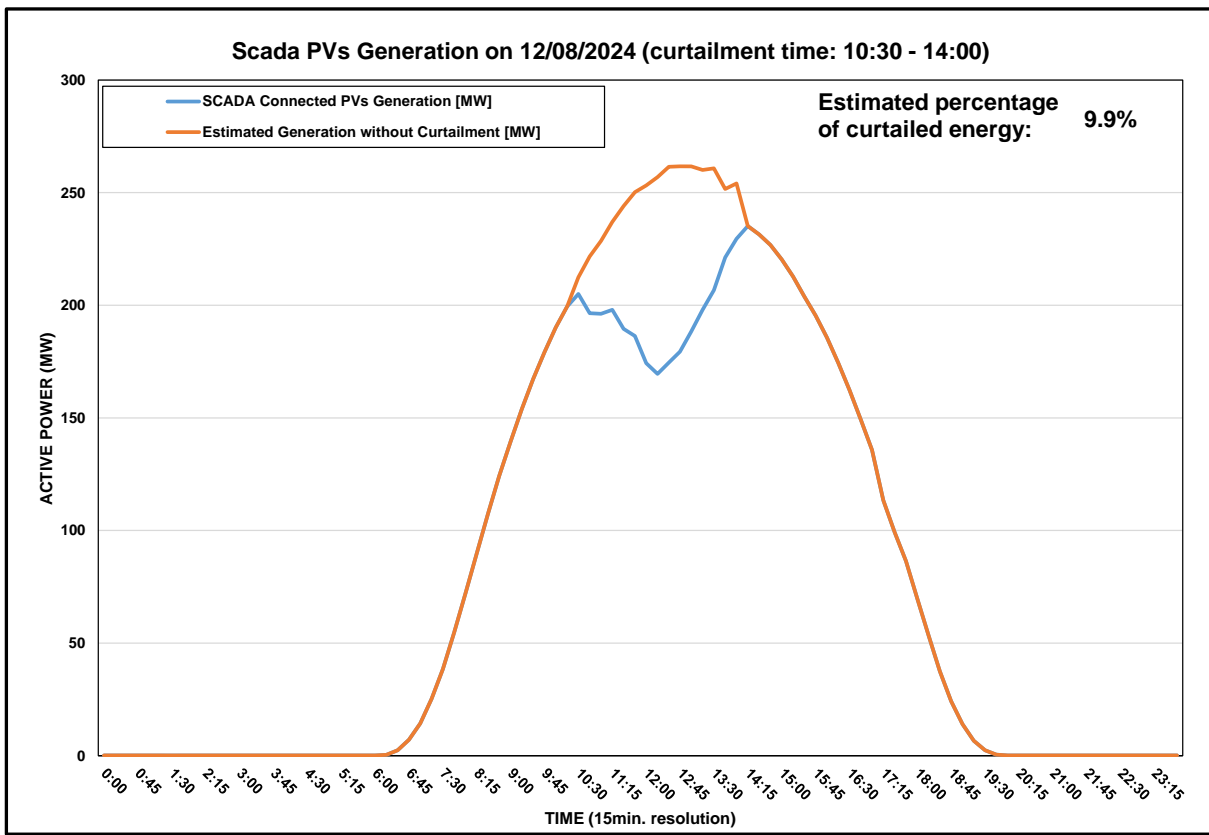


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	13/08/2024
Start of Curtailment	10:45
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2000.3 MWh
Total Estimated Curtailed Energy:	99.4 MWh
Percentage of Curtailed Energy	5.0%

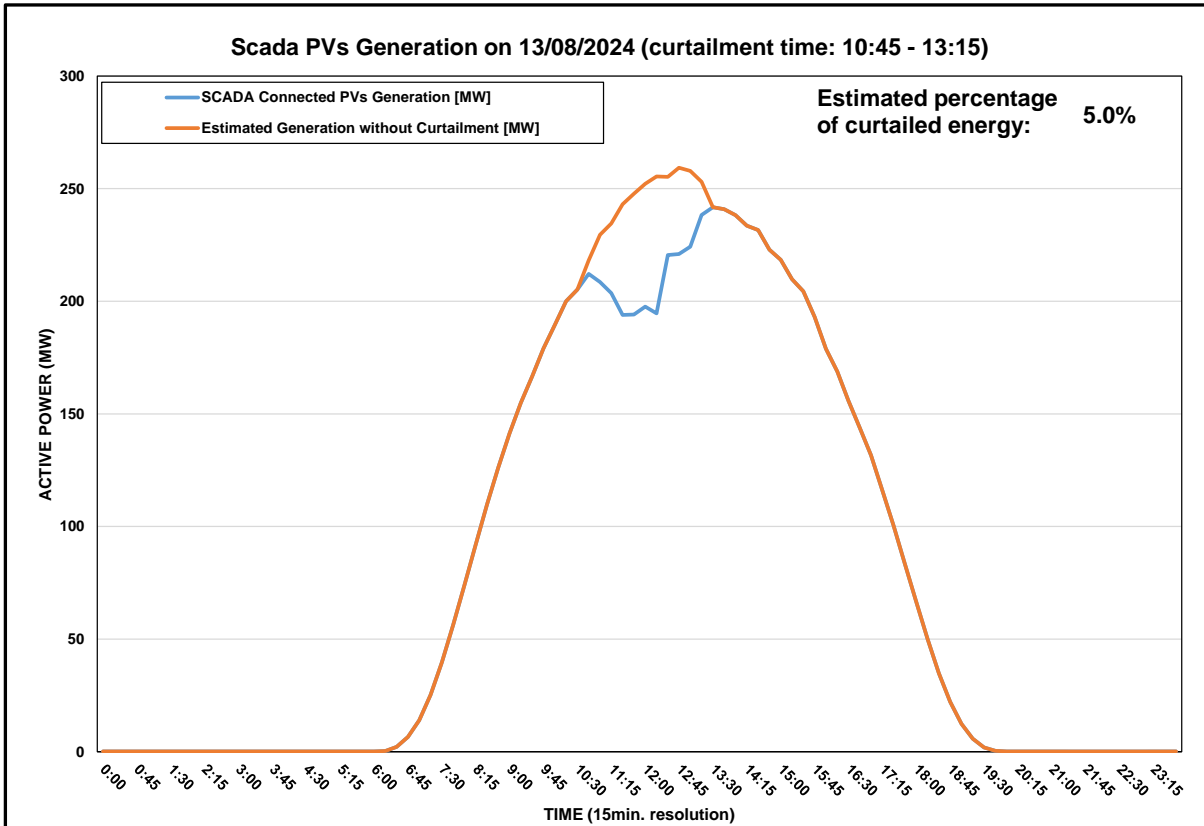


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	15/08/2024
Start of Curtailment	9:00
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2002 MWh
Total Estimated Curtailed Energy:	699.5 MWh
Percentage of Curtailed Energy	34.9%

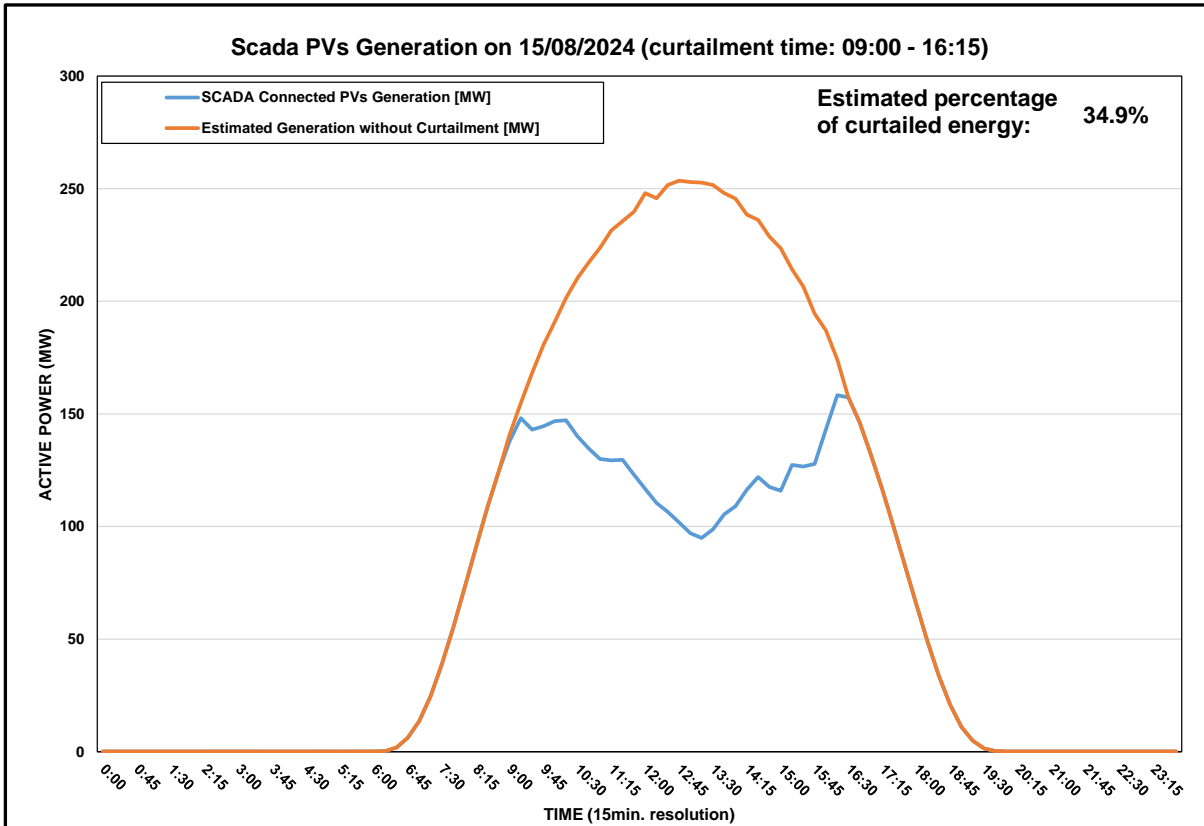


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	16/08/2024
Start of Curtailment	11:00
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1940.1 MWh
Total Estimated Curtailed Energy:	106.2 MWh
Percentage of Curtailed Energy	5.5%

Scada PVs Generation on 16/08/2024 (curtailment time: 11:00 - 13:45)

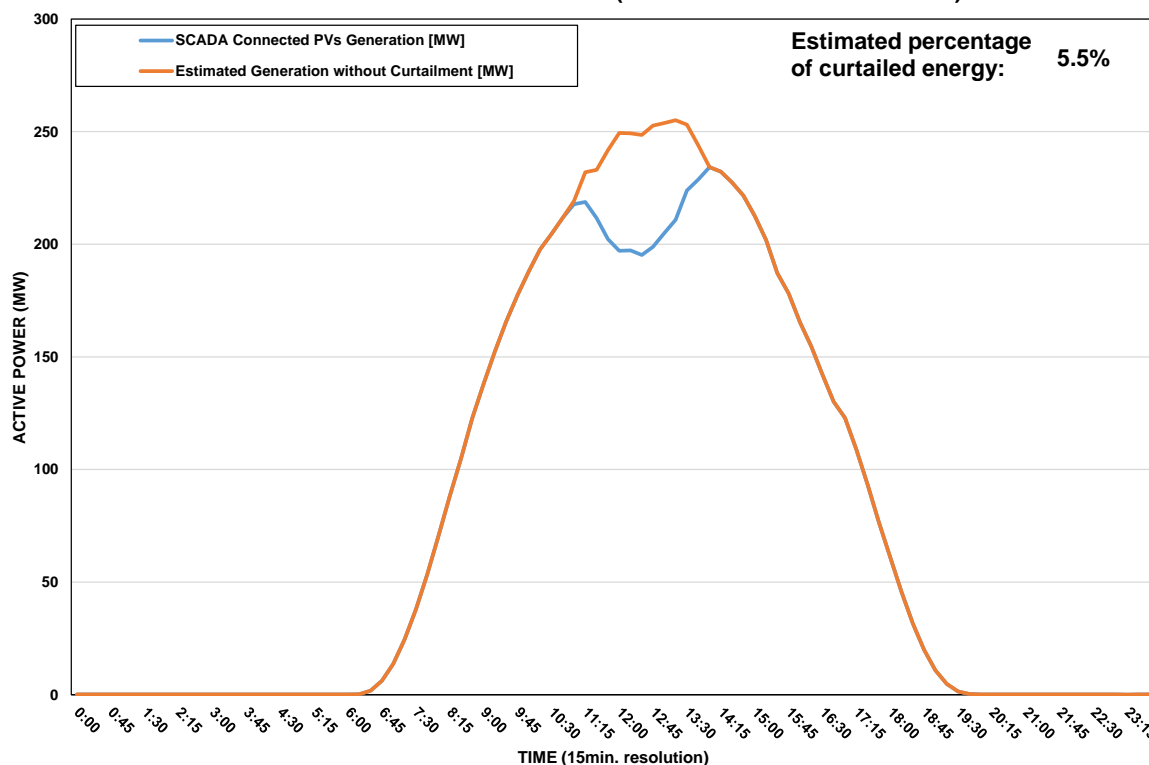


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	17/08/2024
Start of Curtailment	12:00
End of Curtailment	12:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1934.7 MWh
Total Estimated Curtailed Energy:	5.1 MWh
Percentage of Curtailed Energy	0.3%

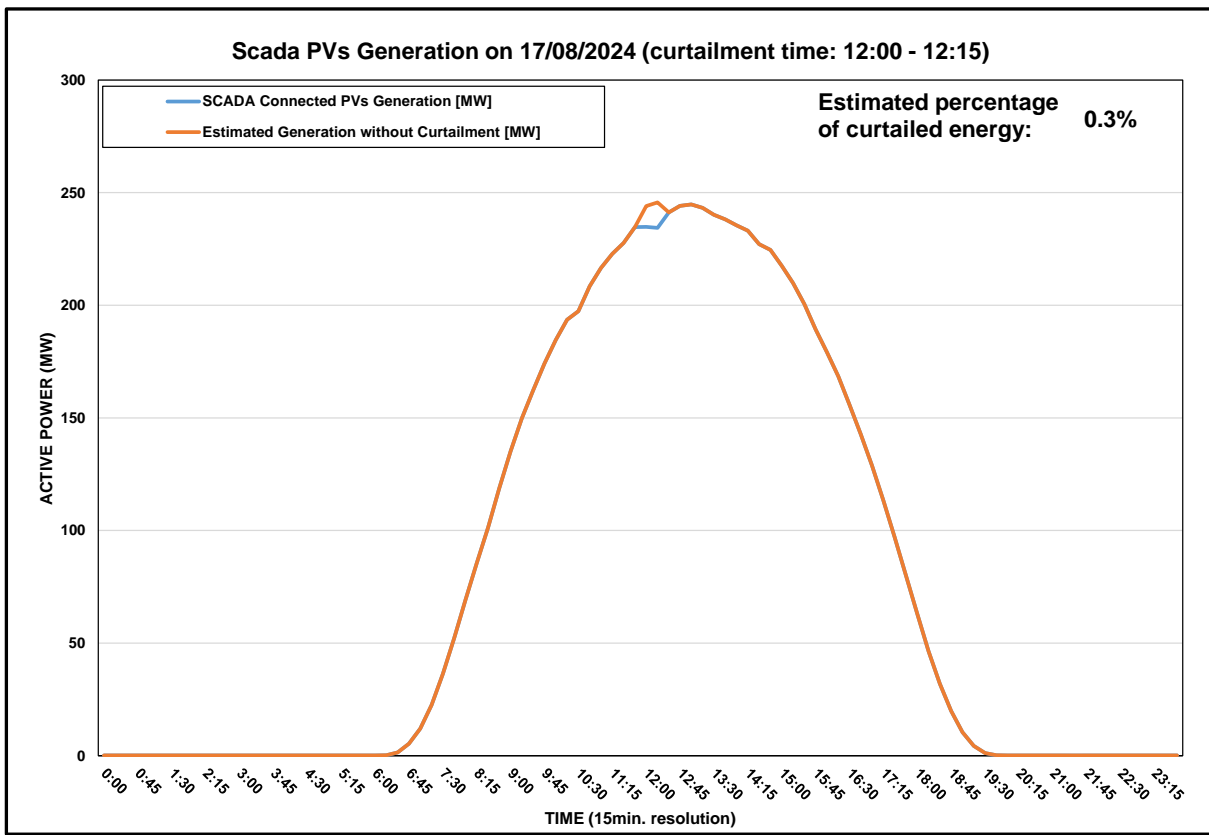


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	18/08/2024
Start of Curtailment	10:00
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1950 MWh
Total Estimated Curtailed Energy:	178.9 MWh
Percentage of Curtailed Energy	9.2%

Scada PVs Generation on 18/08/2024 (curtailment time: 10:00 - 13:45)

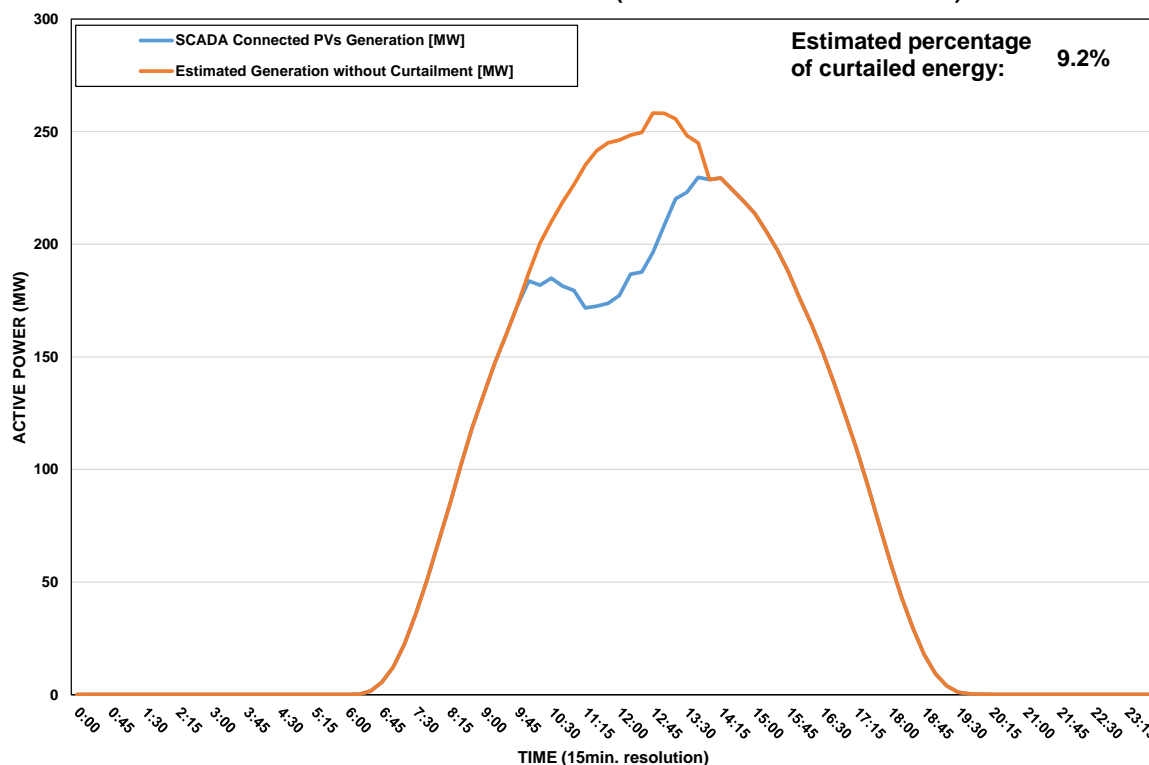


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	20/08/2024
Start of Curtailment	12:00
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1952.5 MWh
Total Estimated Curtailed Energy:	38.3 MWh
Percentage of Curtailed Energy	2.0%

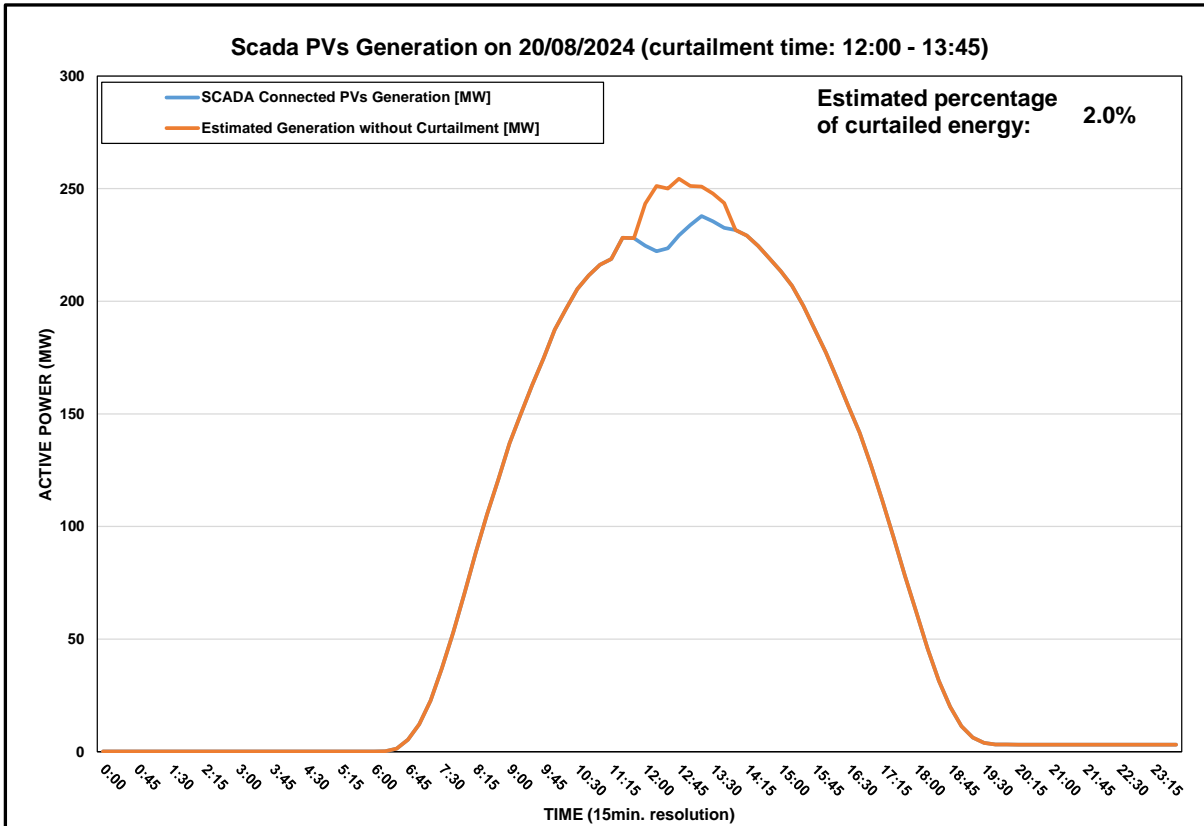


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	22/08/2024
Start of Curtailment	11:30
End of Curtailment	12:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1804.7 MWh
Total Estimated Curtailed Energy:	7.1 MWh
Percentage of Curtailed Energy	0.4%

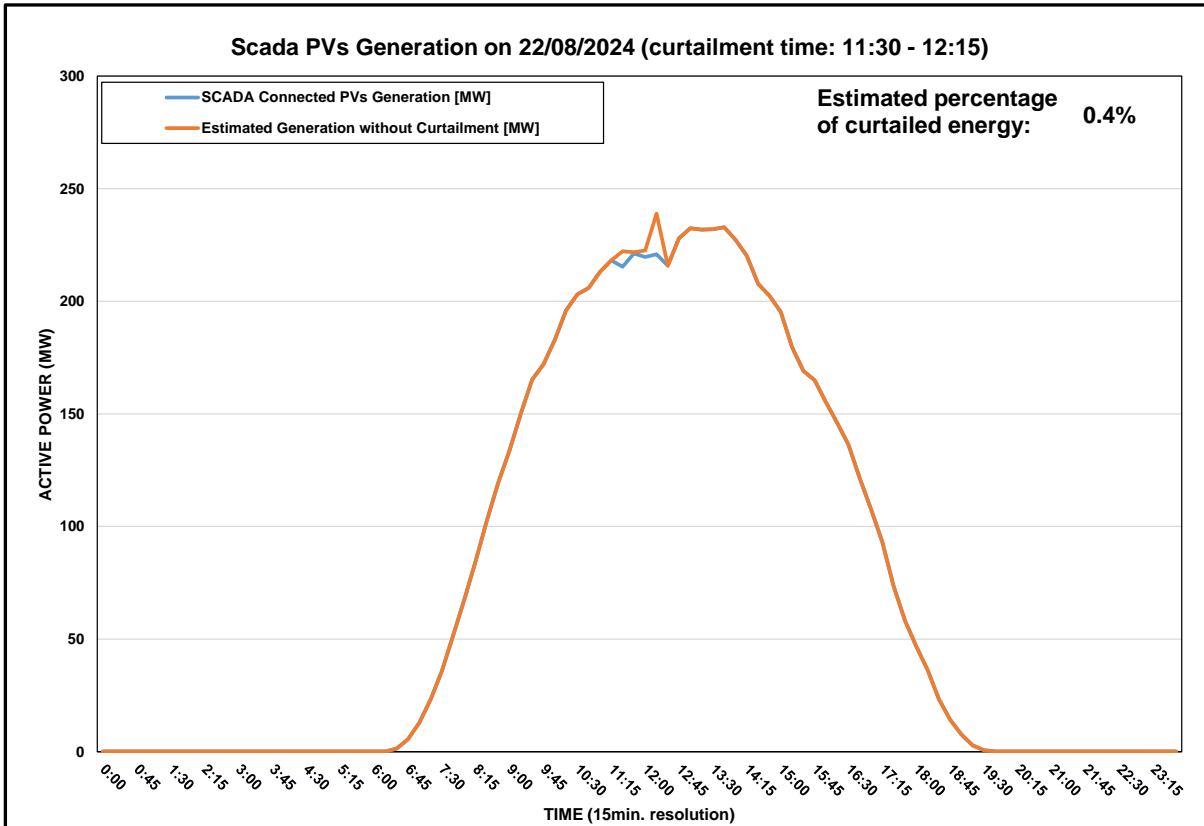


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	24/08/2024
Start of Curtailment	11:15
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1875.4 MWh
Total Estimated Curtailed Energy:	66.4 MWh
Percentage of Curtailed Energy	3.5%

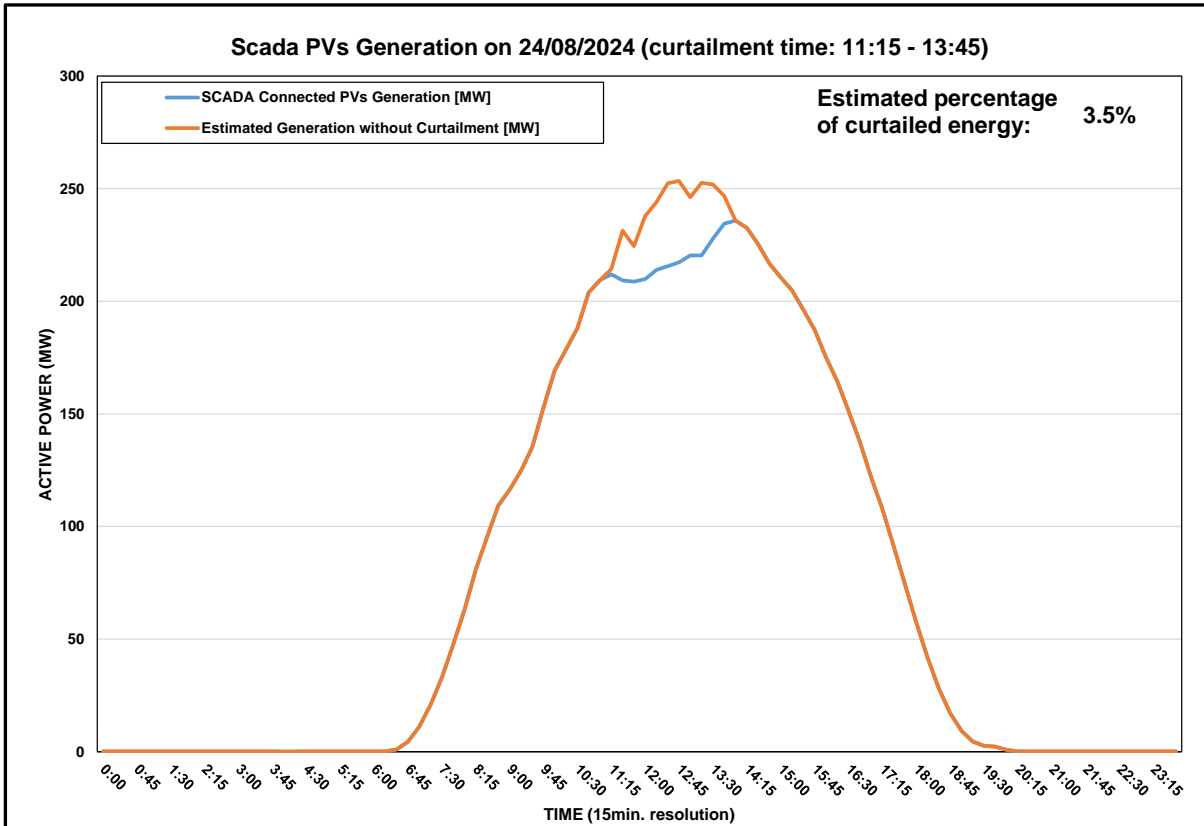


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	25/08/2024
Start of Curtailment	10:45
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1793.6 MWh
Total Estimated Curtailed Energy:	98 MWh
Percentage of Curtailed Energy	5.5%

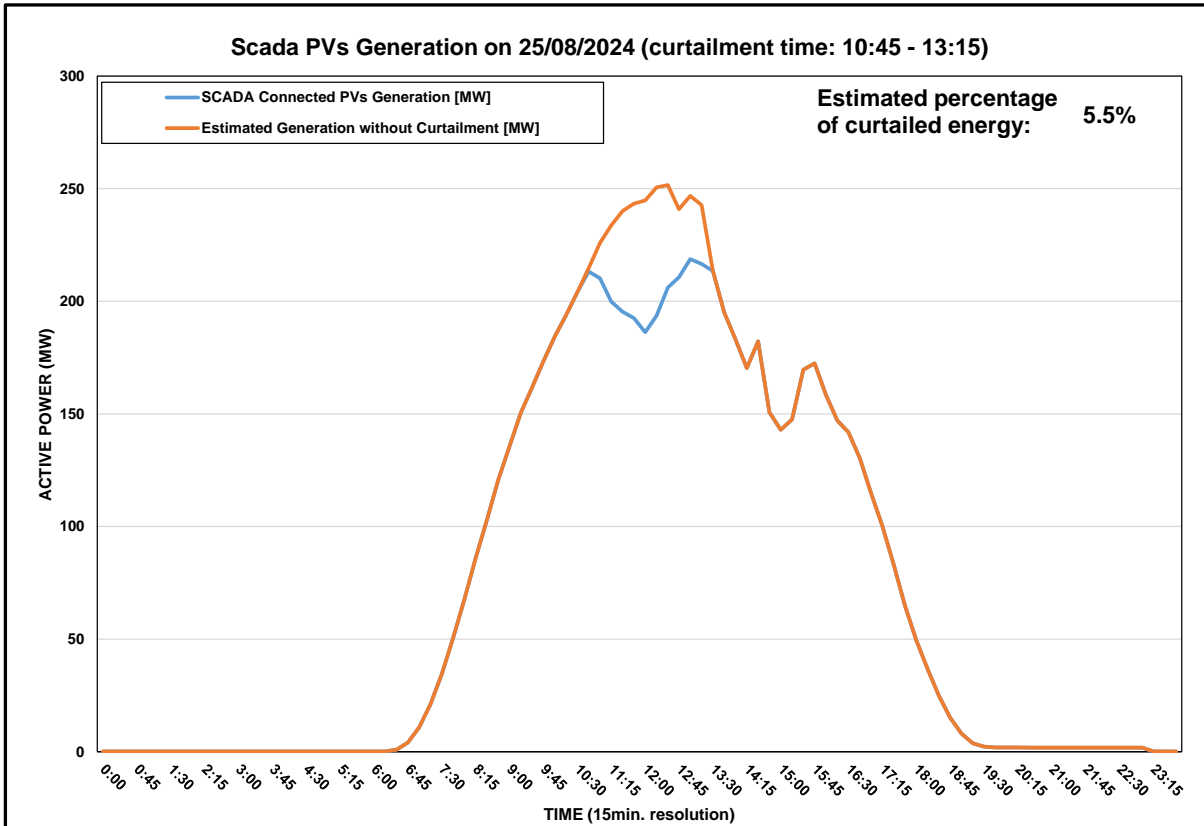


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	27/08/2024
Start of Curtailment	11:00
End of Curtailment	13:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1818.6 MWh
Total Estimated Curtailed Energy:	91.4 MWh
Percentage of Curtailed Energy	5.0%

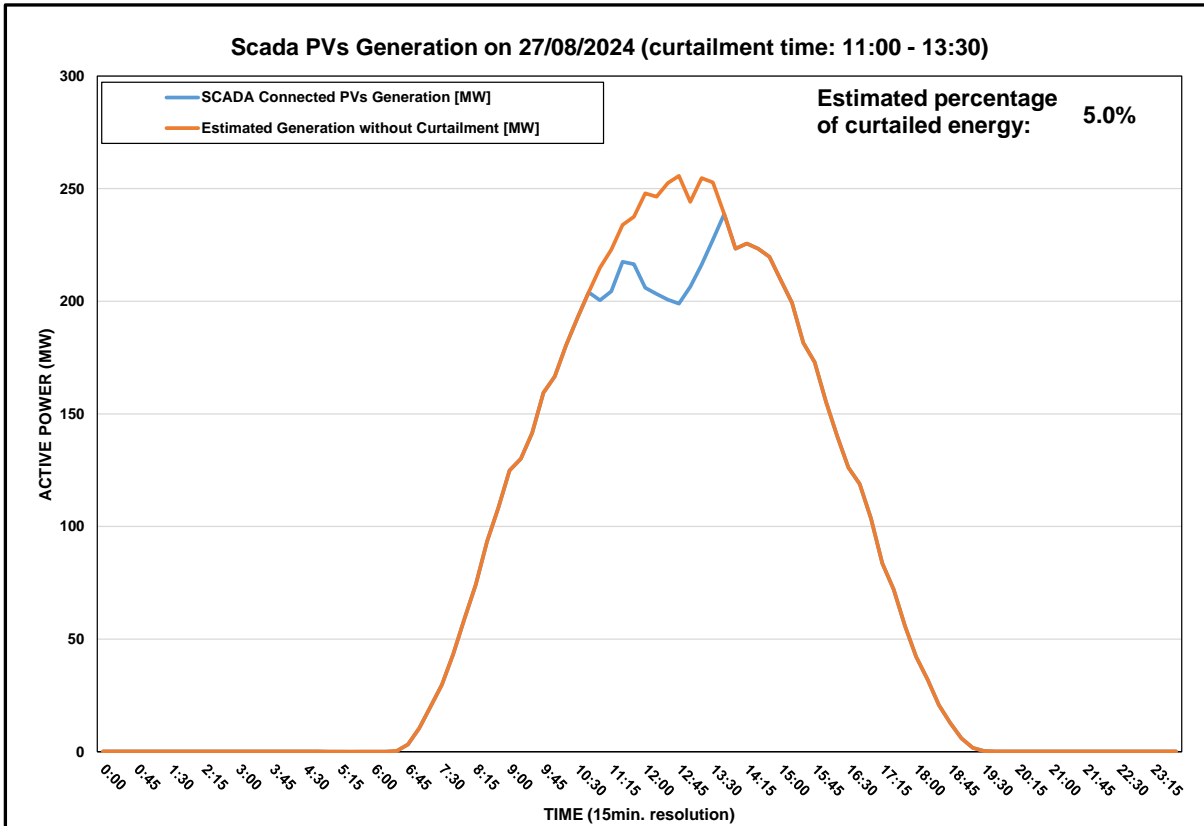


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	29/08/2024
Start of Curtailment	10:30
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1873.9 MWh
Total Estimated Curtailed Energy:	196.7 MWh
Percentage of Curtailed Energy	10.5%

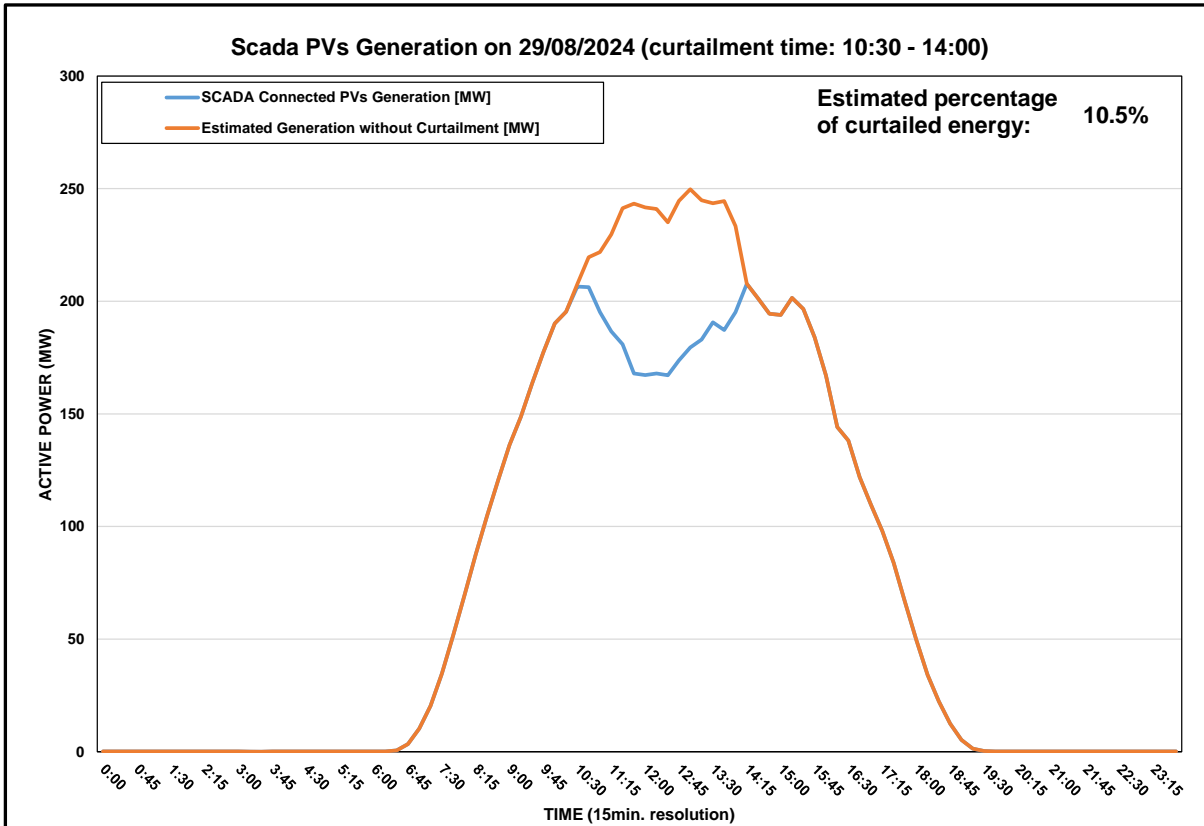

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	31/08/2024
Start of Curtailment	10:15
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1827.9 MWh
Total Estimated Curtailed Energy:	190.3 MWh
Percentage of Curtailed Energy	10.4%

Scada PVs Generation on 31/08/2024 (curtailment time: 10:15 - 14:30)

