


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	01/03/2024
Start of Curtailment	8:45
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1874.1 MWh
Total Estimated Curtailed Energy:	982.9 MWh
Percentage of Curtailed Energy	52.4%

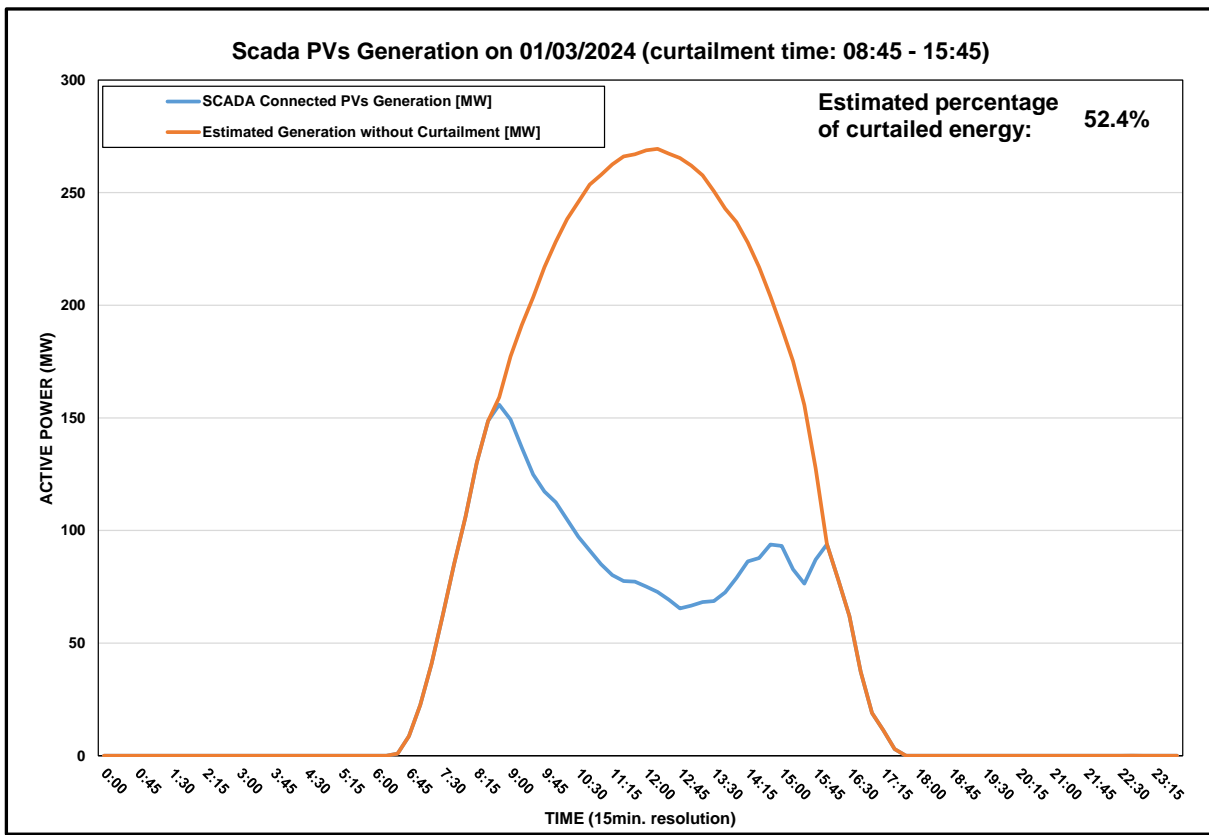


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	02/03/2024
Start of Curtailment	8:30
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1708.1 MWh
Total Estimated Curtailed Energy:	1073.5 MWh
Percentage of Curtailed Energy	62.9%

Scada PVs Generation on 02/03/2024 (curtailment time: 08:30 - 16:00)

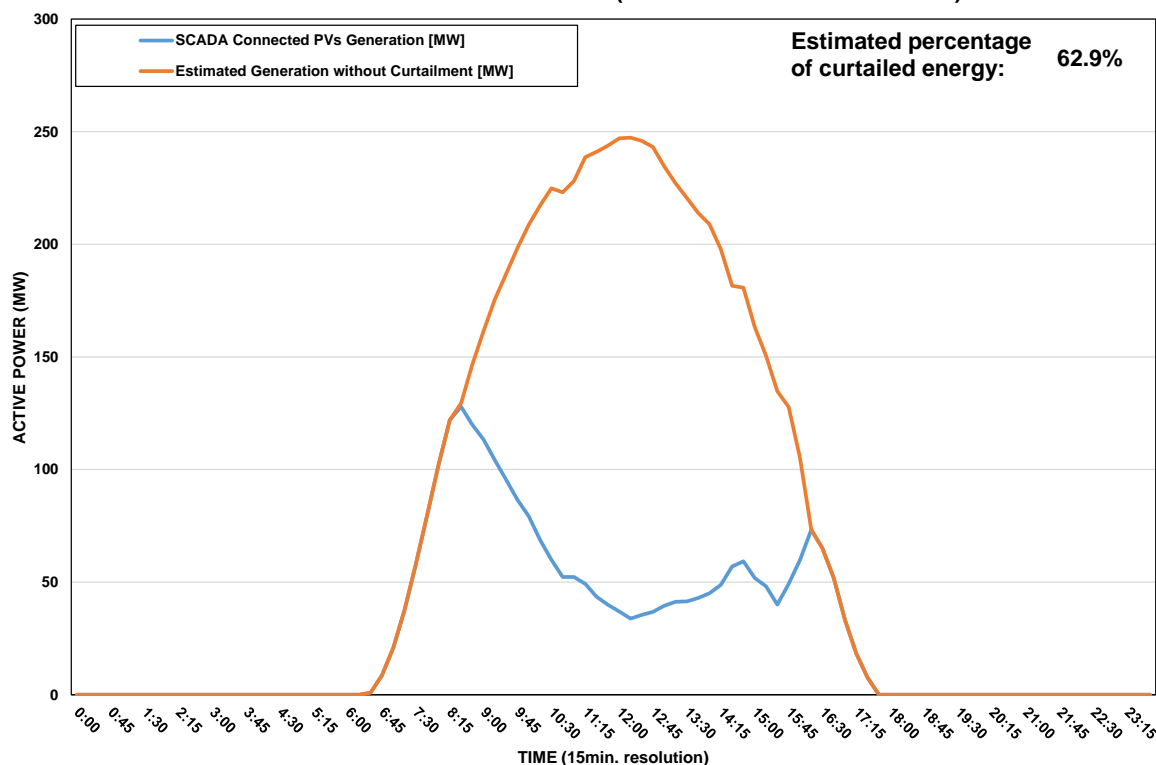


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	03/03/2024
Start of Curtailment	8:30
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1131.4 MWh
Total Estimated Curtailed Energy:	379.2 MWh
Percentage of Curtailed Energy	33.5%

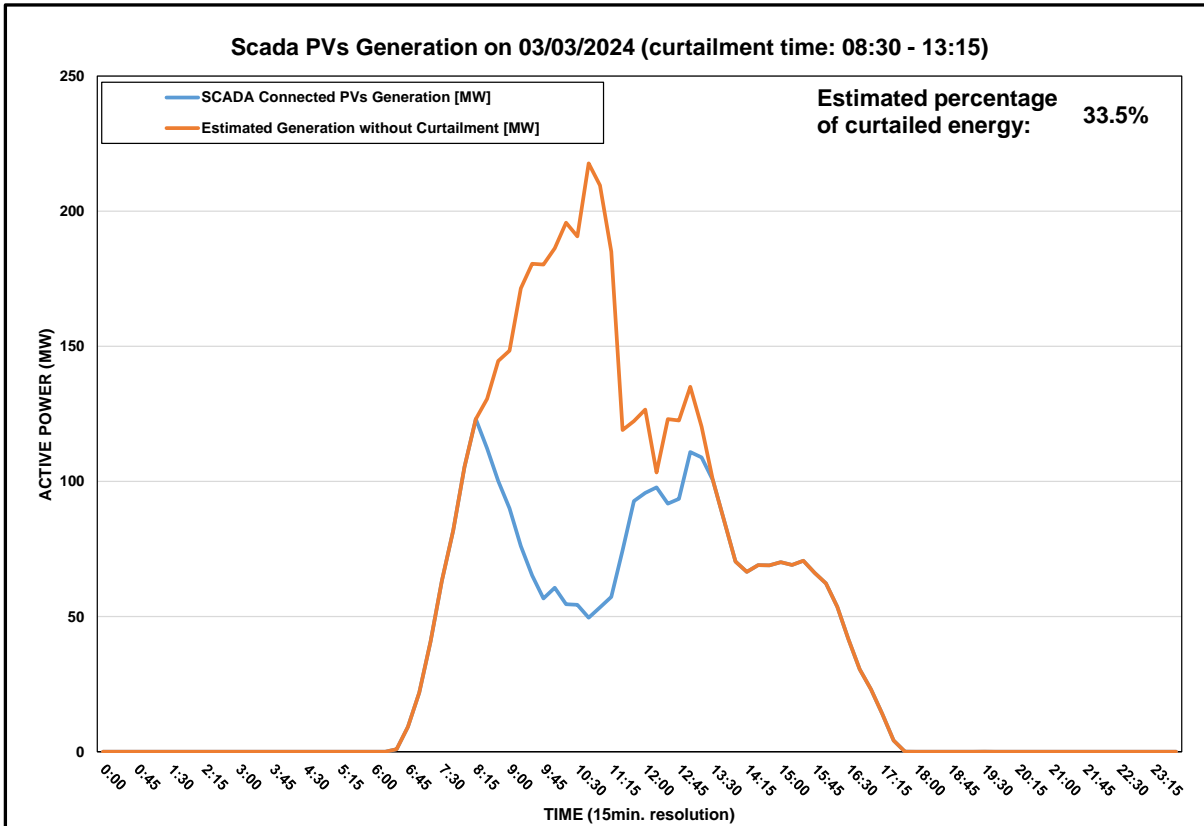


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	04/03/2024
Start of Curtailment	9:00
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1472.2 MWh
Total Estimated Curtailed Energy:	573.2 MWh
Percentage of Curtailed Energy	38.9%

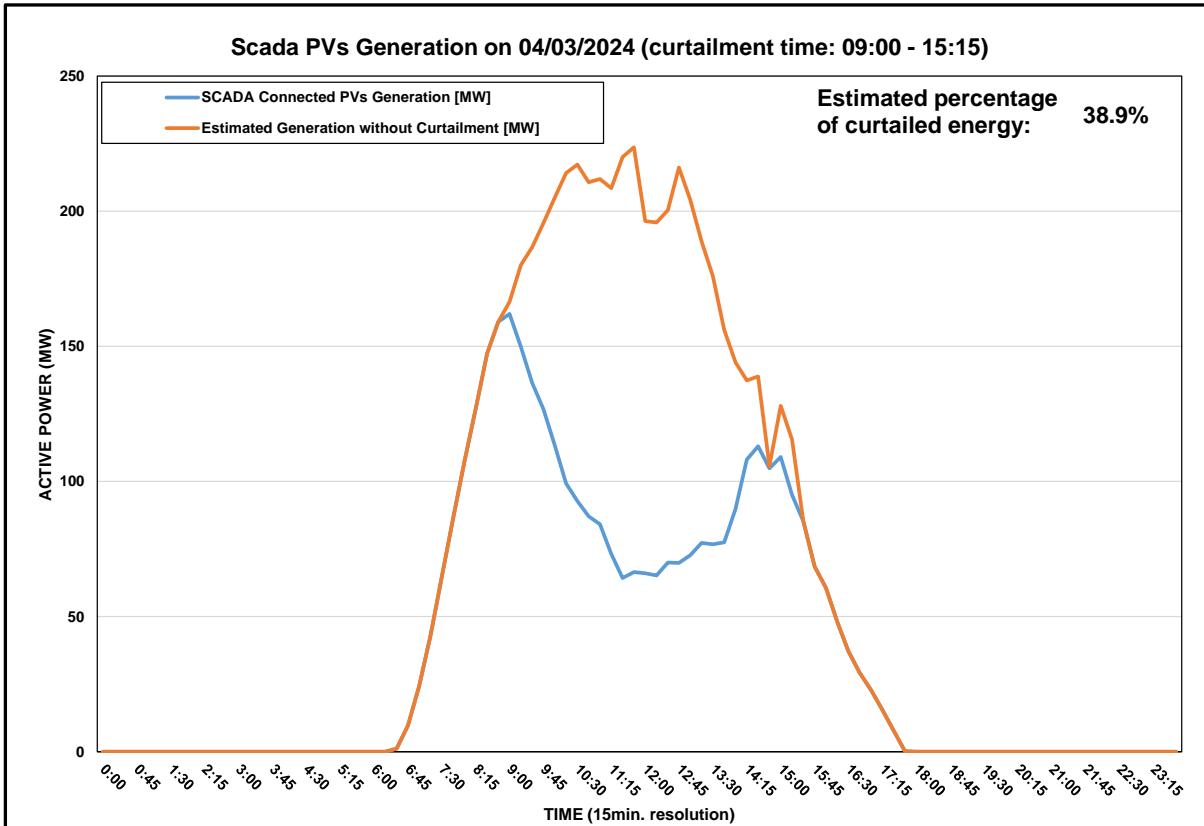


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	05/03/2024
Start of Curtailment	9:00
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1834.6 MWh
Total Estimated Curtailed Energy:	914 MWh
Percentage of Curtailed Energy	49.8%

Scada PVs Generation on 05/03/2024 (curtailment time: 09:00 - 15:30)

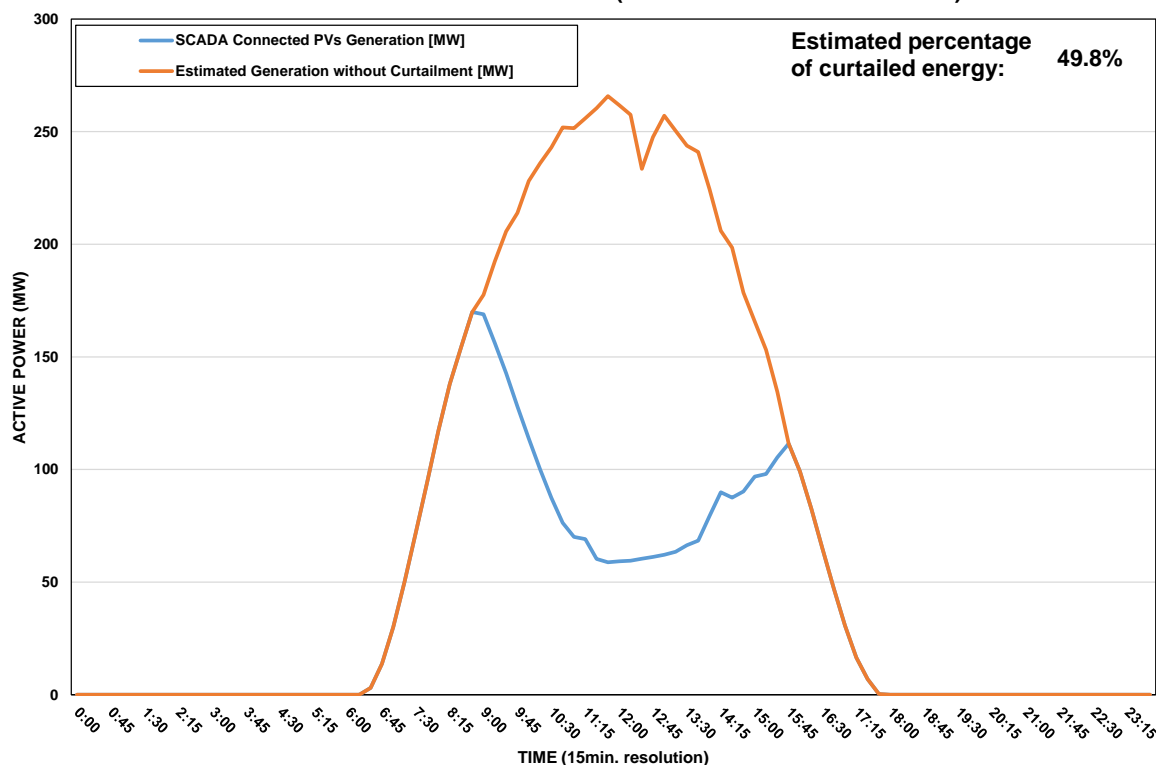


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	06/03/2024
Start of Curtailment	9:00
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1406.4 MWh
Total Estimated Curtailed Energy:	481.1 MWh
Percentage of Curtailed Energy	34.2%

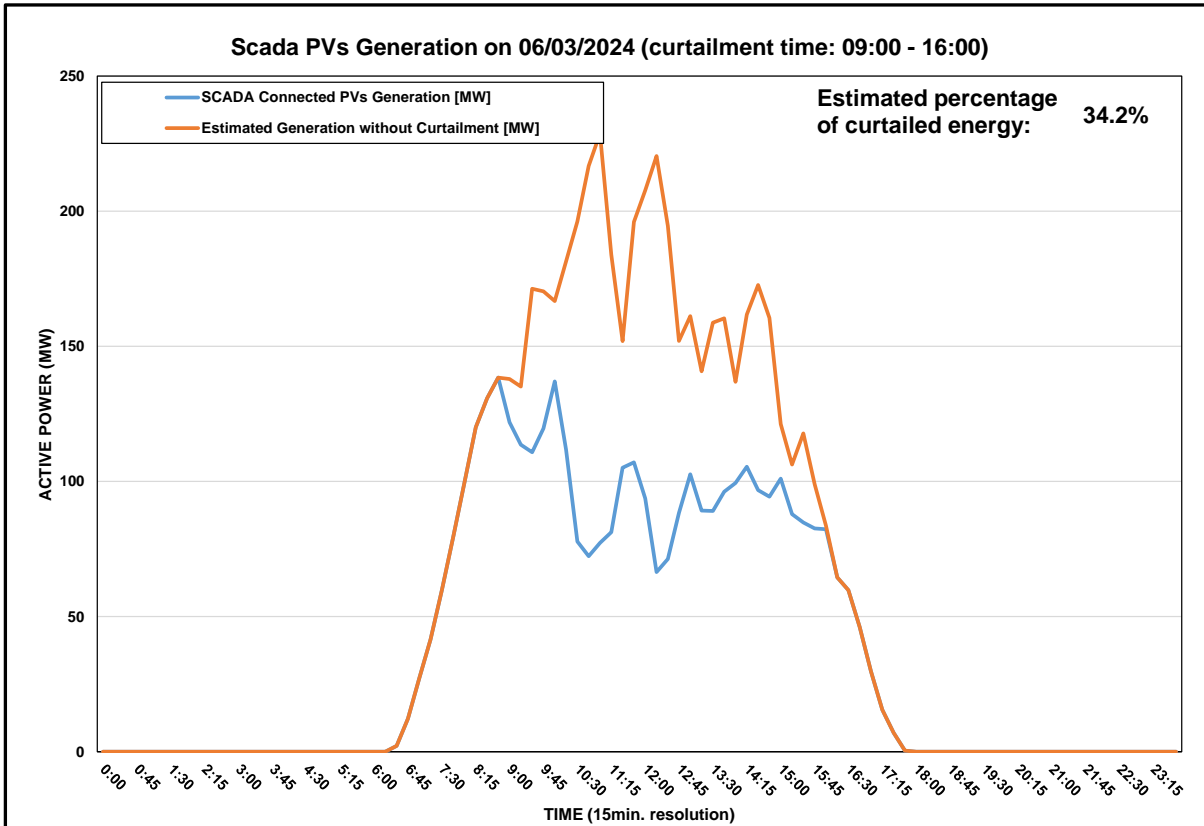


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	07/03/2024
Start of Curtailment	9:15
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1501.8 MWh
Total Estimated Curtailed Energy:	728.8 MWh
Percentage of Curtailed Energy	48.5%

Scada PVs Generation on 07/03/2024 (curtailment time: 09:15 - 16:15)

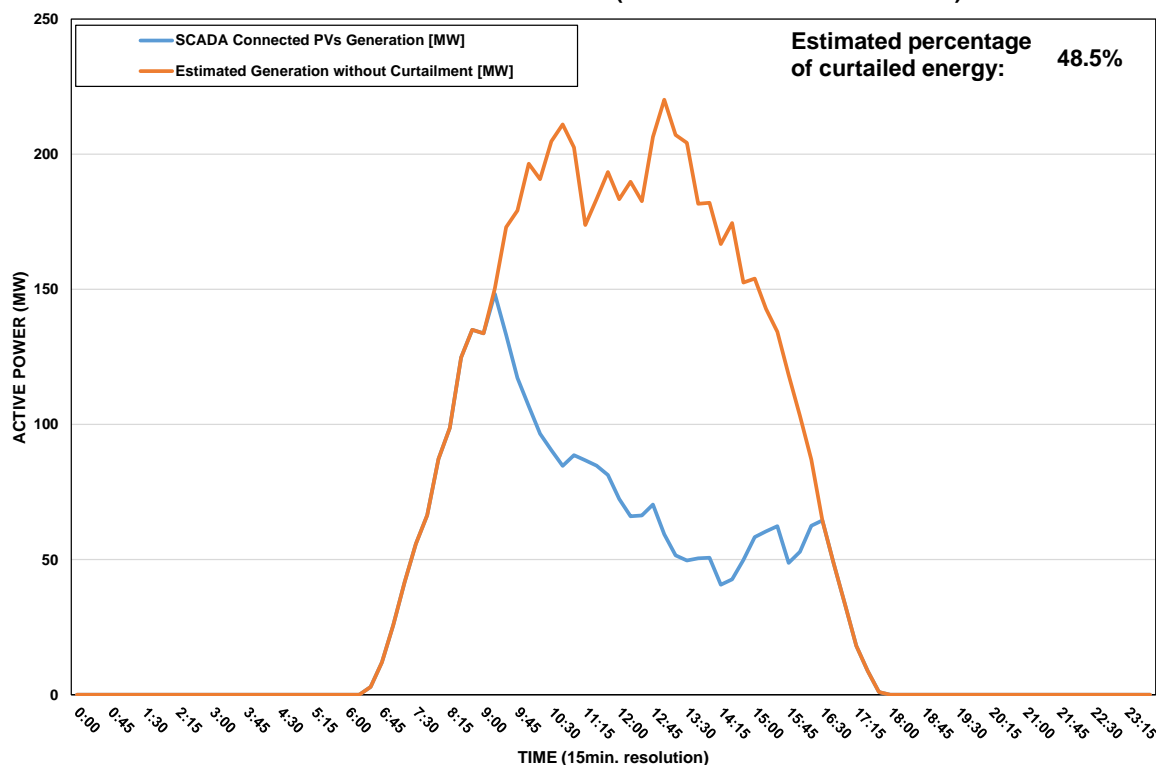


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	08/03/2024
Start of Curtailment	8:45
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1697.1 MWh
Total Estimated Curtailed Energy:	741.9 MWh
Percentage of Curtailed Energy	43.7%

Scada PVs Generation on 08/03/2024 (curtailment time: 08:45 - 15:00)

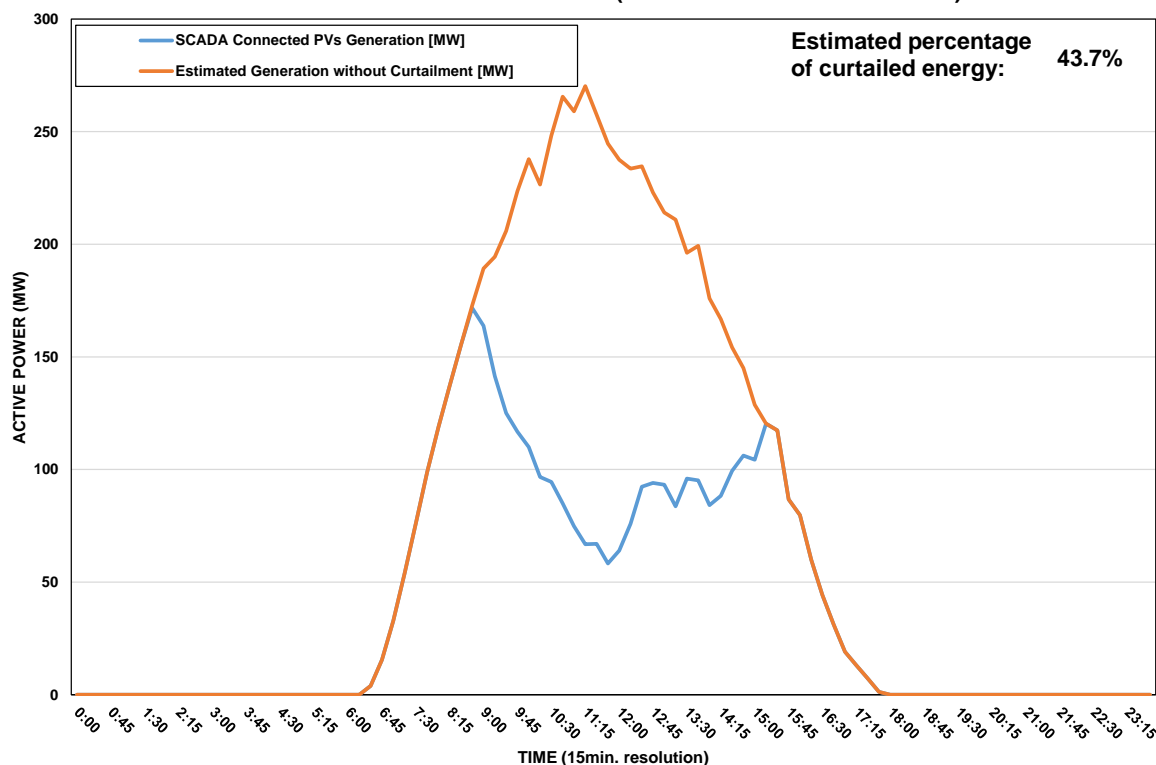


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	09/03/2024
Start of Curtailment	8:15
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1621.2 MWh
Total Estimated Curtailed Energy:	1032.9 MWh
Percentage of Curtailed Energy	63.7%

Scada PVs Generation on 09/03/2024 (curtailment time: 08:15 - 16:00)

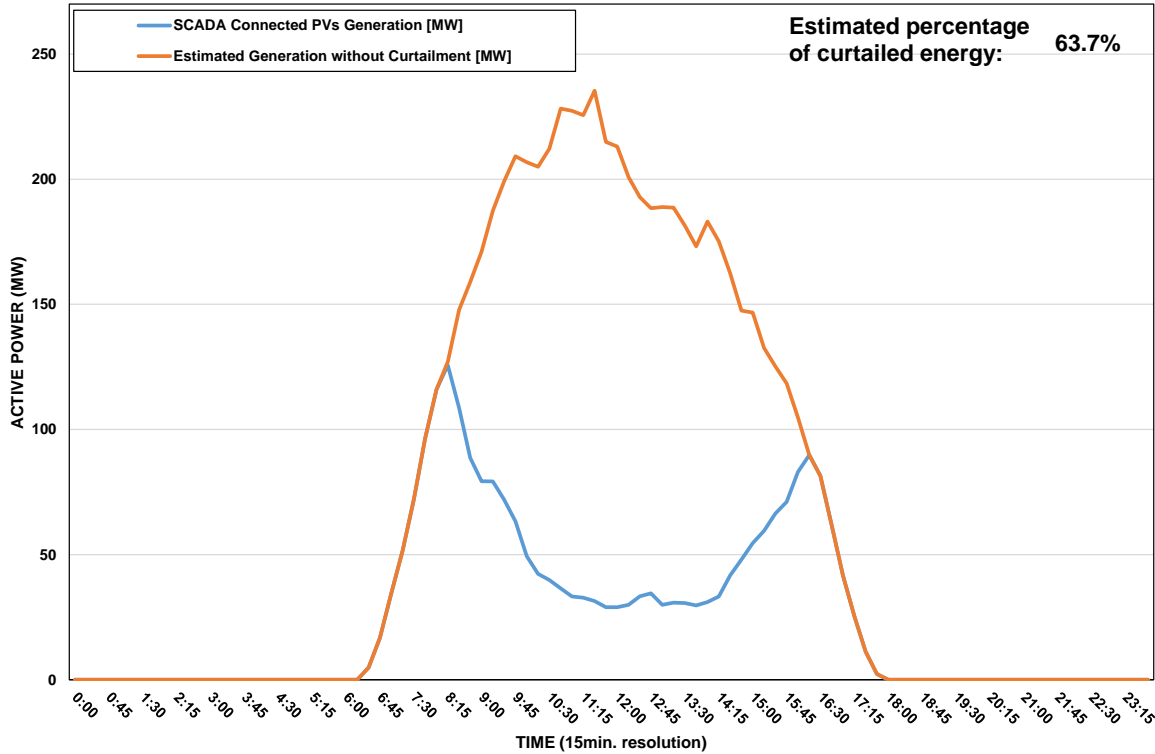


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	10/03/2024
Start of Curtailment	8:45
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1303.6 MWh
Total Estimated Curtailed Energy:	433 MWh
Percentage of Curtailed Energy	33.2%

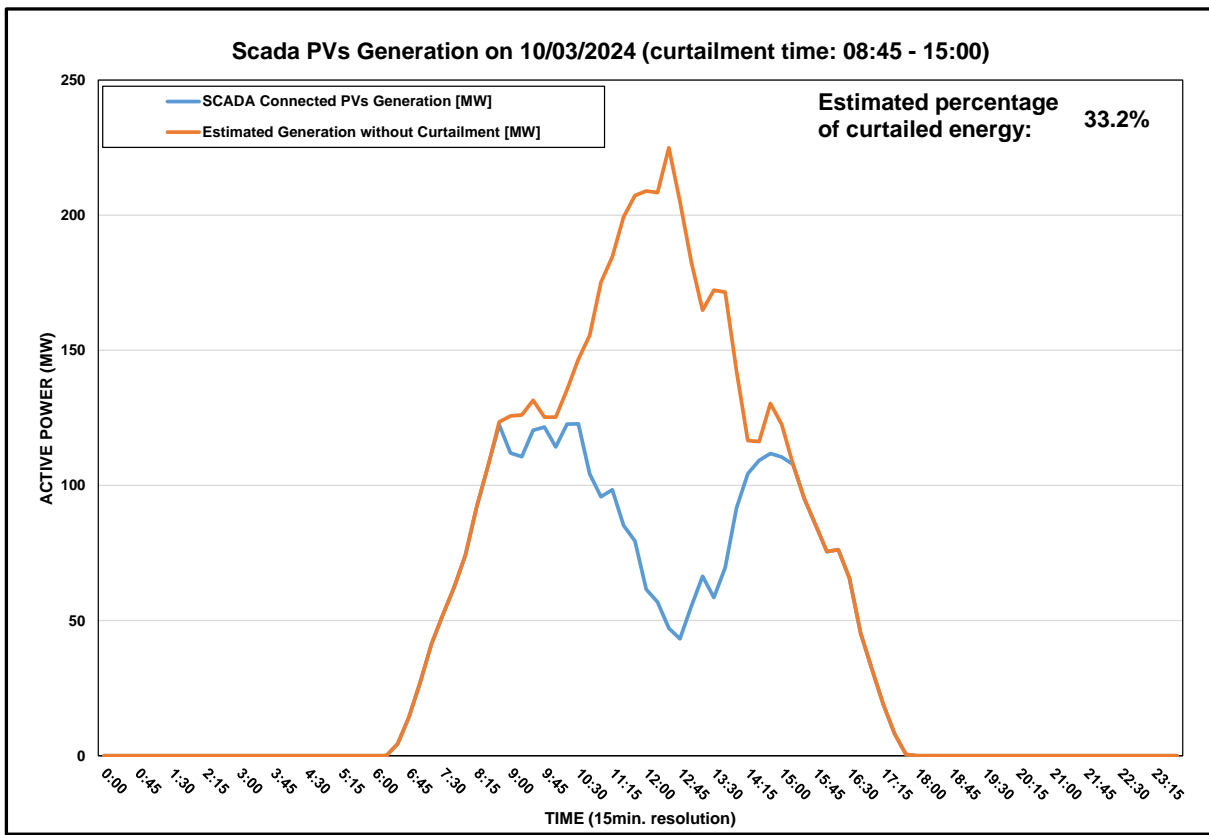


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	11/03/2024
Start of Curtailment	8:45
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1996.5 MWh
Total Estimated Curtailed Energy:	1031.2 MWh
Percentage of Curtailed Energy	51.7%

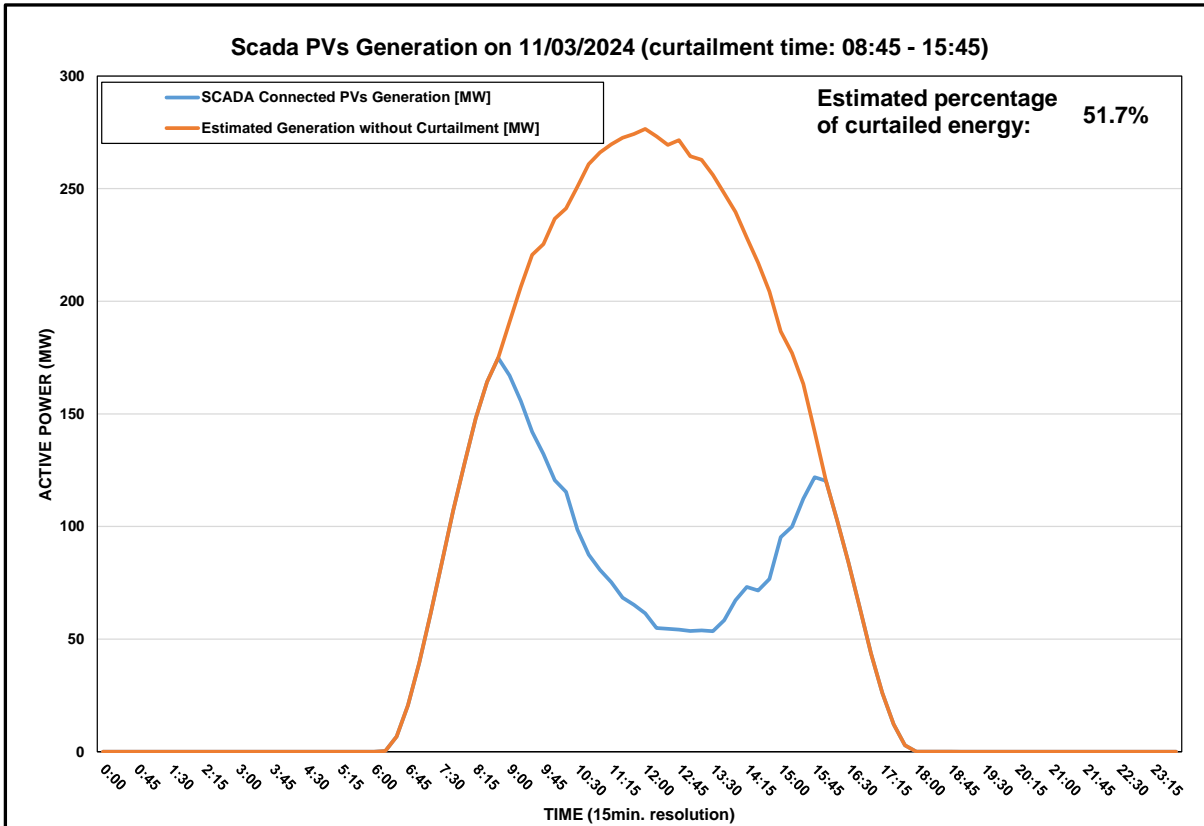


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	12/03/2024
Start of Curtailment	8:45
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2002.2 MWh
Total Estimated Curtailed Energy:	1040.8 MWh
Percentage of Curtailed Energy	52.0%

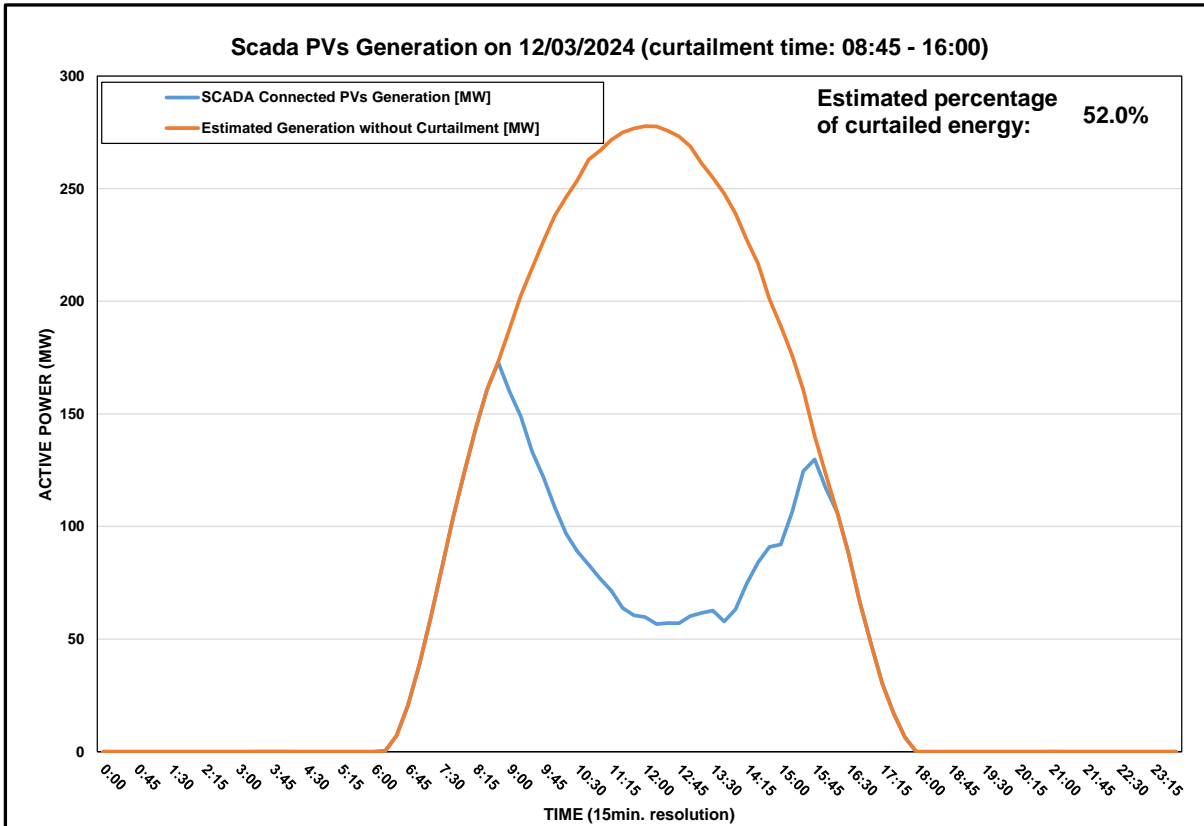


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	13/03/2024
Start of Curtailment	9:30
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1676.7 MWh
Total Estimated Curtailed Energy:	671.3 MWh
Percentage of Curtailed Energy	40.0%

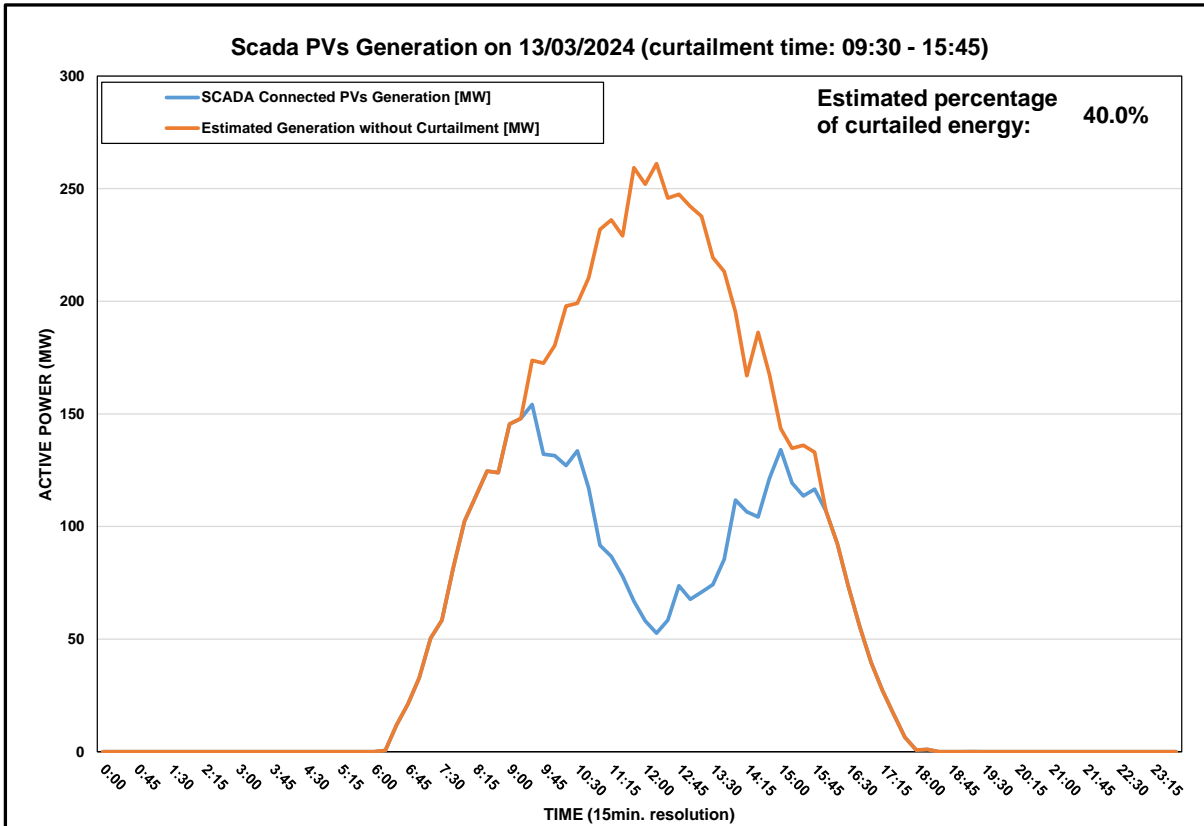


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	14/03/2024
Start of Curtailment	8:30
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1748.3 MWh
Total Estimated Curtailed Energy:	866.2 MWh
Percentage of Curtailed Energy	49.5%

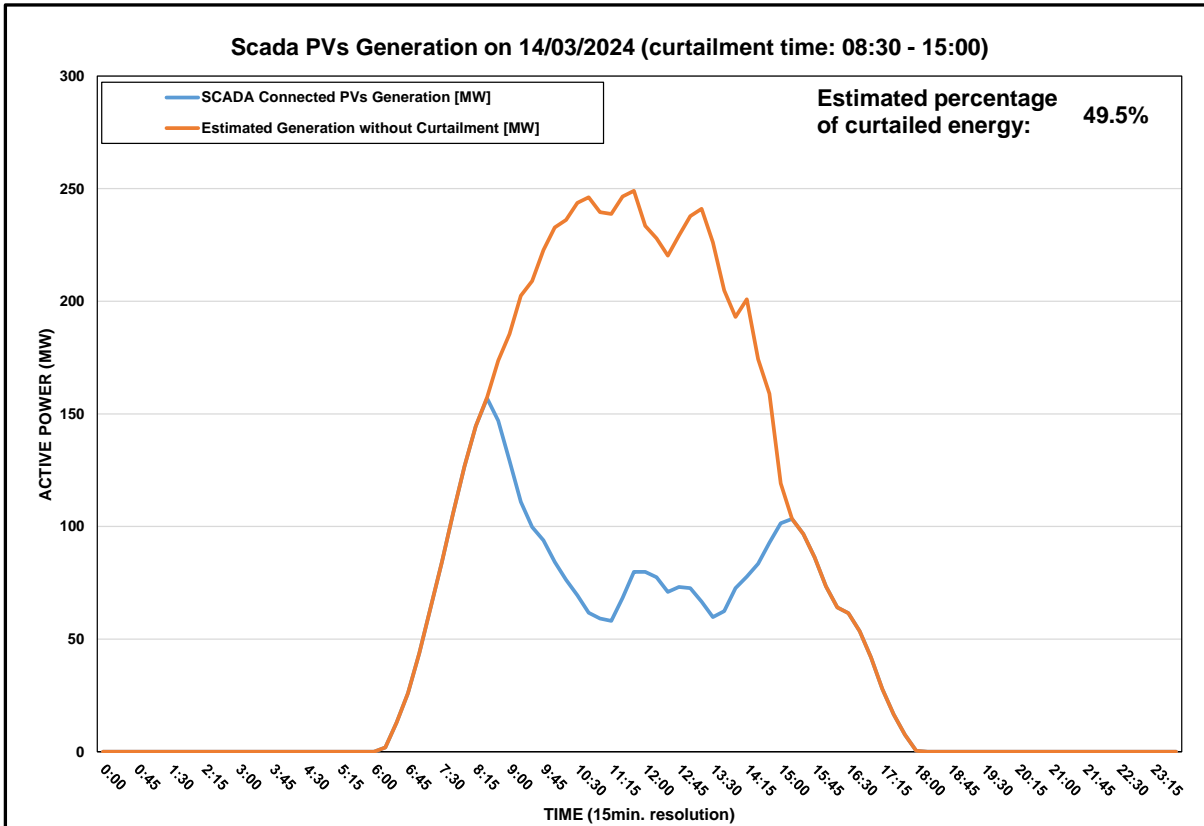


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	15/03/2024
Start of Curtailment	9:00
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1467.4 MWh
Total Estimated Curtailed Energy:	344.9 MWh
Percentage of Curtailed Energy	23.5%

Scada PVs Generation on 15/03/2024 (curtailment time: 09:00 - 15:15)

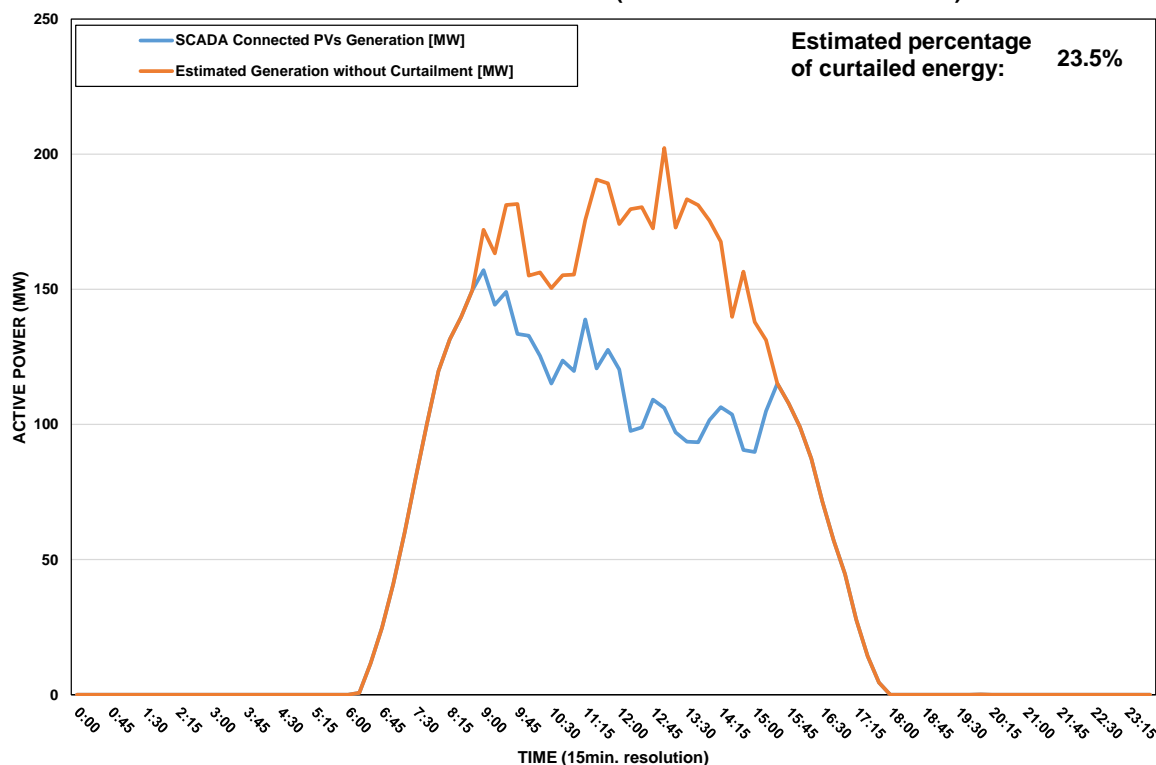


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	16/03/2024
Start of Curtailment	8:30
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1539.8 MWh
Total Estimated Curtailed Energy:	673.9 MWh
Percentage of Curtailed Energy	43.8%

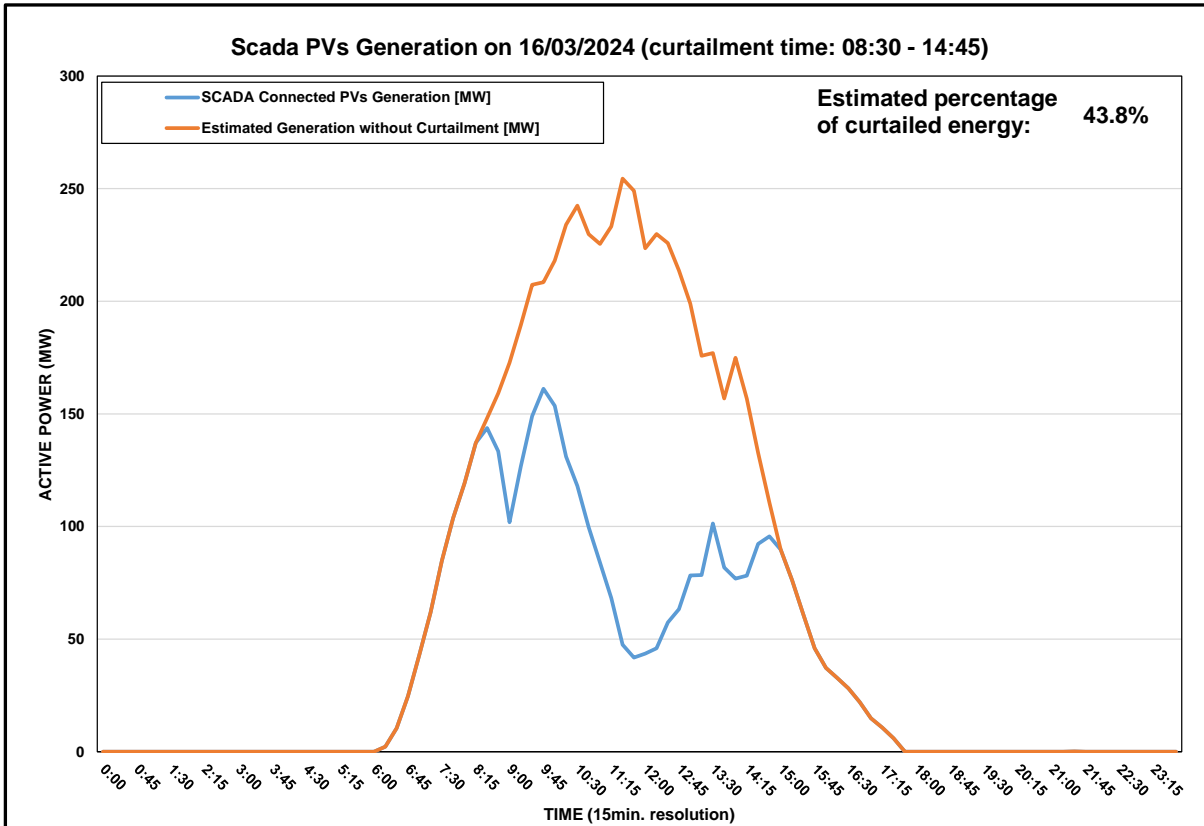


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	17/03/2024
Start of Curtailment	7:30
End of Curtailment	12:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1136.4 MWh
Total Estimated Curtailed Energy:	591 MWh
Percentage of Curtailed Energy	52.0%

Scada PVs Generation on 17/03/2024 (curtailment time: 07:30 - 12:00)

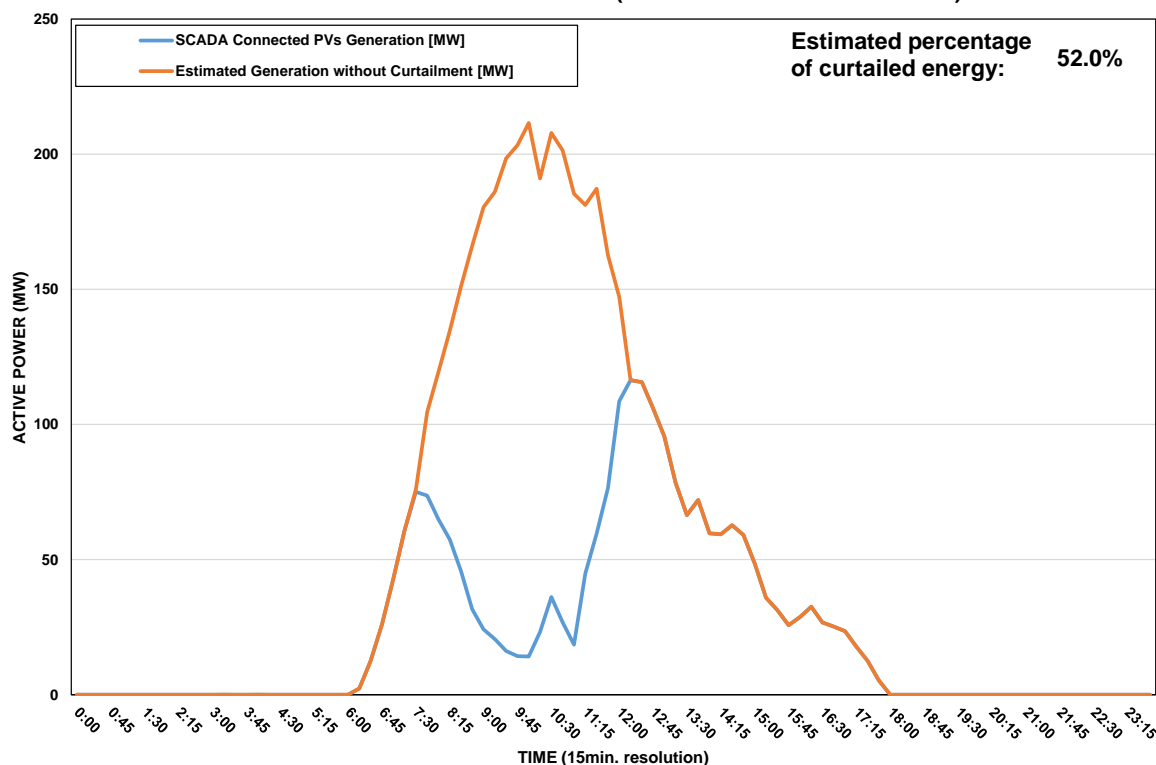


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	18/03/2024
Start of Curtailment	10:00
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1059 MWh
Total Estimated Curtailed Energy:	380.5 MWh
Percentage of Curtailed Energy	35.9%

Scada PVs Generation on 18/03/2024 (curtailment time: 10:00 - 14:30)

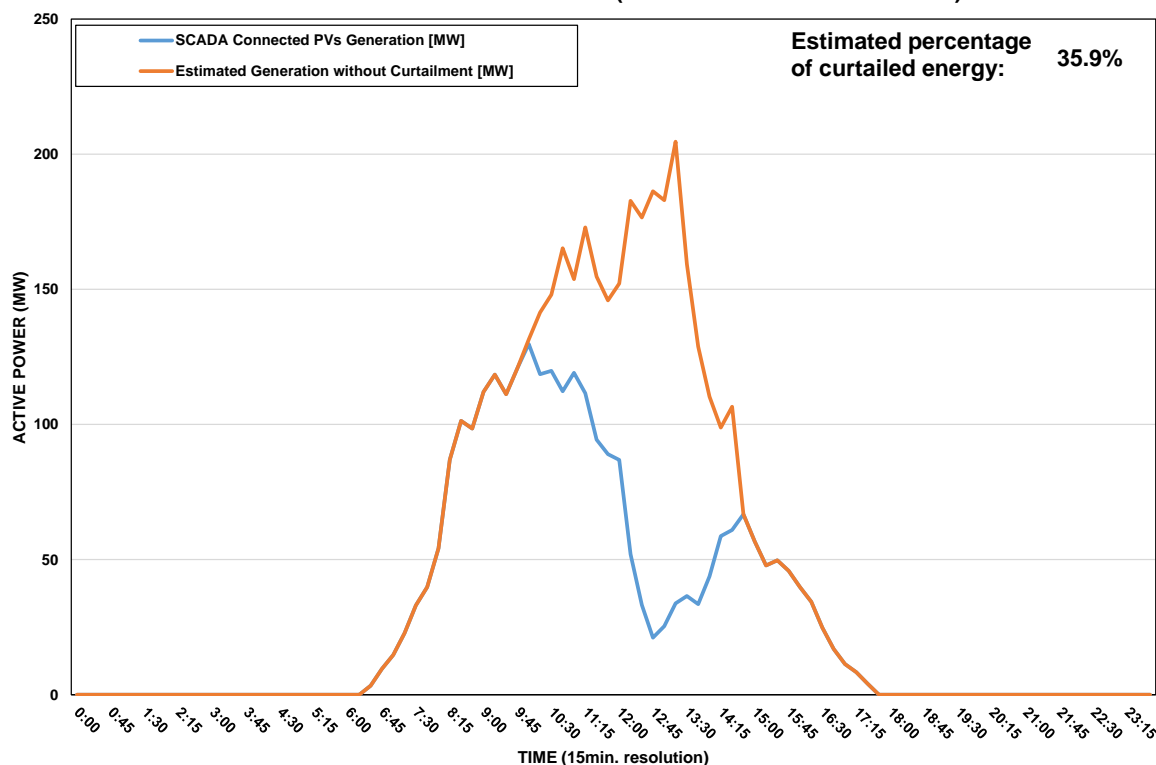


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	19/03/2024
Start of Curtailment	8:45
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1822.2 MWh
Total Estimated Curtailed Energy:	993.9 MWh
Percentage of Curtailed Energy	54.5%

Scada PVs Generation on 19/03/2024 (curtailment time: 08:45 - 16:00)

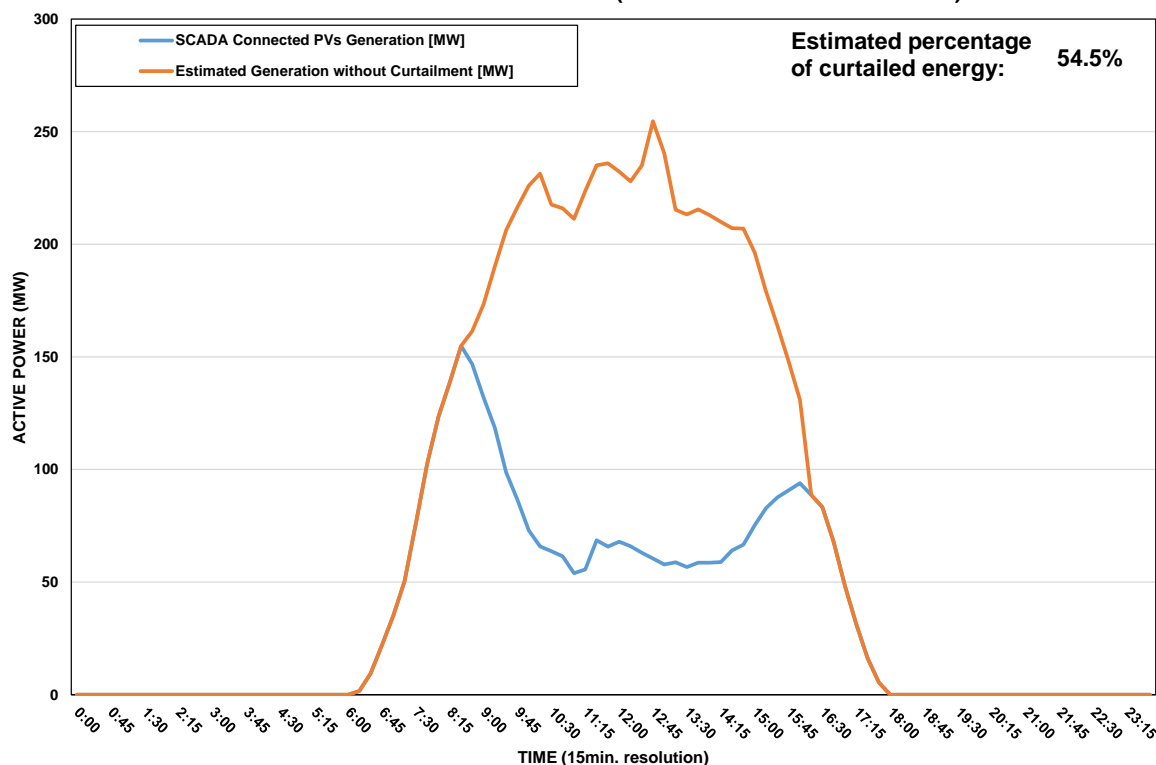


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	20/03/2024
Start of Curtailment	8:00
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1284.7 MWh
Total Estimated Curtailed Energy:	442.9 MWh
Percentage of Curtailed Energy	34.5%

Scada PVs Generation on 20/03/2024 (curtailment time: 08:00 - 13:15)

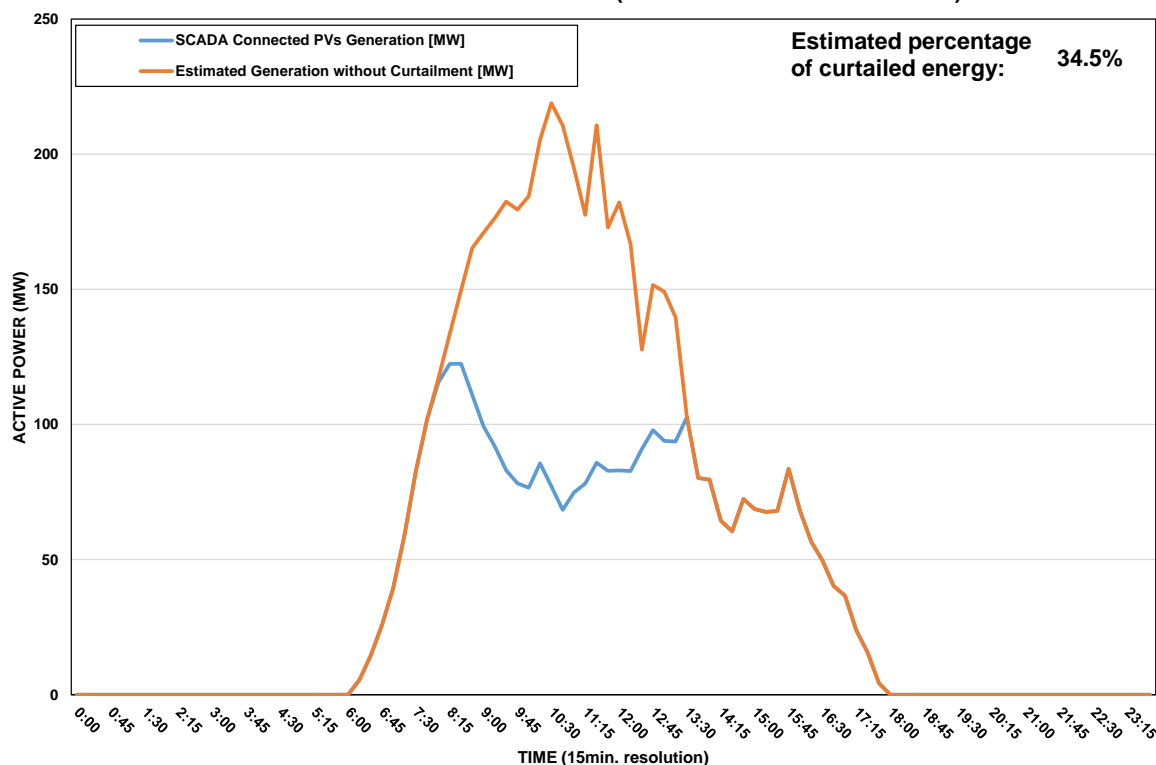


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	21/03/2024
Start of Curtailment	8:15
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1777.3 MWh
Total Estimated Curtailed Energy:	1034.7 MWh
Percentage of Curtailed Energy	58.2%

Scada PVs Generation on 21/03/2024 (curtailment time: 08:15 - 16:15)

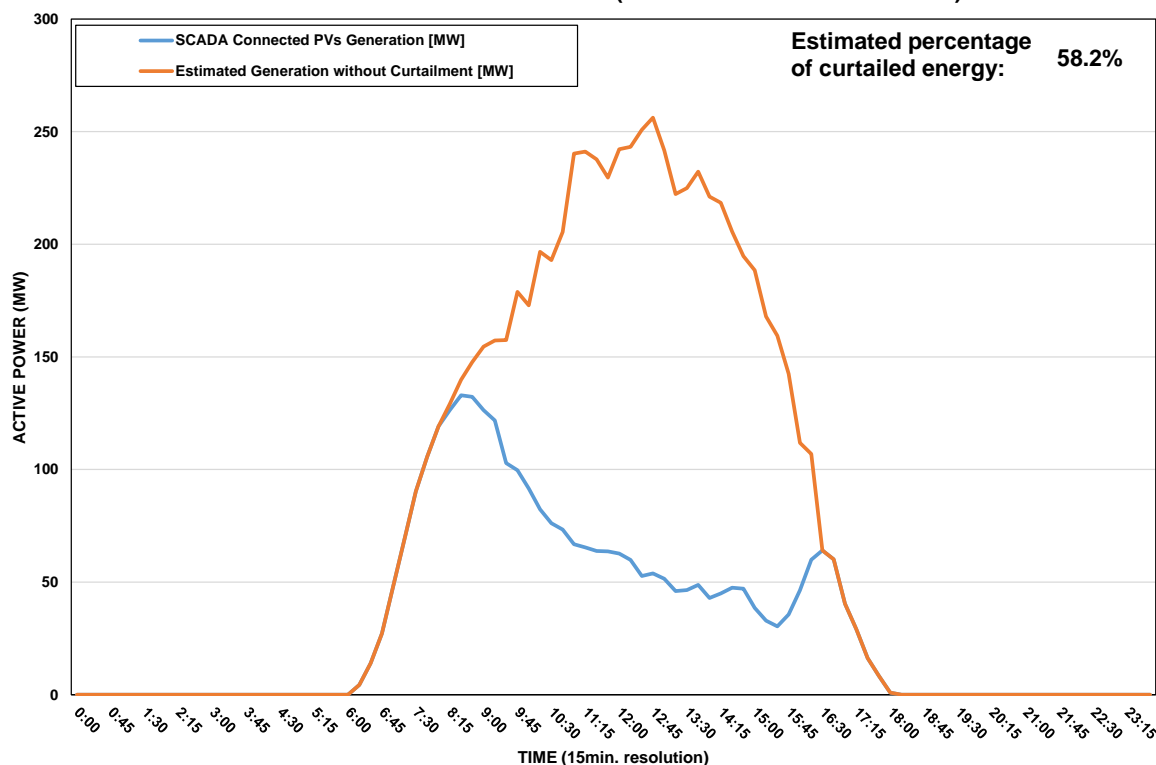


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	22/03/2024
Start of Curtailment	8:30
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1907.3 MWh
Total Estimated Curtailed Energy:	1142.4 MWh
Percentage of Curtailed Energy	59.9%

Scada PVs Generation on 22/03/2024 (curtailment time: 08:30 - 16:15)

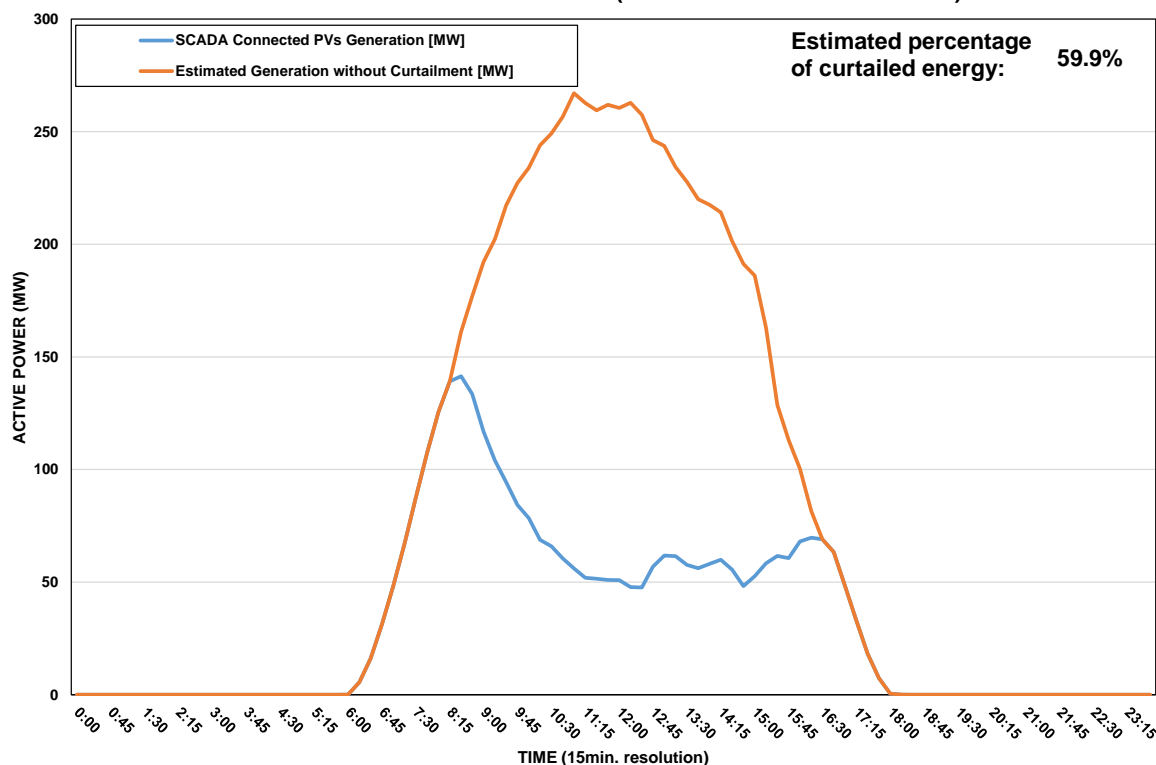


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	23/03/2024
Start of Curtailment	8:30
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1762.8 MWh
Total Estimated Curtailed Energy:	817.4 MWh
Percentage of Curtailed Energy	46.4%

Scada PVs Generation on 23/03/2024 (curtailment time: 08:30 - 15:00)

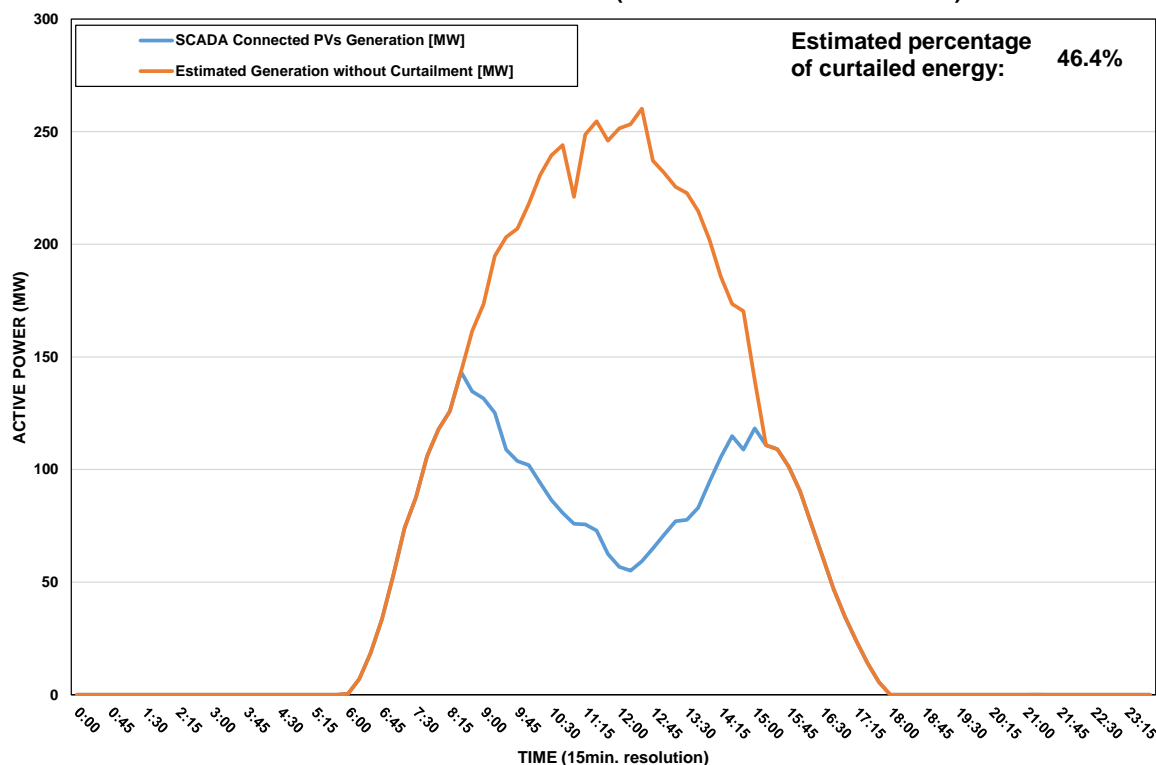


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	24/03/2024
Start of Curtailment	8:00
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1765.2 MWh
Total Estimated Curtailed Energy:	1261.2 MWh
Percentage of Curtailed Energy	71.5%

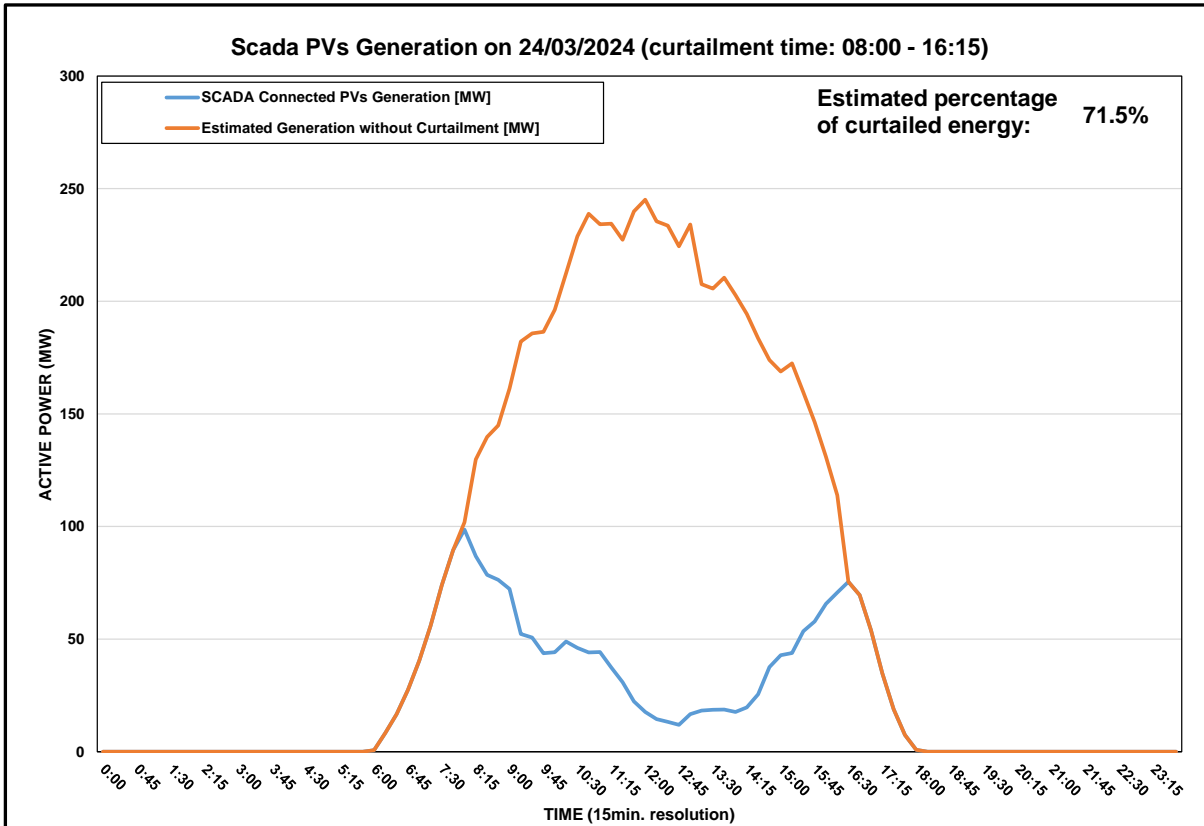


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	25/03/2024	Activation of PV System cut-off from 7.14kW \leq P < 500kW: Cut off PV System Group:	NIC 2
Start of Curtailment	7:30	Start of cut-off:	10:45
End of Curtailment	16:00	End of cut-off:	14:15
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1913.3 MWh	Total Estimated cut-off energy regarding PV Systems from 7.14kW \leq P < 500kW:	51.6 MWh
Total Estimated Curtailed Energy:	1526.1 MWh		
Percentage of Curtailed Energy	79.8%		

Scada PVs Generation on 25/03/2024 (curtailment time: 07:30 - 16:00)

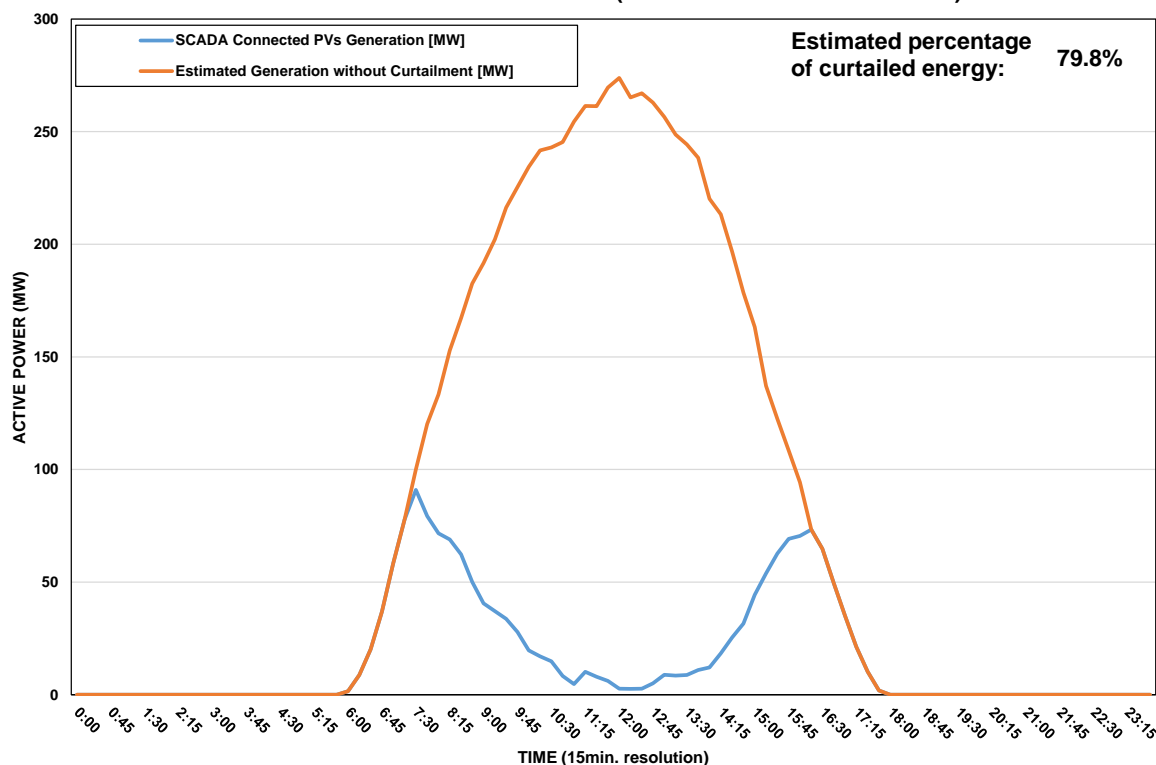


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	26/03/2024
Start of Curtailment	8:45
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	<i>RES-E Generation Restriction due to low loading of the electrical system</i>
Total Estimated Energy of the day:	1661.1 MWh
Total Estimated Curtailed Energy:	880.9 MWh
Percentage of Curtailed Energy	53.0%

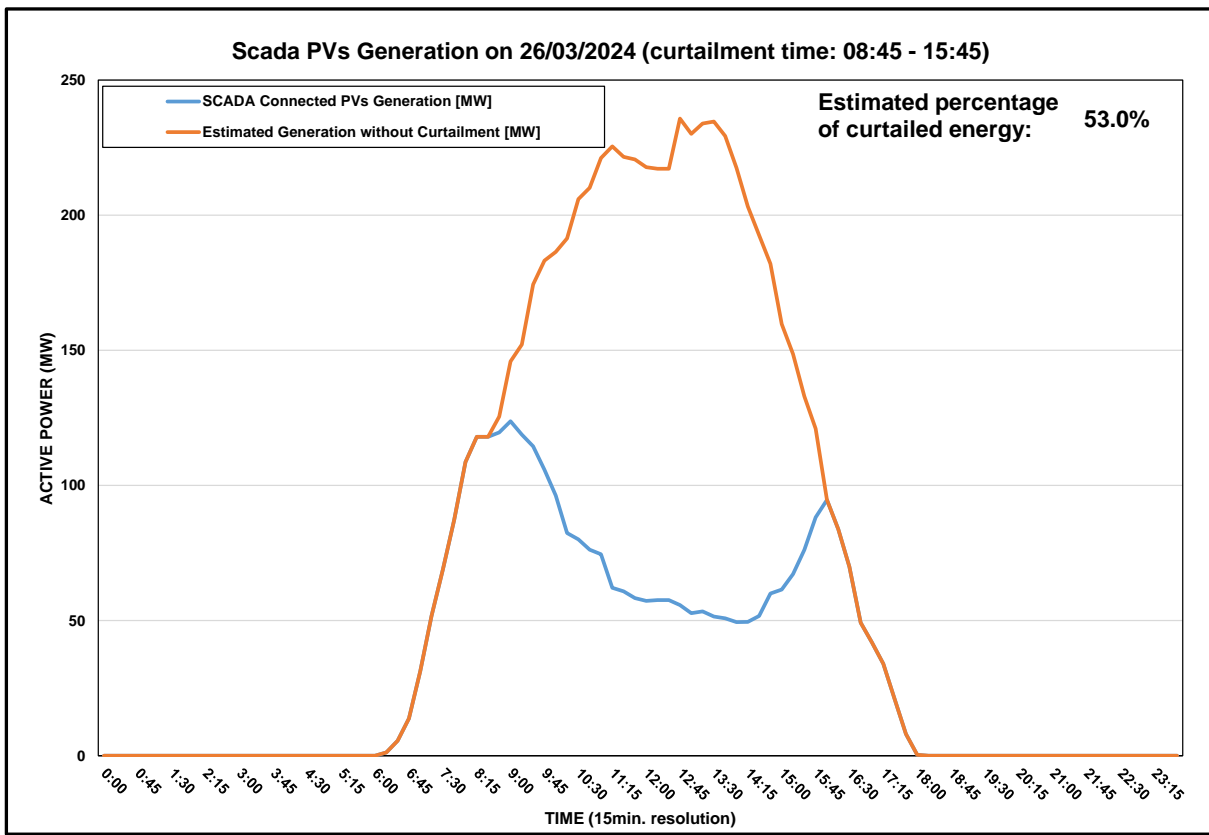


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	27/03/2024
Start of Curtailment	11:30
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1334.7 MWh
Total Estimated Curtailed Energy:	648.3 MWh
Percentage of Curtailed Energy	48.6%

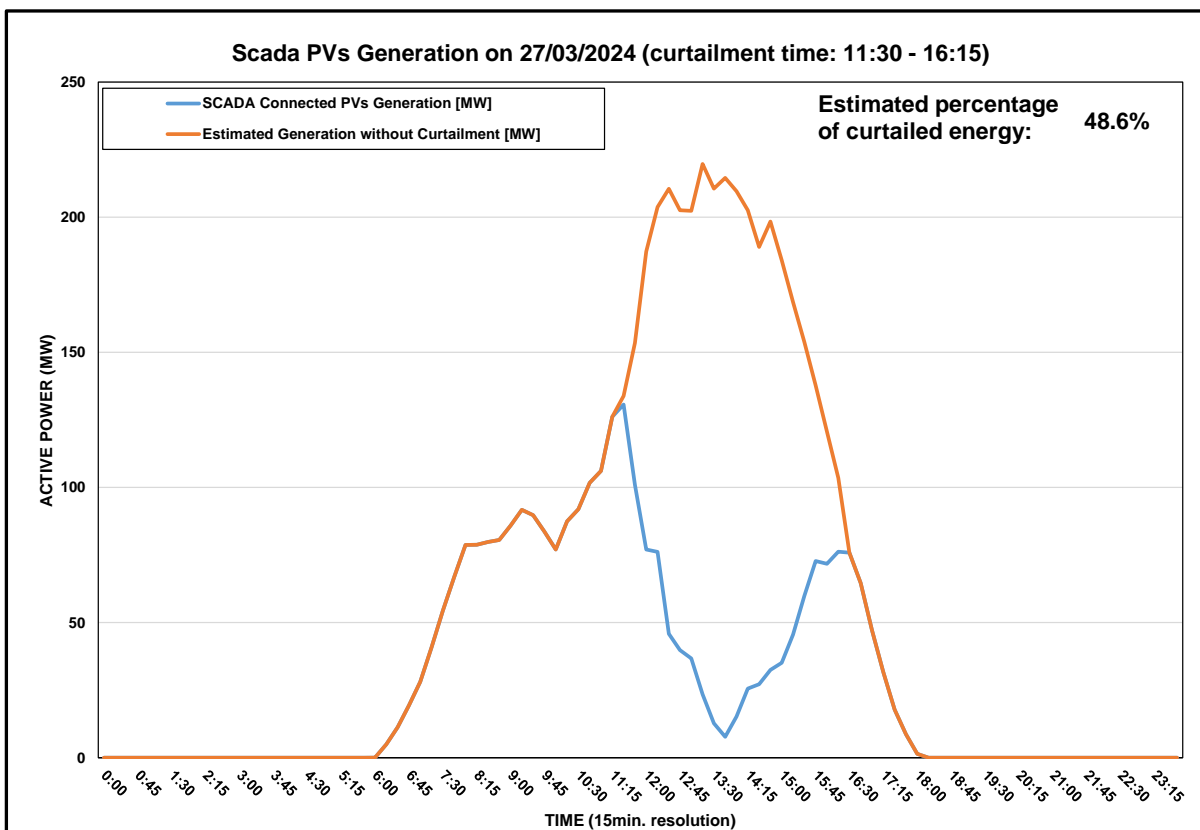


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	28/03/2024
Start of Curtailment	8:15
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1860 MWh
Total Estimated Curtailed Energy:	1053.7 MWh
Percentage of Curtailed Energy	56.7%

Scada PVs Generation on 28/03/2024 (curtailment time: 08:15 - 15:45)

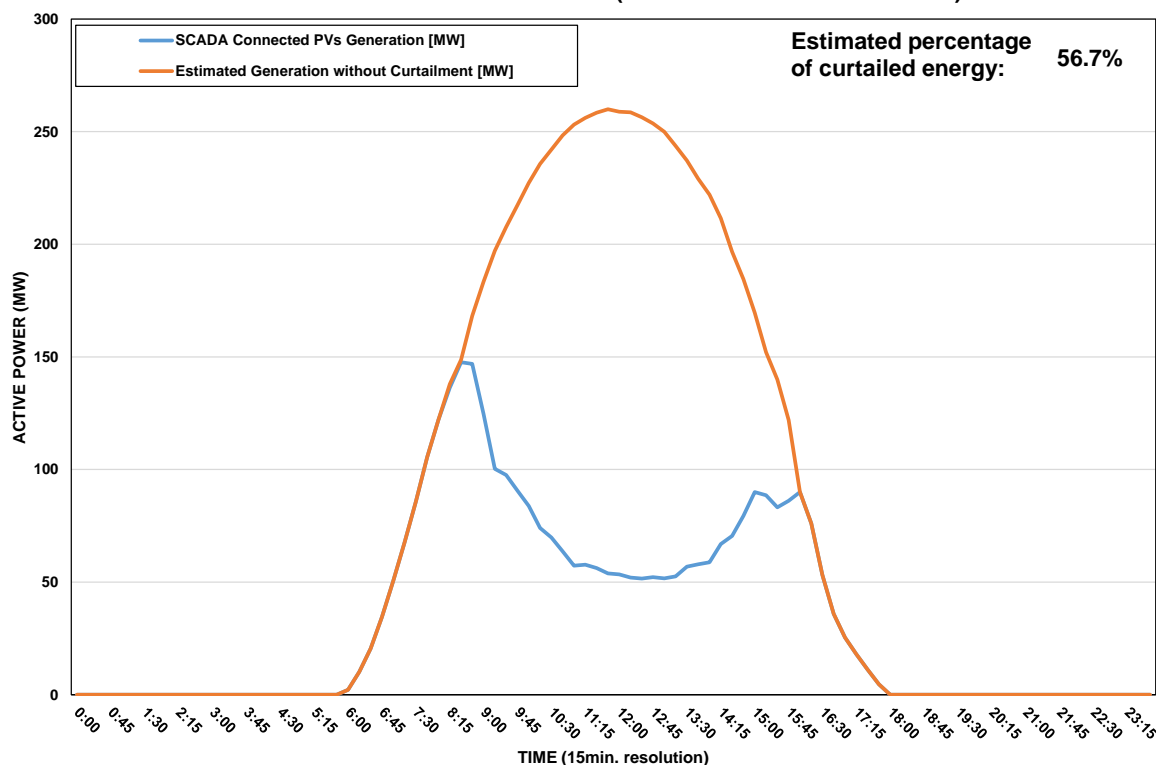


**DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION**



Daily Curtailment Report of PV Generation

Date of Curtailment	29/03/2024
Start of Curtailment	09:30
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1716.3 MWh
Total Estimated Curtailed Energy:	823.1 MWh
Percentage of Curtailed Energy	48.0%

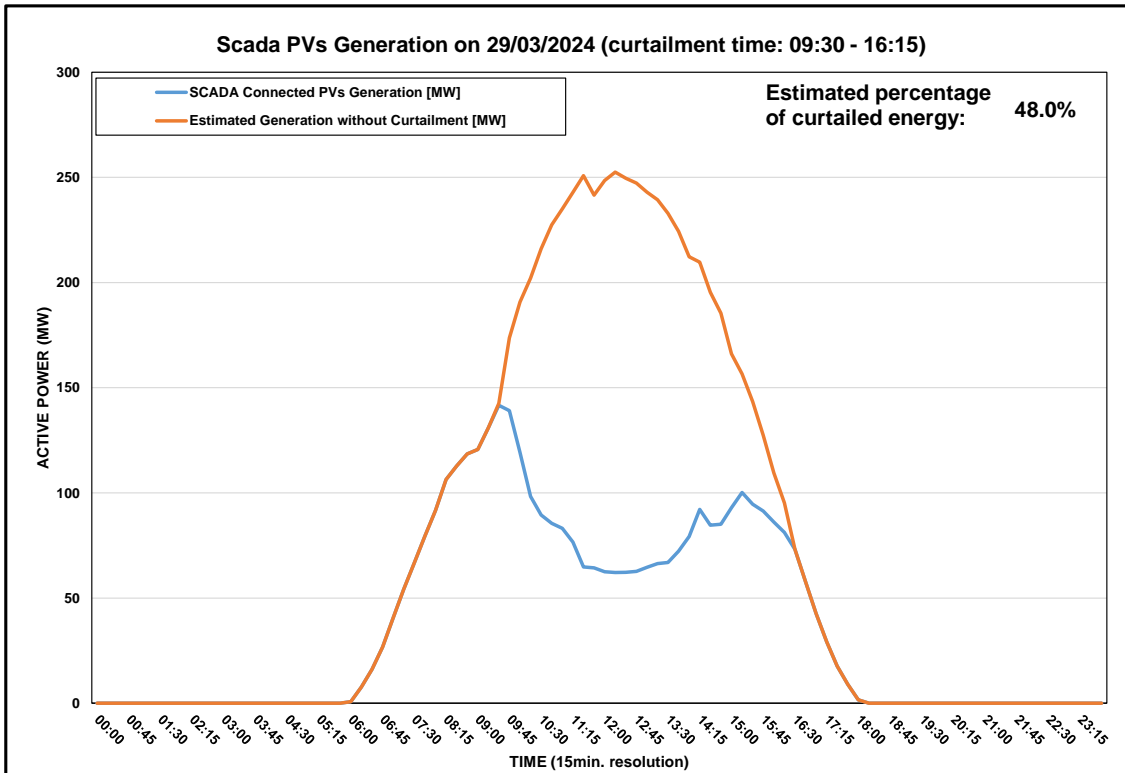


**DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION**



Daily Curtailment Report of PV Generation

Date of Curtailment	30/03/2024
Start of Curtailment	07:30
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1927.8 MWh
Total Estimated Curtailed Energy:	1278 MWh
Percentage of Curtailed Energy	66.3%

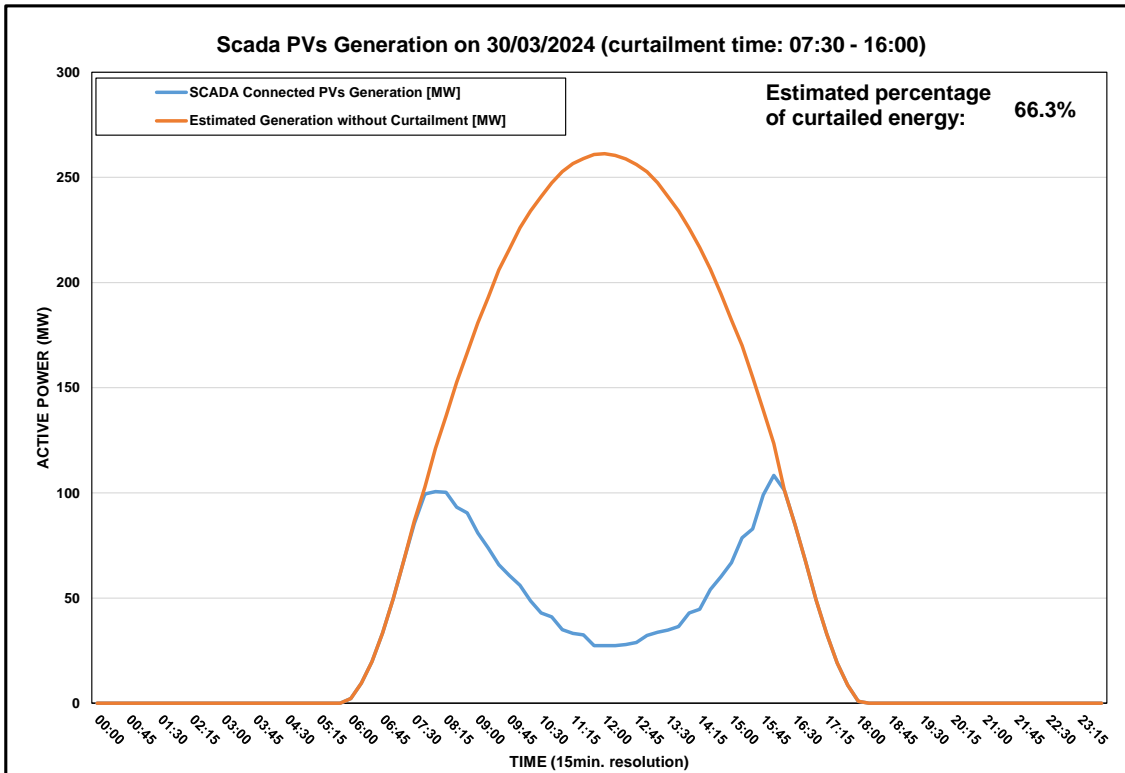

**DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION**



Daily Curtailment Report of PV Generation

Date of Curtailment	31/03/2024	Activation of PV System cut-off from 7.14kW <= P < 500kW: Cut off PV System Group: NIC 2, LIM 1, FAM-LAR 1	
Start of Curtailment	08:30	Start of cut-off:	10:45
End of Curtailment	17:15	End of cut-off:	16:00
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1967.2 MWh	Total Estimated cut-off energy regarding PV Systems from 7.14kW <= P < 500kW:	185.6 MWh
Total Estimated Curtailed Energy:	1534.7 MWh		
Percentage of Curtailed Energy	78.0%		

