


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	08/01/2022
Start of Curtailment	11:00
End of Curtailment	13:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	467 MWh
Total Estimated Curtailed Energy:	15.5 MWh
Percentage of Curtailed Energy	3.3%

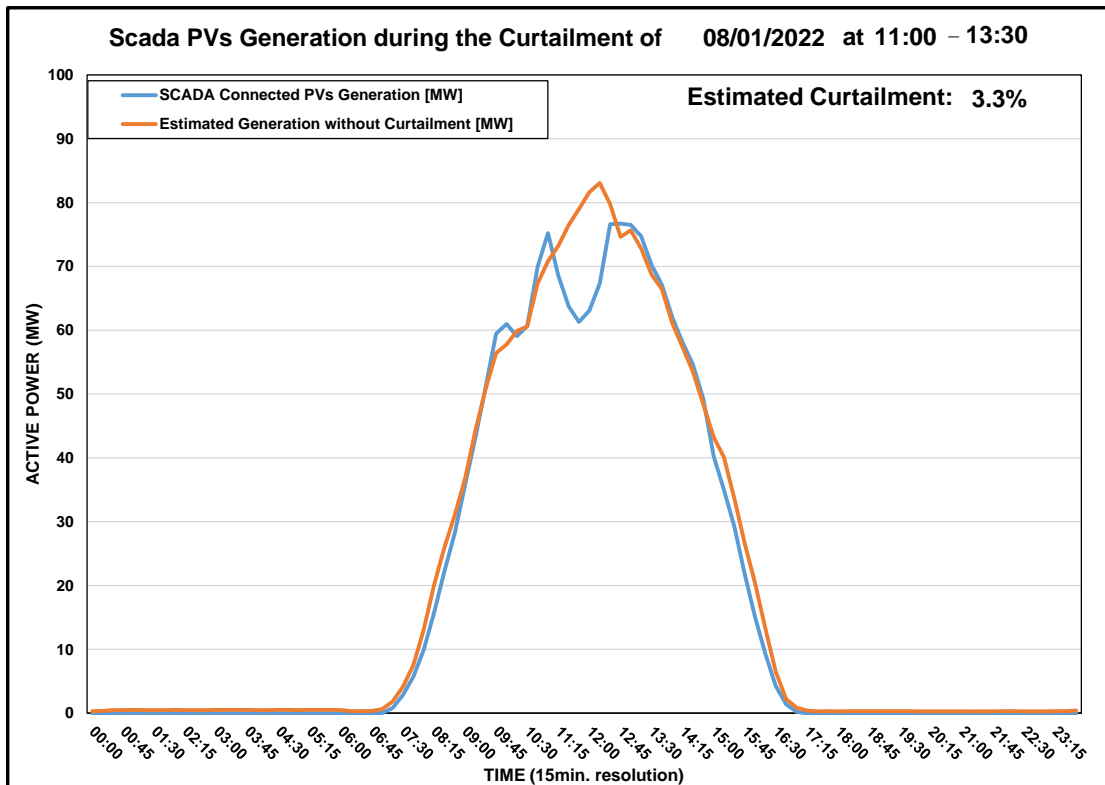


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	23/01/2022
Start of Curtailment	09:00
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	598.7 MWh
Total Estimated Curtailed Energy:	46.3 MWh
Percentage of Curtailed Energy	7.7%

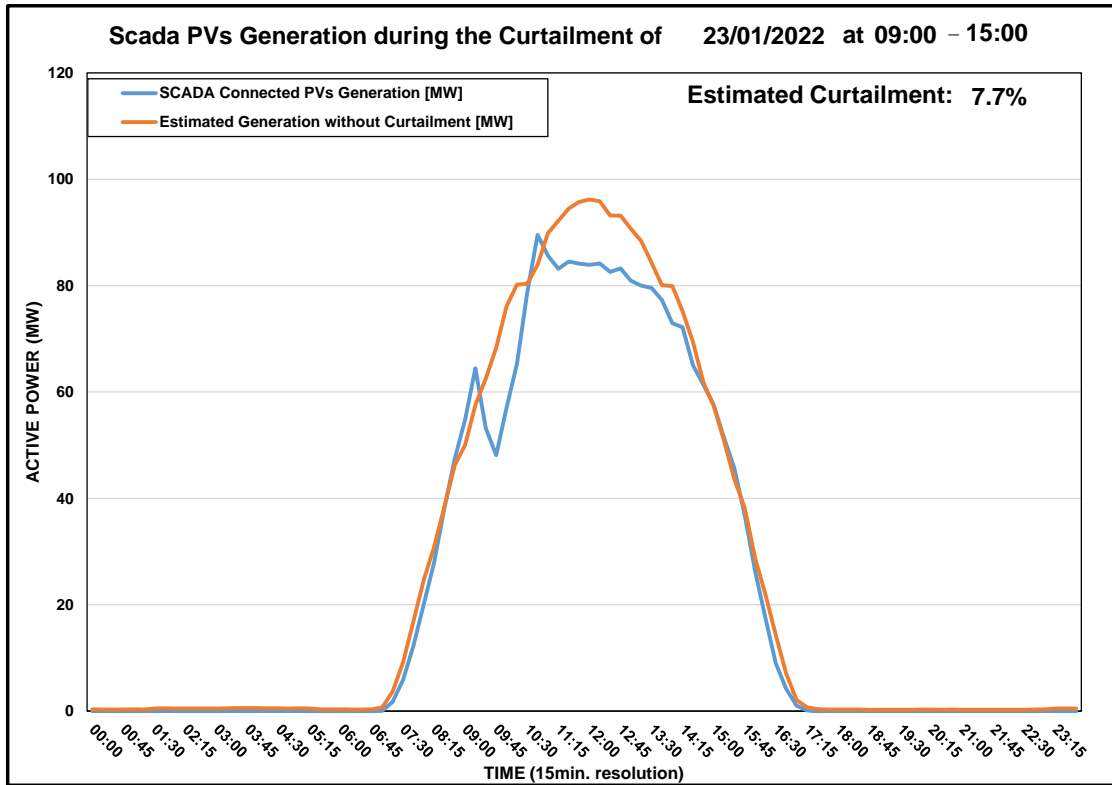


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	03/02/2022
Start of Curtailment	13:15
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	391.6 MWh
Total Estimated Curtailed Energy:	4 MWh
Percentage of Curtailed Energy	1.0%

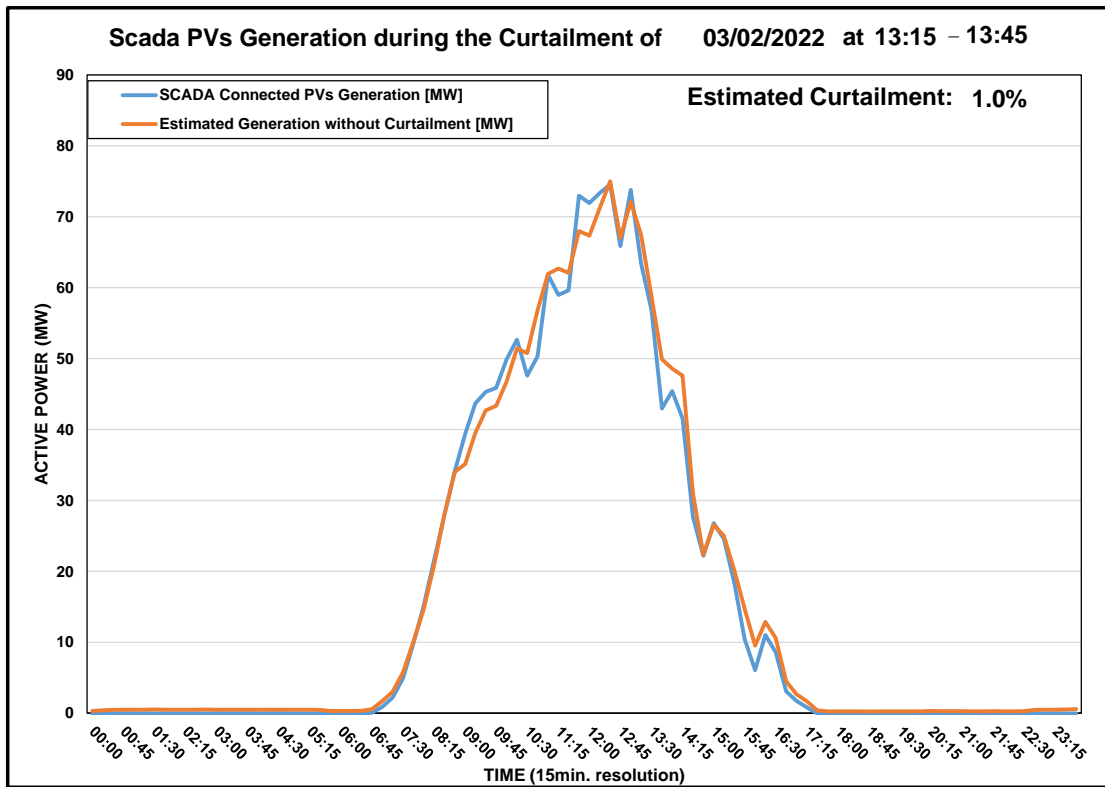


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	05/02/2022
Start of Curtailment	14:45
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	690.1 MWh
Total Estimated Curtailed Energy:	2.9 MWh
Percentage of Curtailed Energy	0.4%

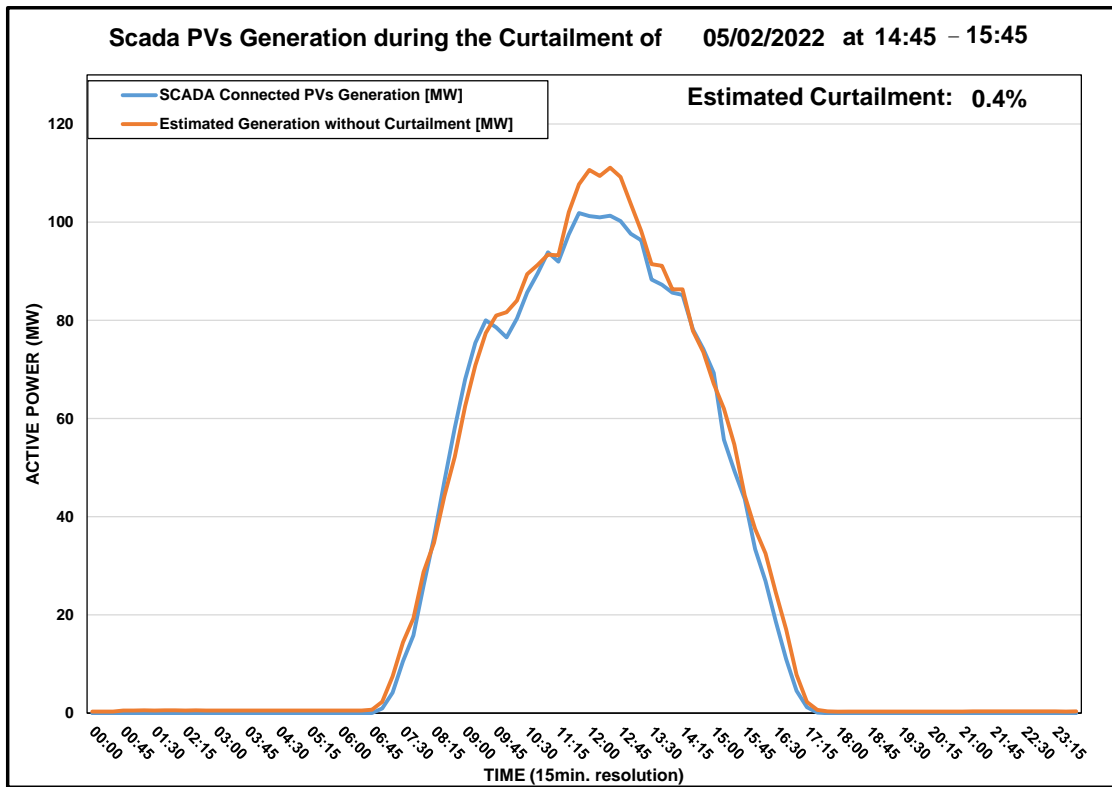


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	20/02/2022
Start of Curtailment	10:15
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	749.5 MWh
Total Estimated Curtailed Energy:	129 MWh
Percentage of Curtailed Energy	17.2%

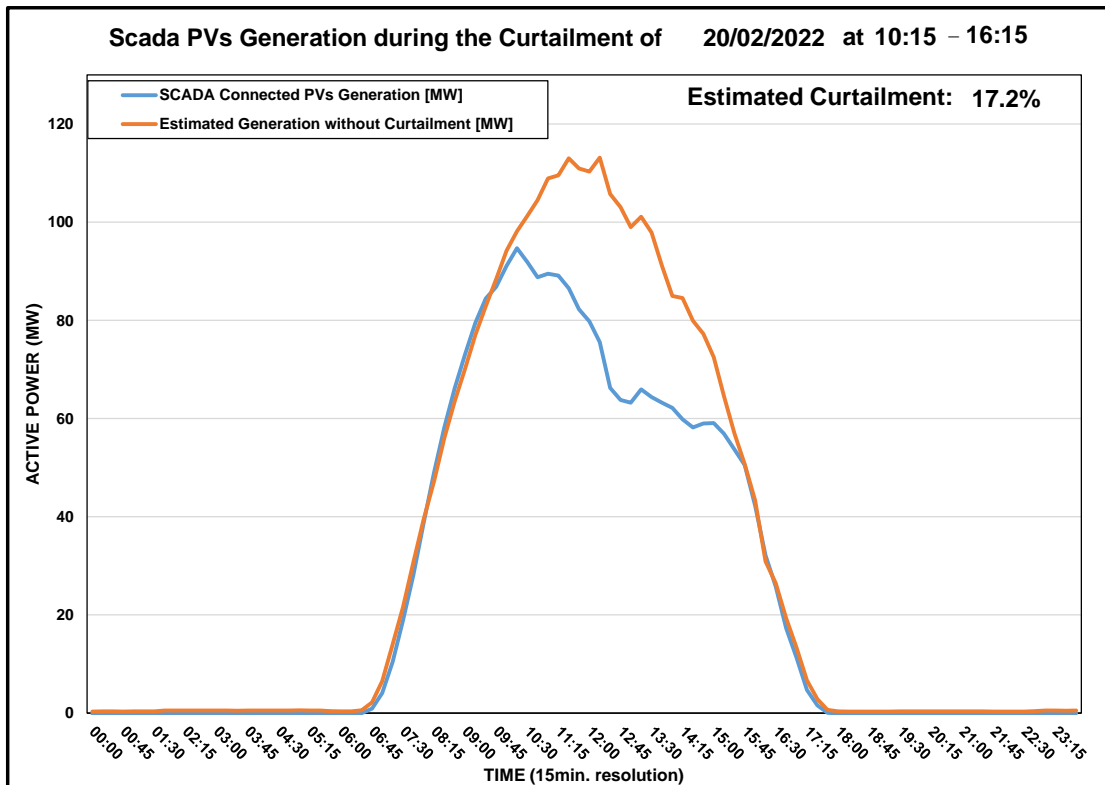


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	21/02/2022
Start of Curtailment	11:45
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	519.2 MWh
Total Estimated Curtailed Energy:	37 MWh
Percentage of Curtailed Energy	7.1%

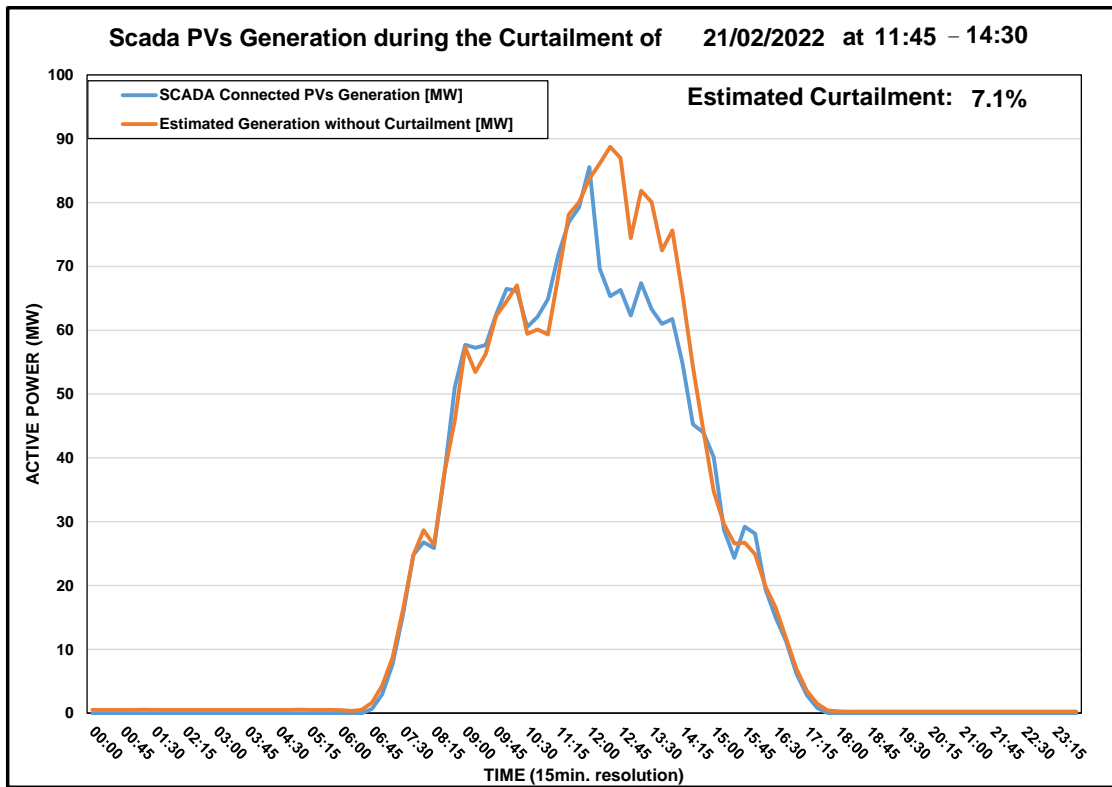


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	22/02/2022
Start of Curtailment	12:30
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	467.9 MWh
Total Estimated Curtailed Energy:	67.7 MWh
Percentage of Curtailed Energy	14.5%

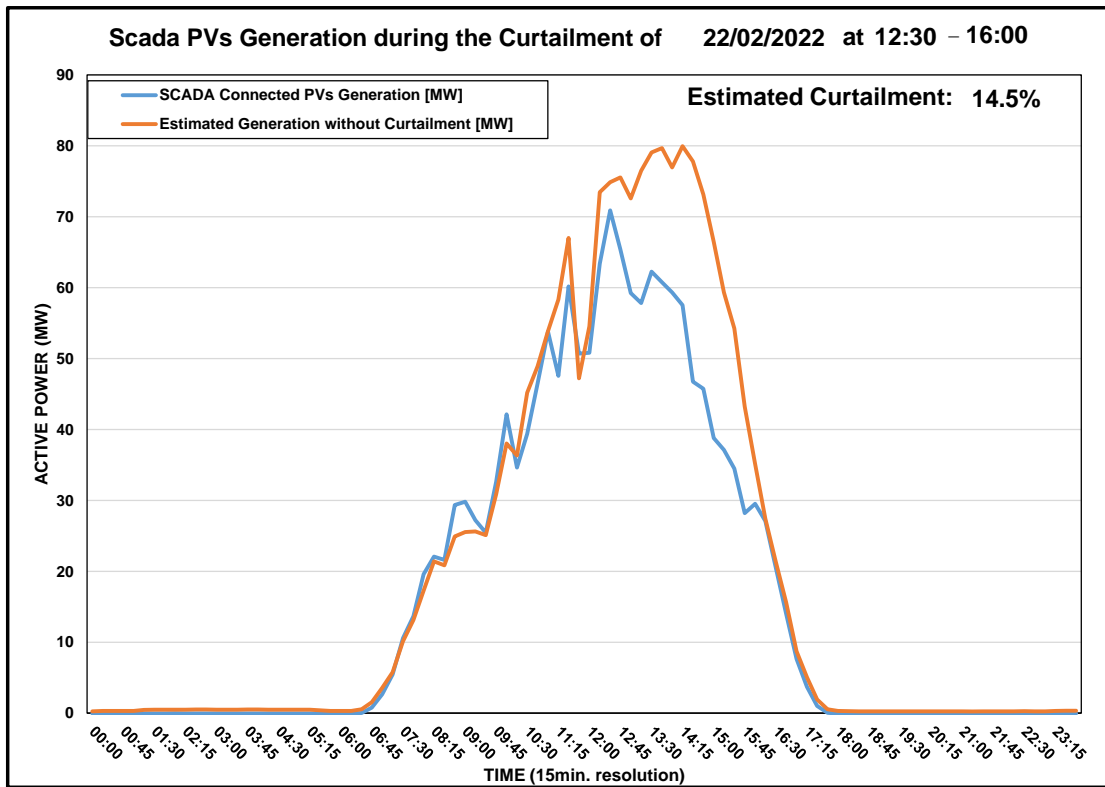


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	23/02/2022
Start of Curtailment	09:30
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	621.8 MWh
Total Estimated Curtailed Energy:	220.1 MWh
Percentage of Curtailed Energy	35.4%

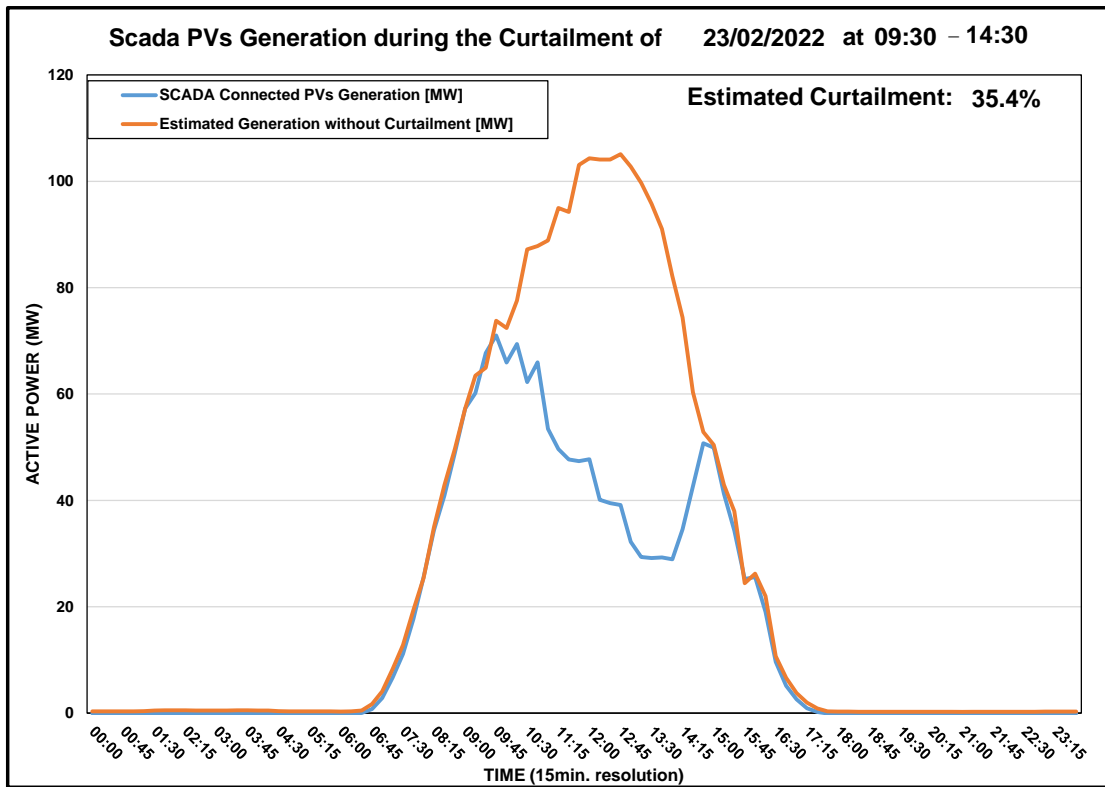


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	24/02/2022
Start of Curtailment	15:15
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	471 MWh
Total Estimated Curtailed Energy:	4.8 MWh
Percentage of Curtailed Energy	1.0%

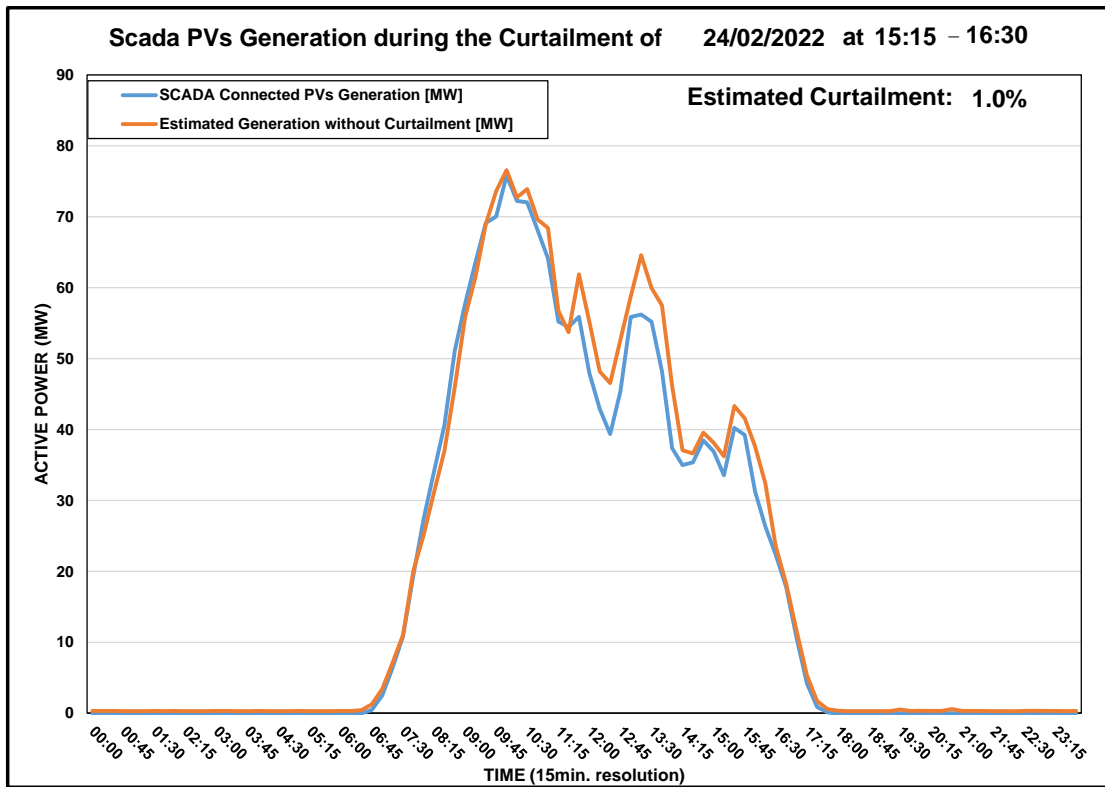


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	03/03/2022
Start of Curtailment	12:00
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	615.3 MWh
Total Estimated Curtailed Energy:	29.7 MWh
Percentage of Curtailed Energy	4.8%

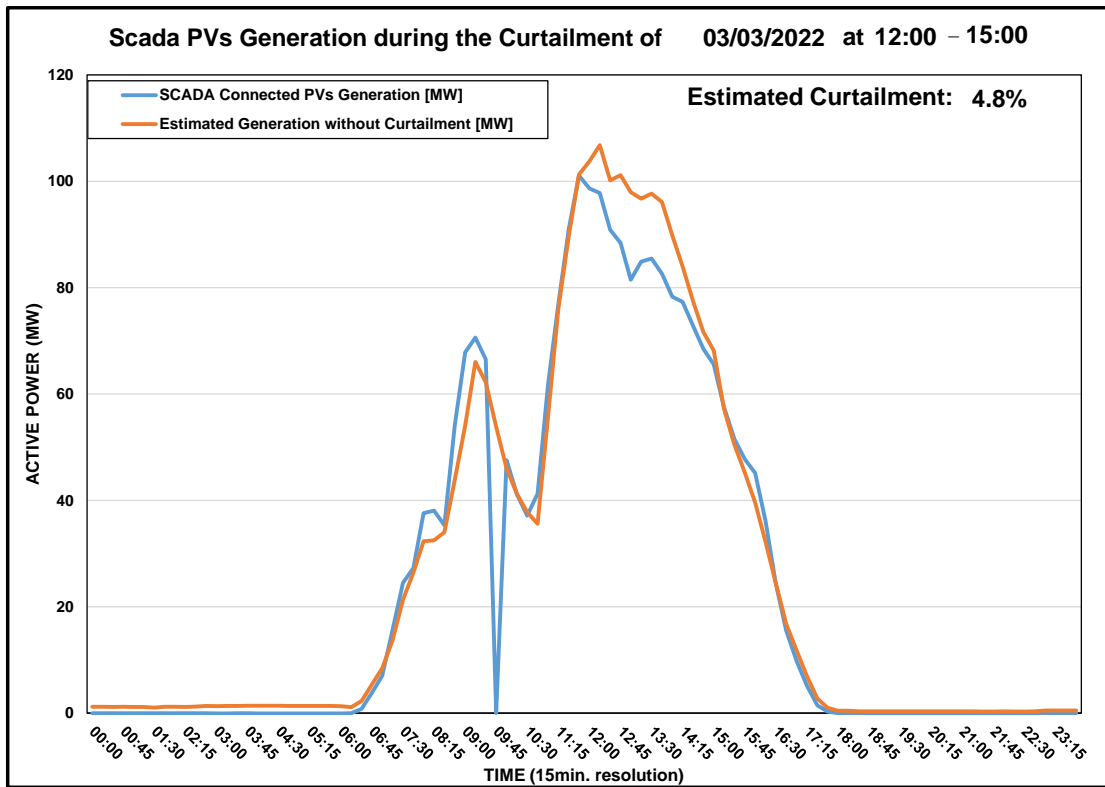


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	06/03/2022
Start of Curtailment	15:00
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	443.3 MWh
Total Estimated Curtailed Energy:	2.2 MWh
Percentage of Curtailed Energy	0.5%

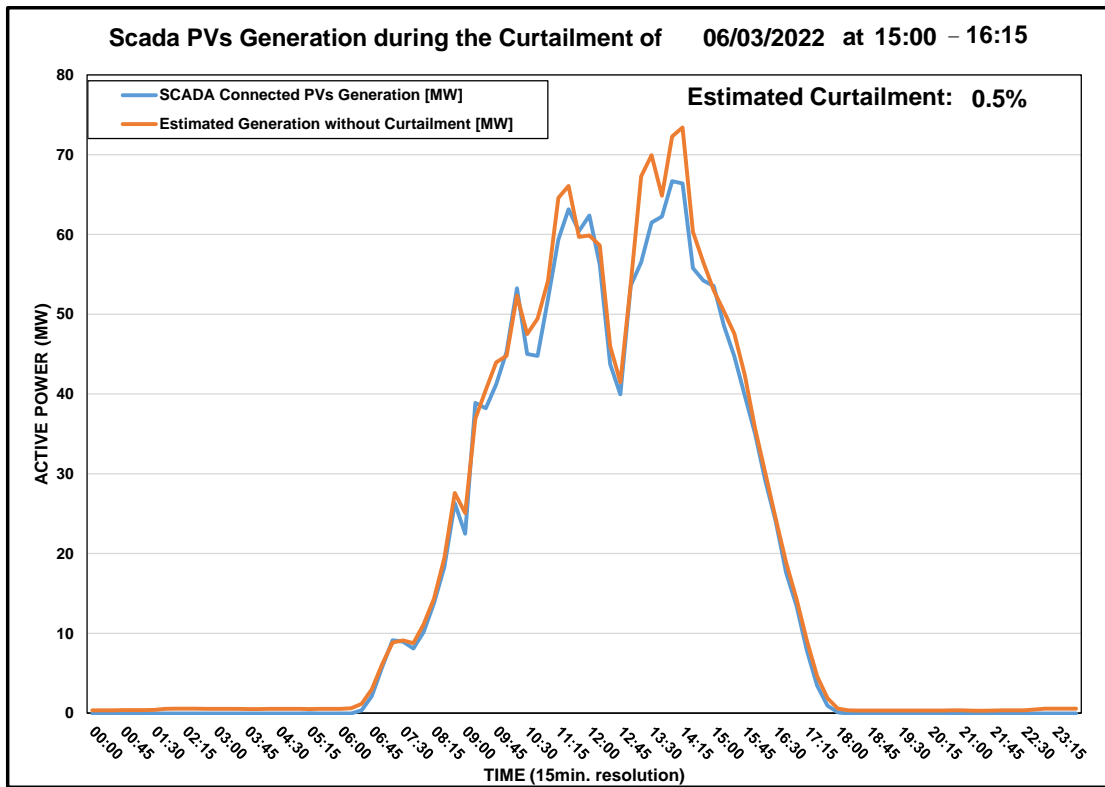


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	07/03/2022
Start of Curtailment	09:30
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	679.6 MWh
Total Estimated Curtailed Energy:	134 MWh
Percentage of Curtailed Energy	19.7%

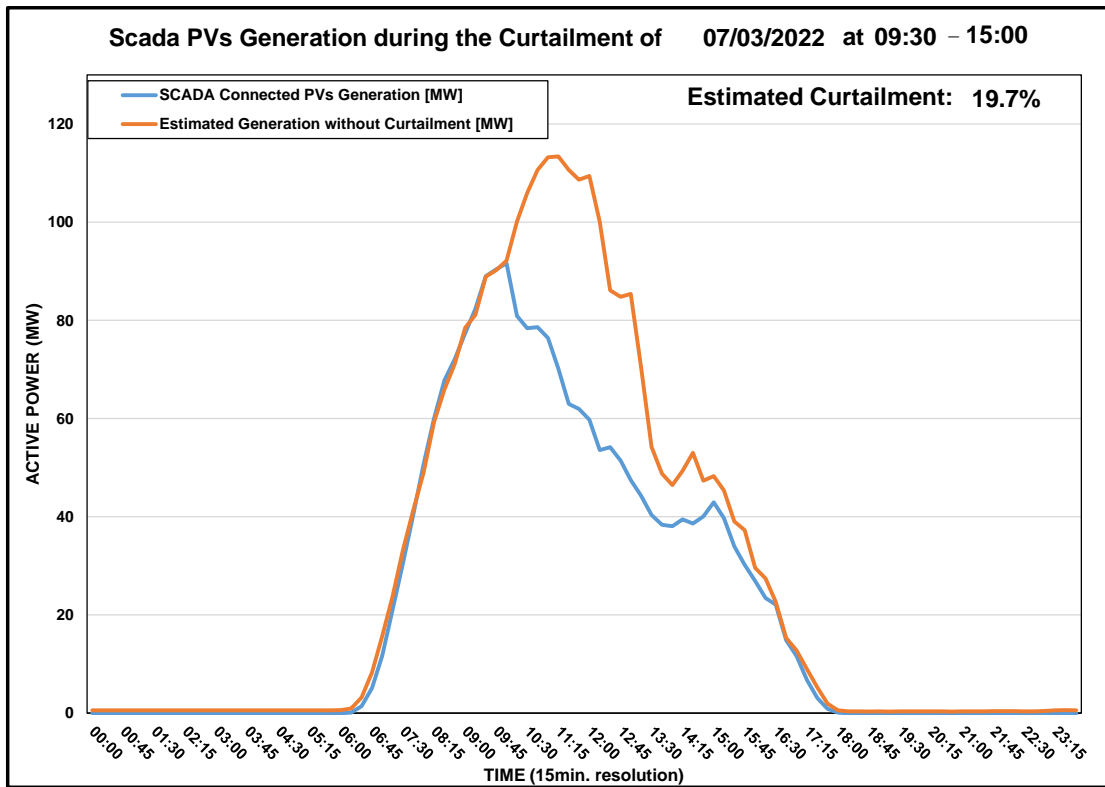


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	08/03/2022
Start of Curtailment	12:15
End of Curtailment	13:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	741.6 MWh
Total Estimated Curtailed Energy:	11.5 MWh
Percentage of Curtailed Energy	1.5%

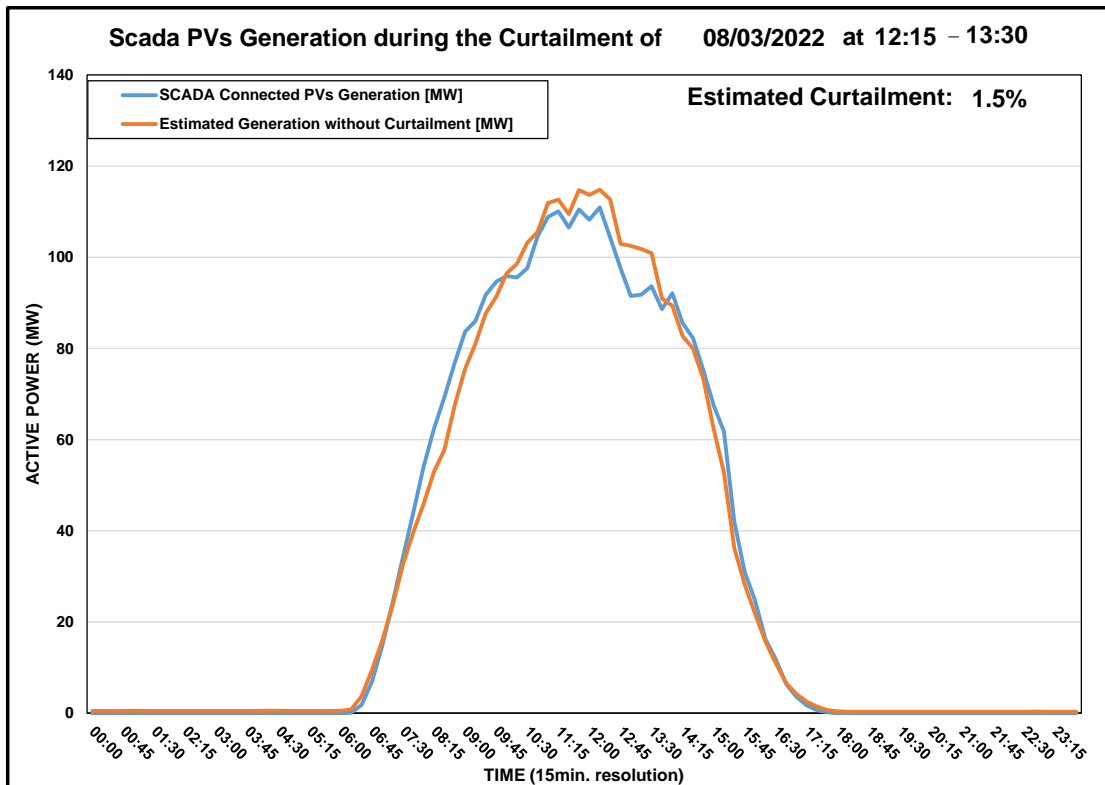


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	11/03/2022
Start of Curtailment	13:45
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	702.7 MWh
Total Estimated Curtailed Energy:	10 MWh
Percentage of Curtailed Energy	1.4%

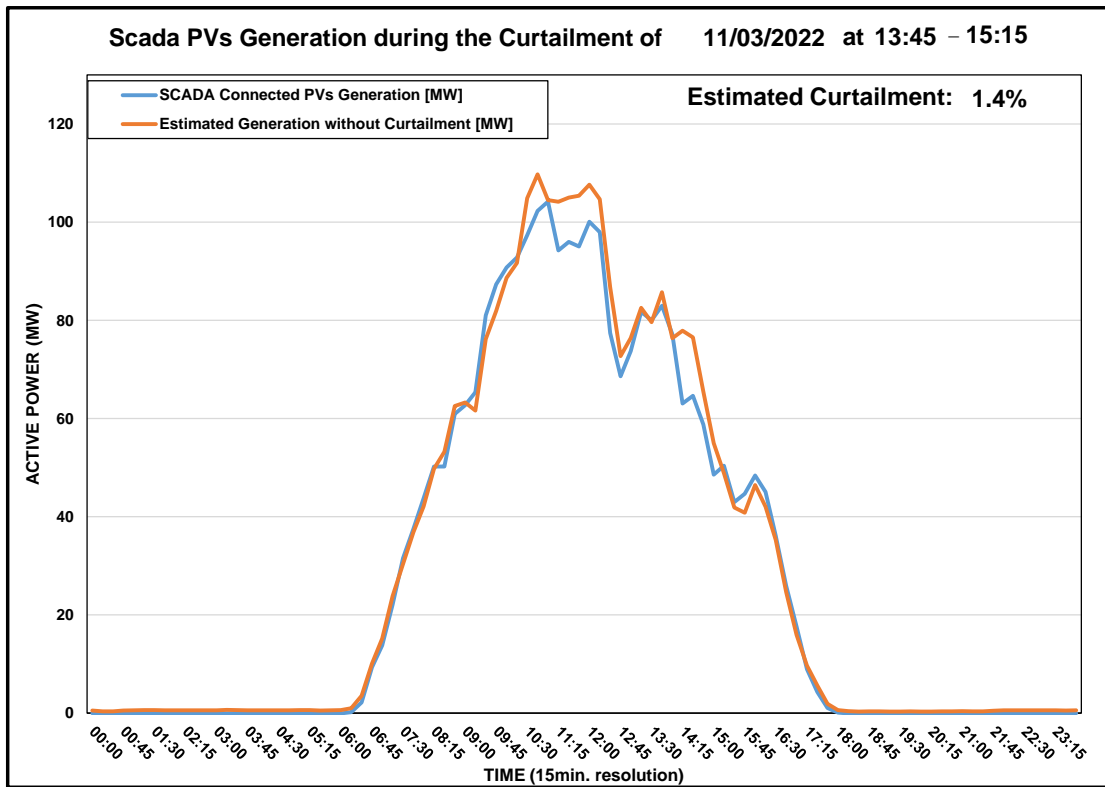


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	13/03/2022
Start of Curtailment	14:45
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	489.2 MWh
Total Estimated Curtailed Energy:	9.8 MWh
Percentage of Curtailed Energy	2.0%

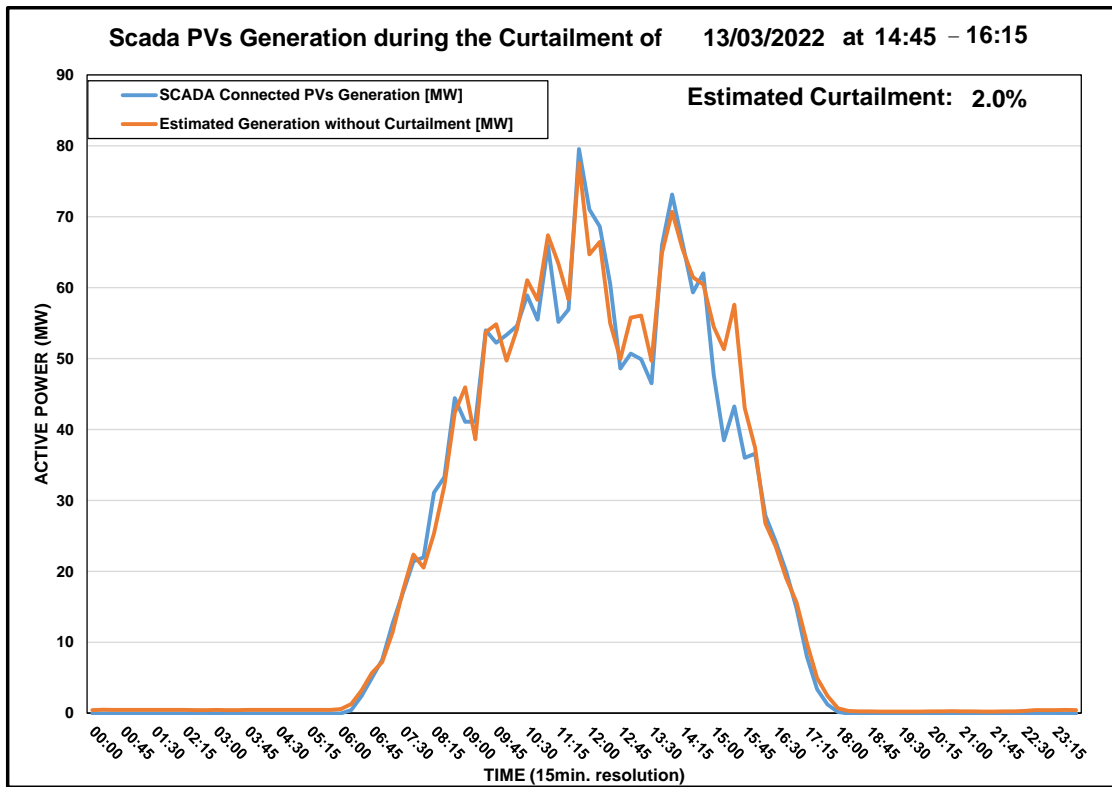


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	20/03/2022
Start of Curtailment	07:45
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	874.9 MWh
Total Estimated Curtailed Energy:	261.6 MWh
Percentage of Curtailed Energy	29.9%

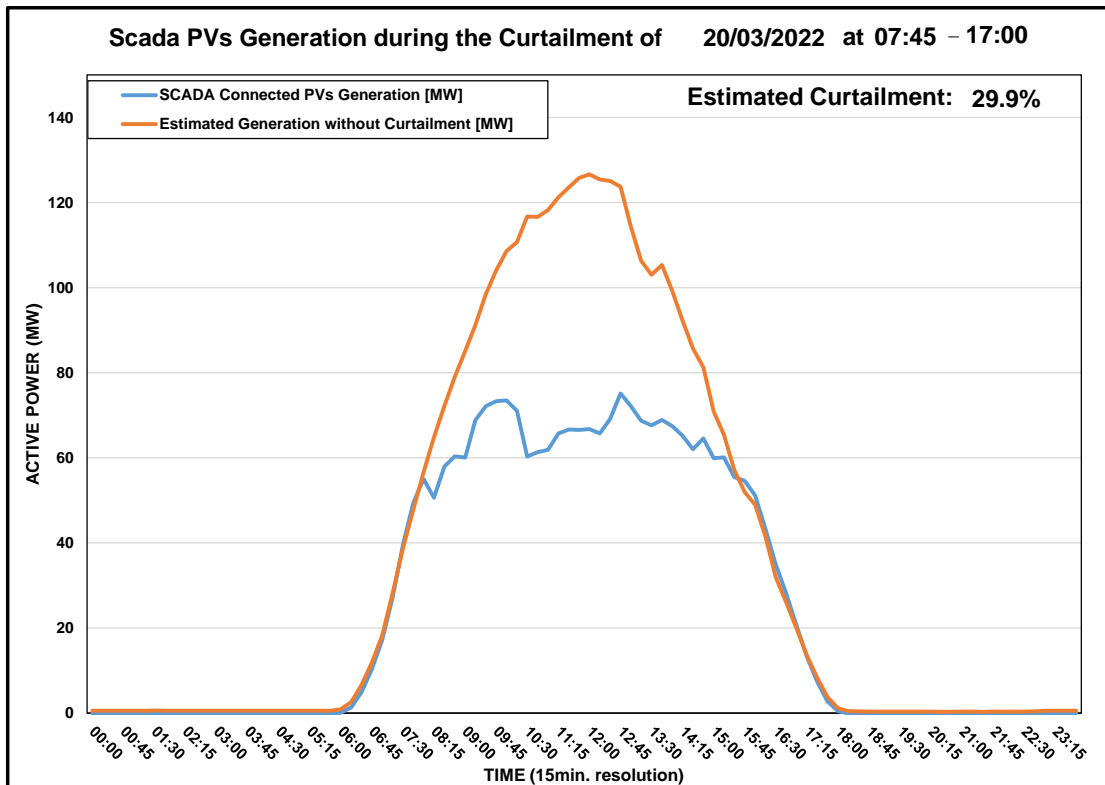


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	25/03/2022
Start of Curtailment	14:45
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	811.1 MWh
Total Estimated Curtailed Energy:	48.5 MWh
Percentage of Curtailed Energy	6.0%

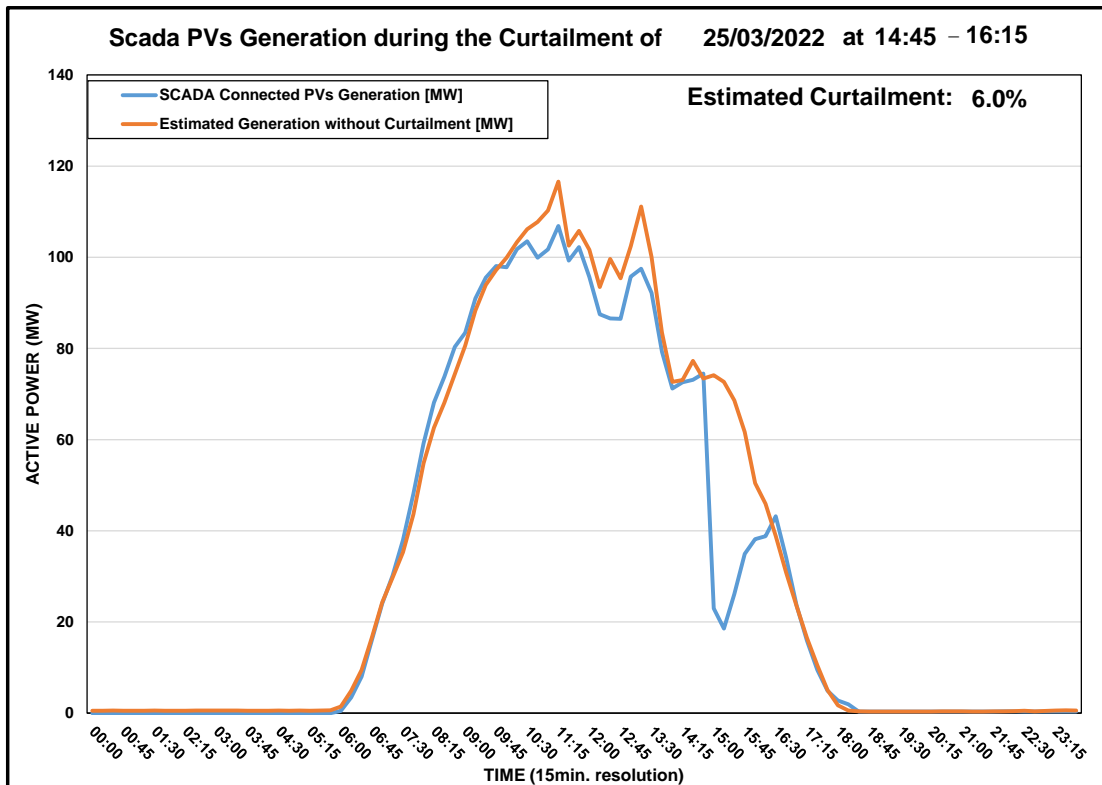


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	26/03/2022
Start of Curtailment	11:15
End of Curtailment	13:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	807.6 MWh
Total Estimated Curtailed Energy:	44.1 MWh
Percentage of Curtailed Energy	5.5%

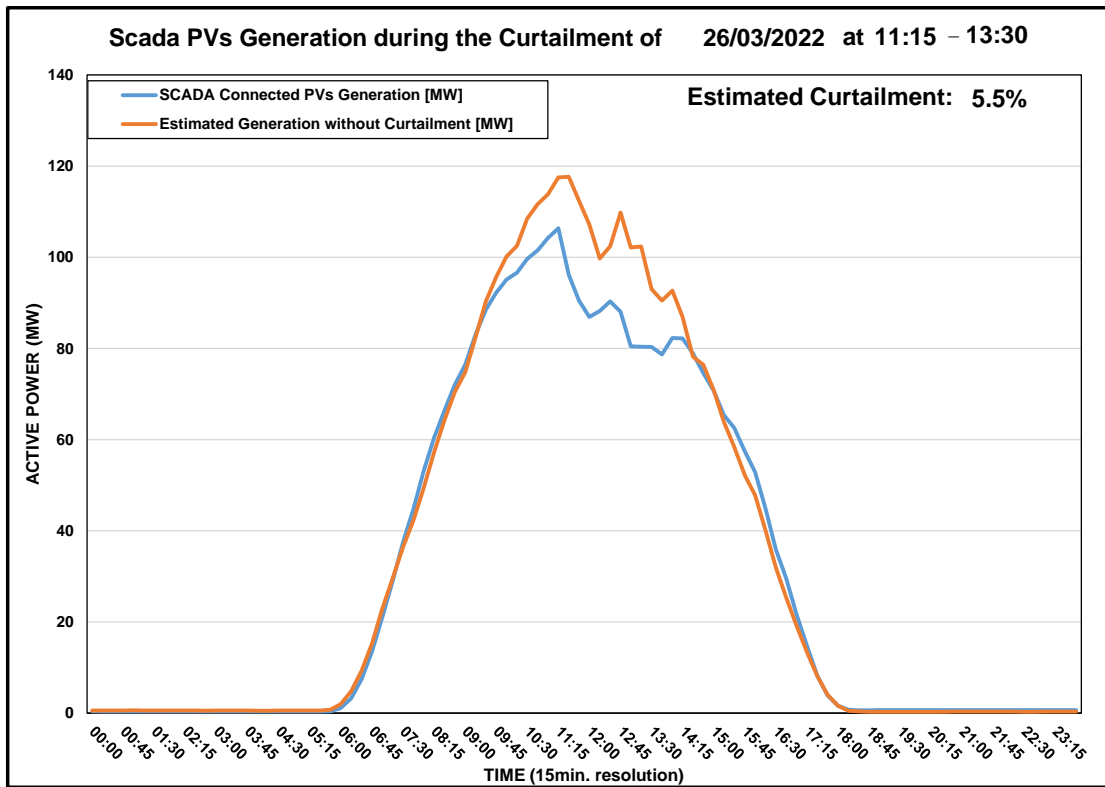


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	27/03/2022
Start of Curtailment	11:45
End of Curtailment	18:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	910.9 MWh
Total Estimated Curtailed Energy:	245.8 MWh
Percentage of Curtailed Energy	27.0%

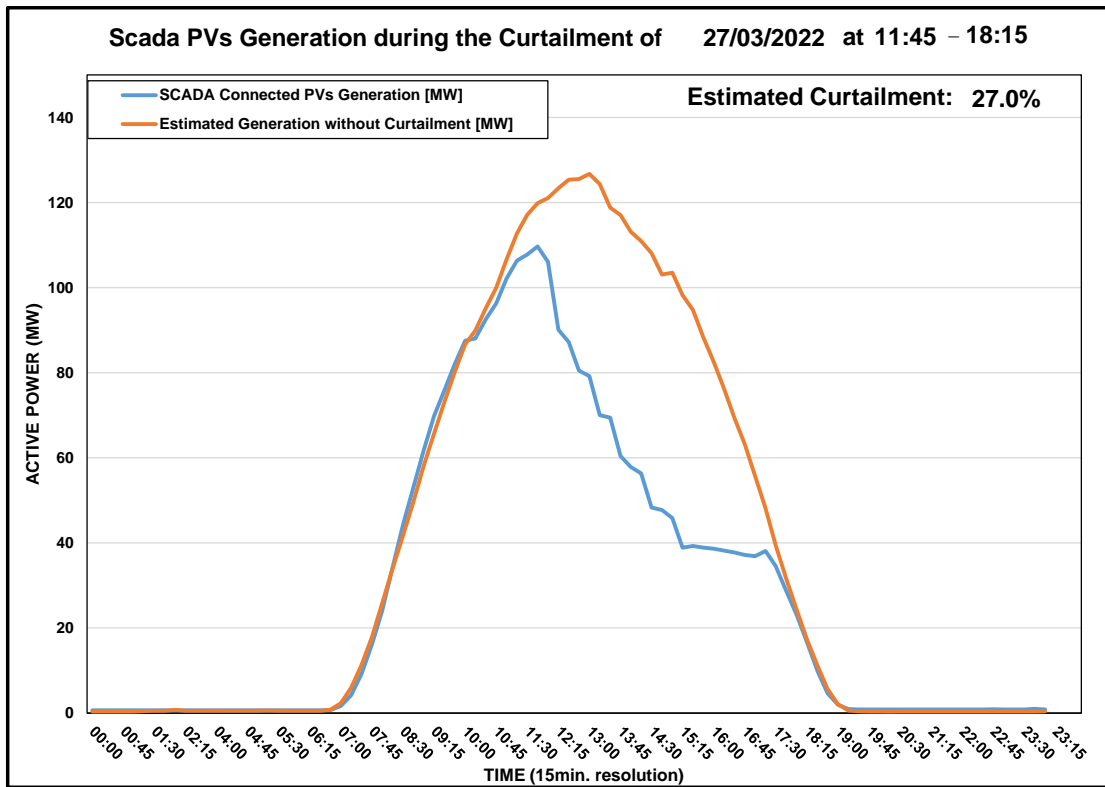


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	28/03/2022
Start of Curtailment	12:45
End of Curtailment	16:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	897.7 MWh
Total Estimated Curtailed Energy:	54.5 MWh
Percentage of Curtailed Energy	6.1%

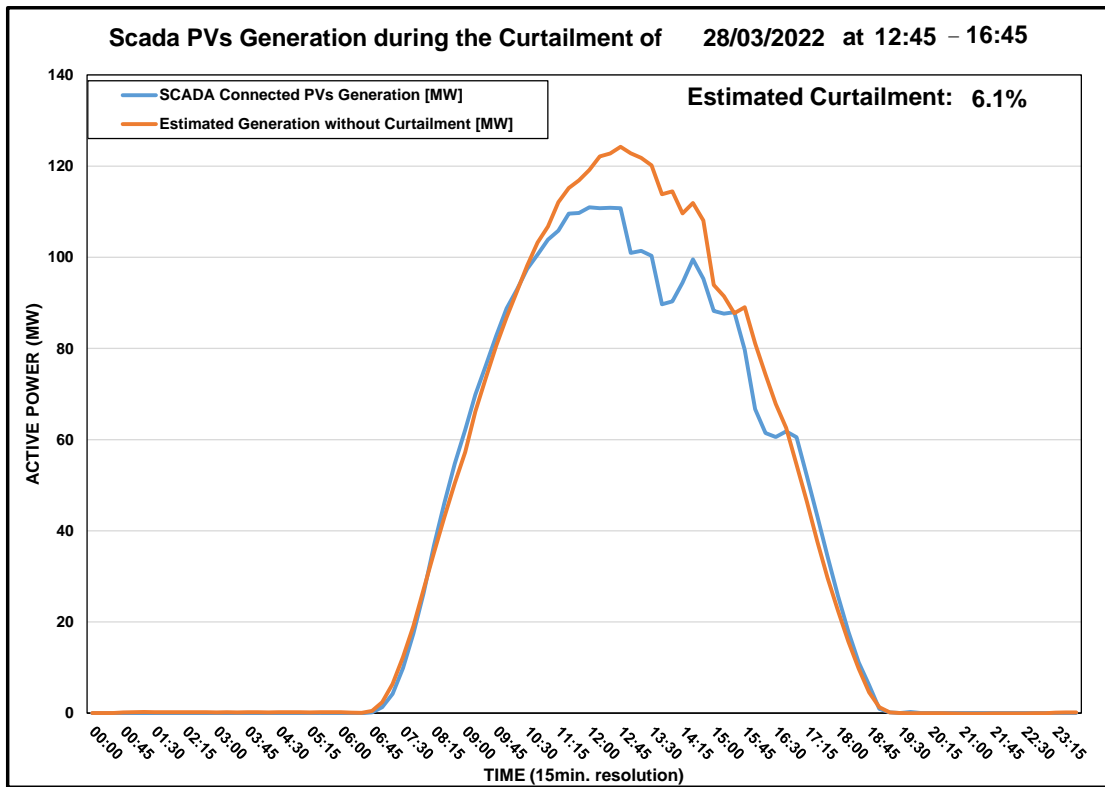


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	01/04/2022
Start of Curtailment	10:00
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	892.8 MWh
Total Estimated Curtailed Energy:	267.3 MWh
Percentage of Curtailed Energy	29.9%

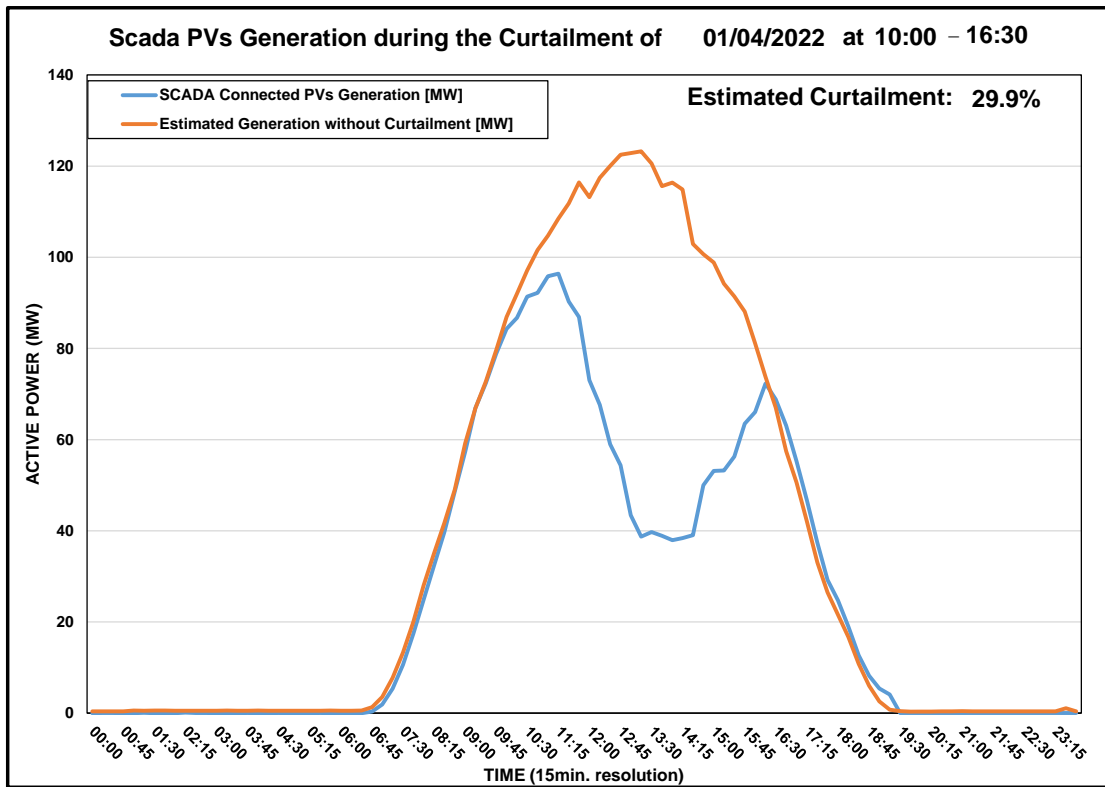


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	02/04/2022
Start of Curtailment	10:45
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	871.8 MWh
Total Estimated Curtailed Energy:	127.5 MWh
Percentage of Curtailed Energy	14.6%

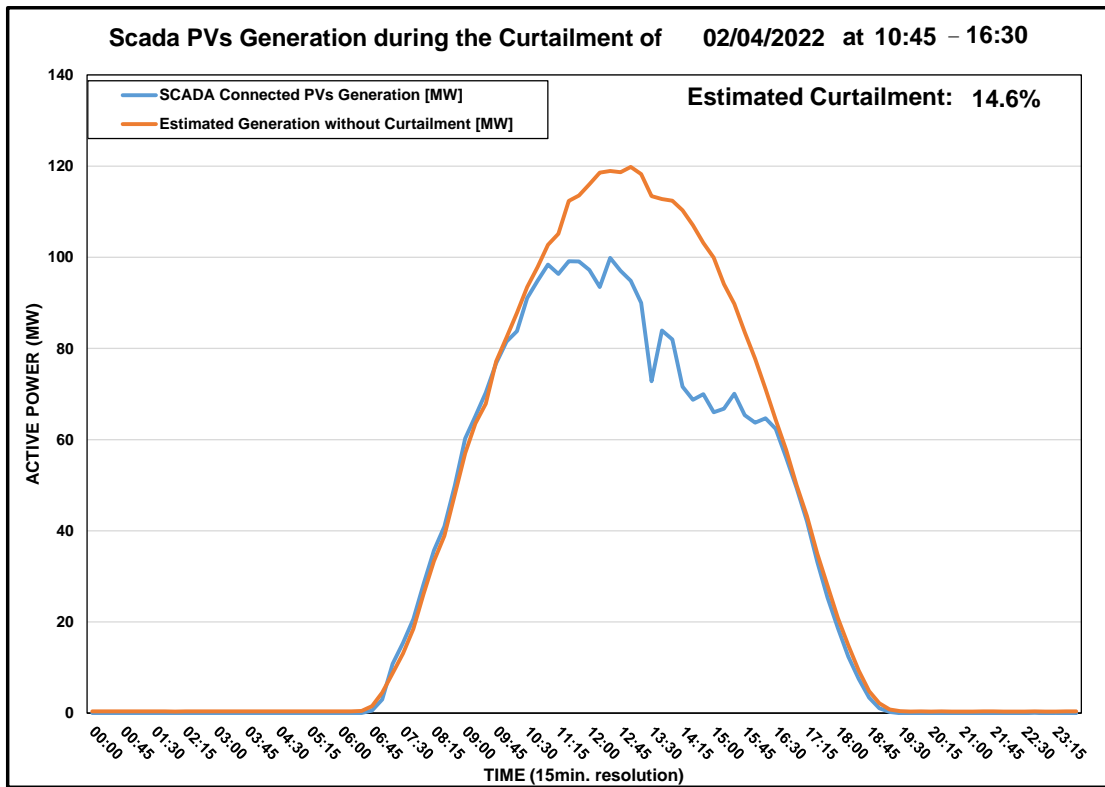


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	03/04/2022
Start of Curtailment	11:00
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	814.2 MWh
Total Estimated Curtailed Energy:	126.5 MWh
Percentage of Curtailed Energy	15.5%

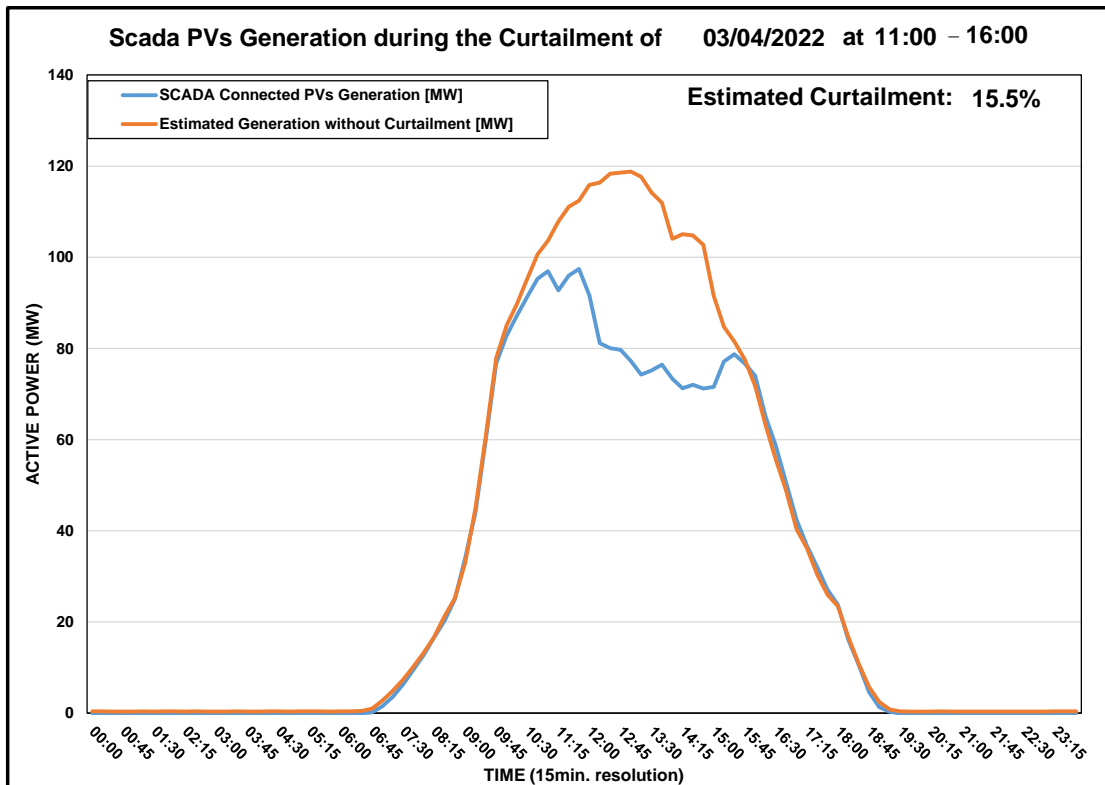


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	05/04/2022
Start of Curtailment	11:30
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	758.4 MWh
Total Estimated Curtailed Energy:	72.5 MWh
Percentage of Curtailed Energy	9.6%

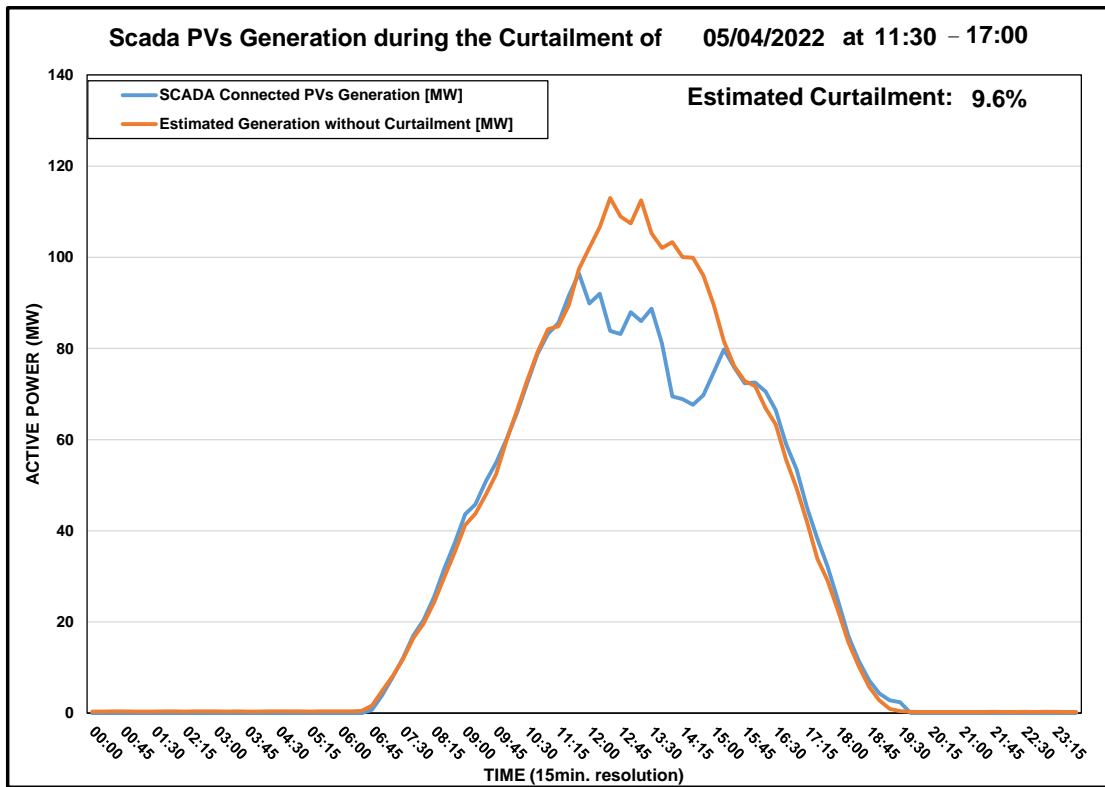


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	06/04/2022
Start of Curtailment	11:30
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	844.6 MWh
Total Estimated Curtailed Energy:	48.1 MWh
Percentage of Curtailed Energy	5.7%

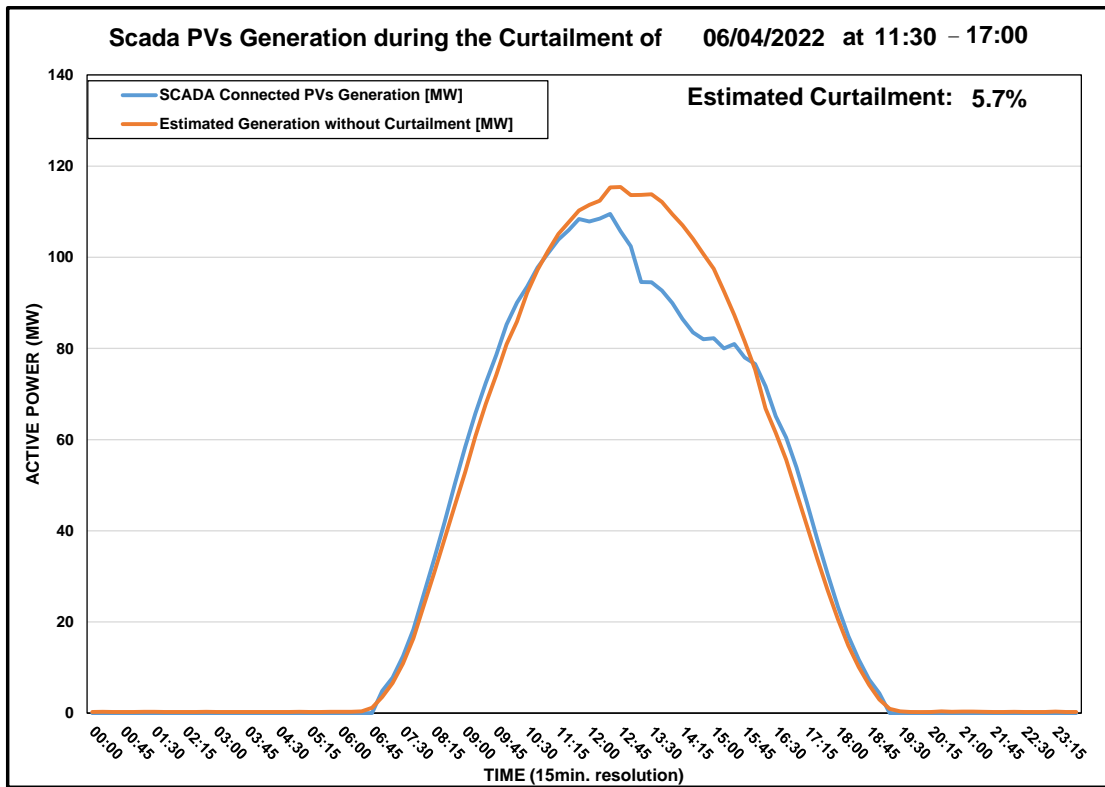


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	08/04/2022
Start of Curtailment	13:00
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	629.9 MWh
Total Estimated Curtailed Energy:	79.4 MWh
Percentage of Curtailed Energy	12.6%

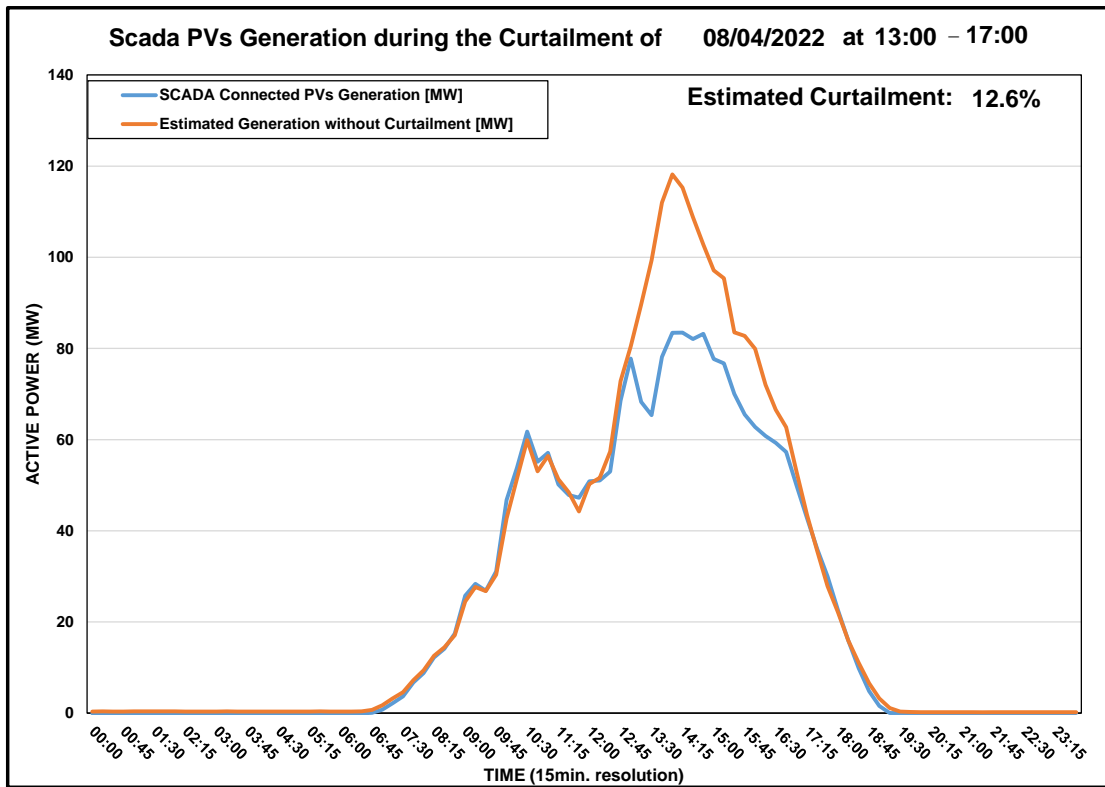


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	09/04/2022
Start of Curtailment	12:00
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	919 MWh
Total Estimated Curtailed Energy:	17.7 MWh
Percentage of Curtailed Energy	1.9%

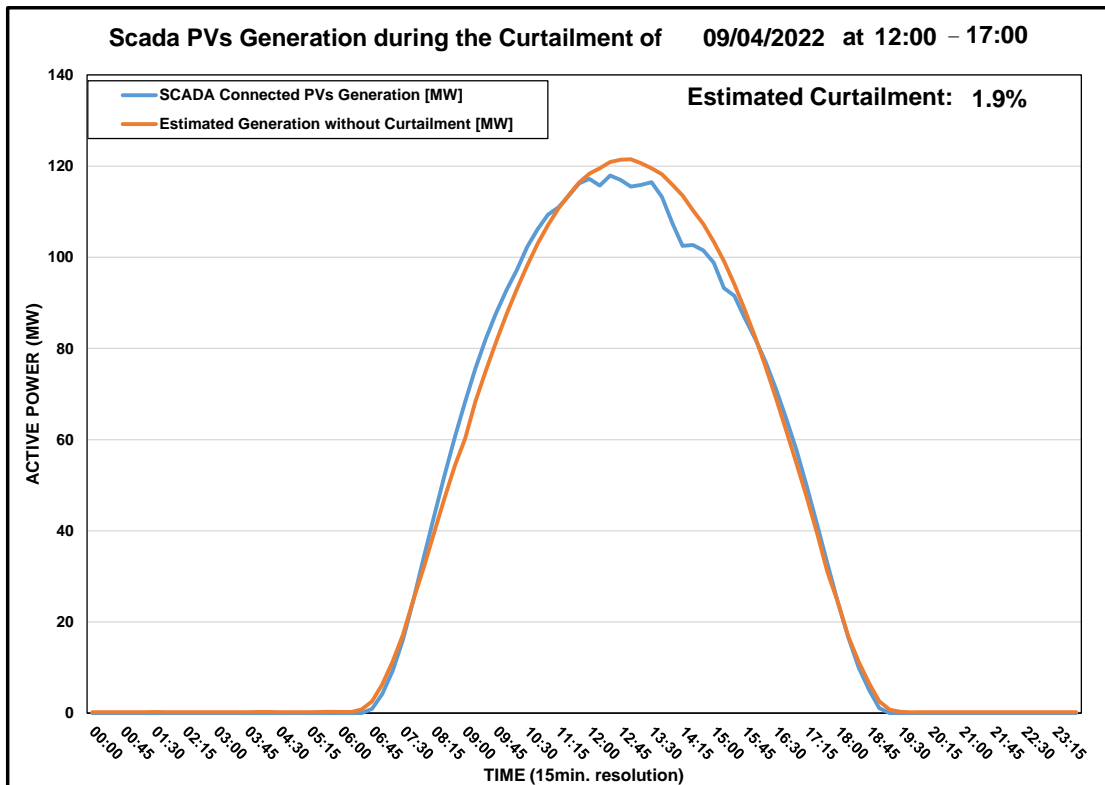


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	10/04/2022
Start of Curtailment	10:30
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	884.7 MWh
Total Estimated Curtailed Energy:	131.2 MWh
Percentage of Curtailed Energy	14.8%

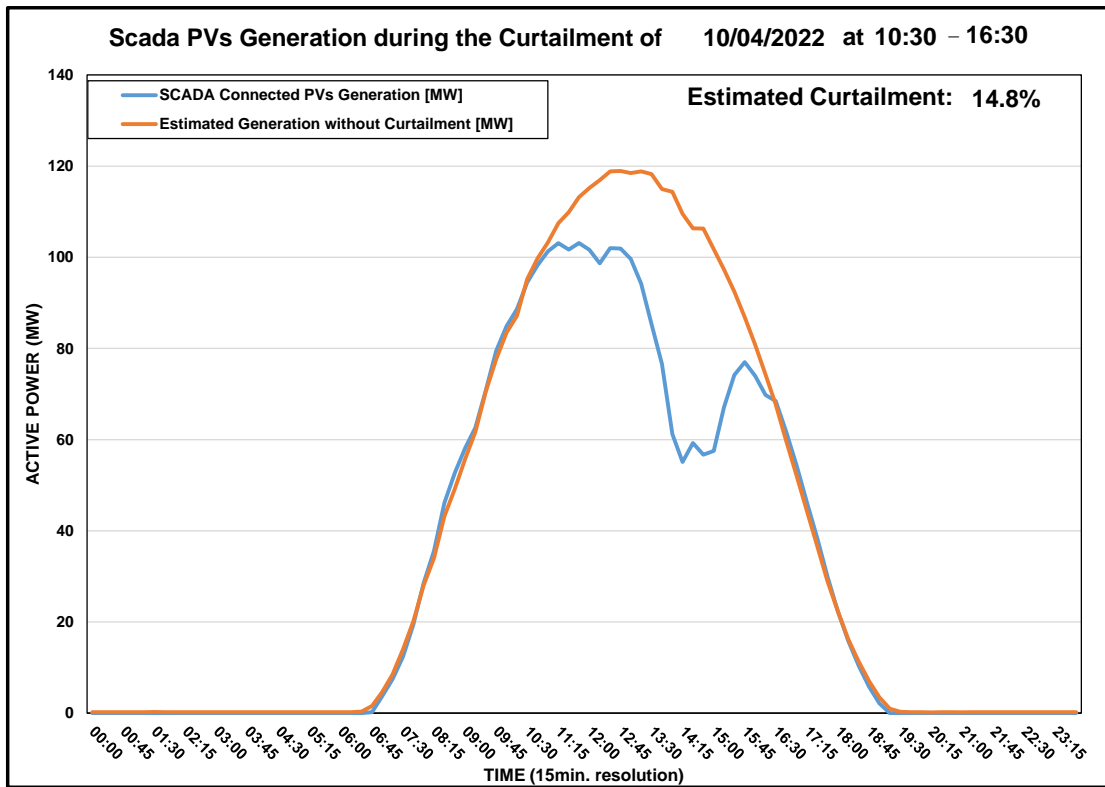


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	11/04/2022
Start of Curtailment	13:00
End of Curtailment	17:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	797.6 MWh
Total Estimated Curtailed Energy:	91.7 MWh
Percentage of Curtailed Energy	11.5%

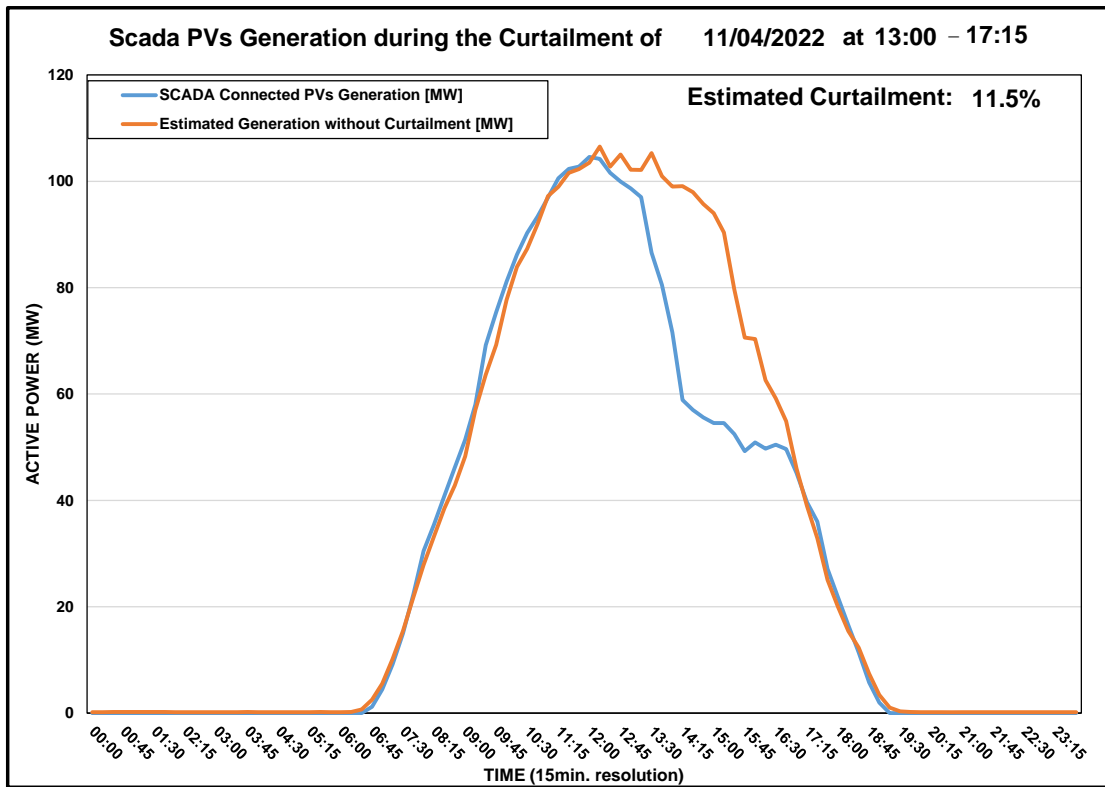


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	12/04/2022
Start of Curtailment	11:00
End of Curtailment	18:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	913.8 MWh
Total Estimated Curtailed Energy:	95.1 MWh
Percentage of Curtailed Energy	10.4%

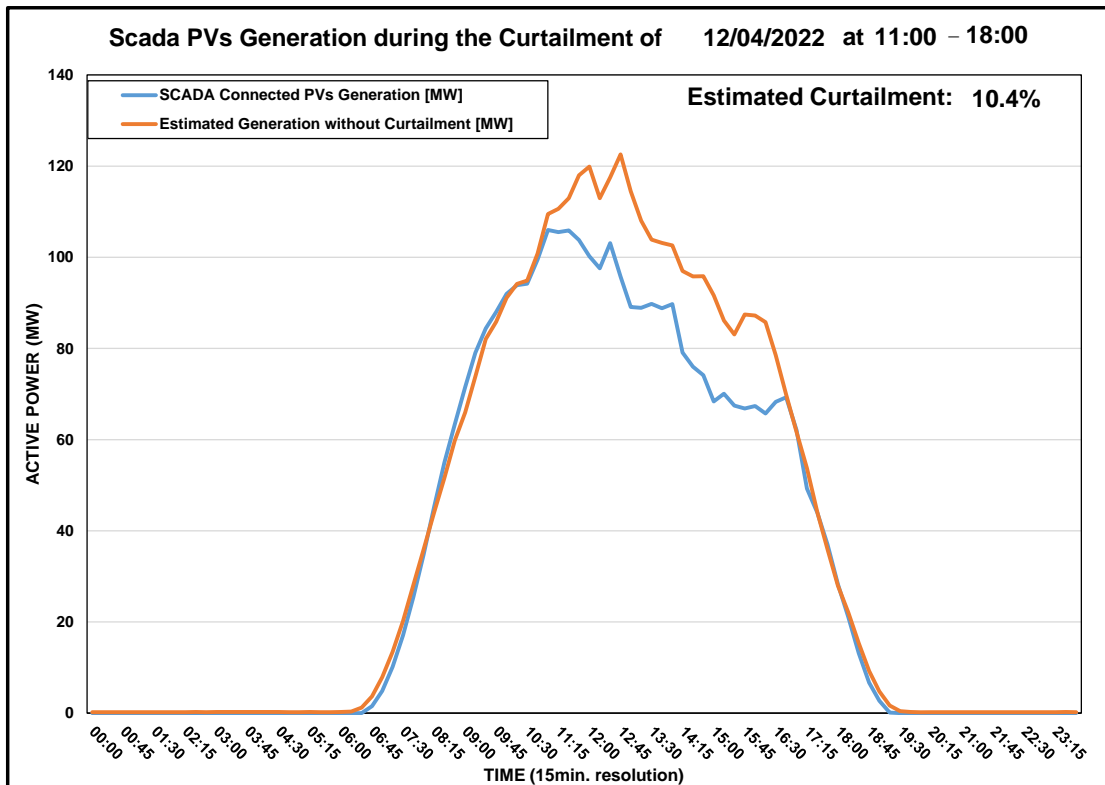


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	13/04/2022
Start of Curtailment	10:30
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	994.4 MWh
Total Estimated Curtailed Energy:	273.8 MWh
Percentage of Curtailed Energy	27.5%

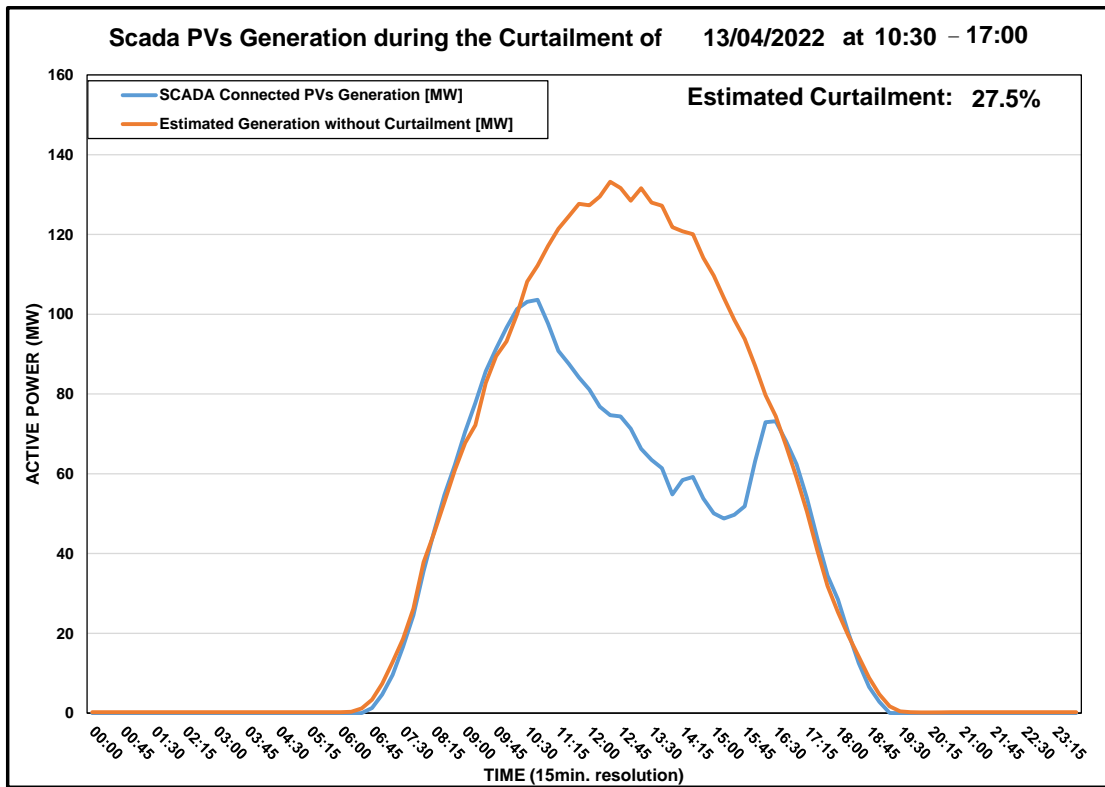


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	14/04/2022
Start of Curtailment	10:30
End of Curtailment	16:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1020.7 MWh
Total Estimated Curtailed Energy:	234.2 MWh
Percentage of Curtailed Energy	22.9%

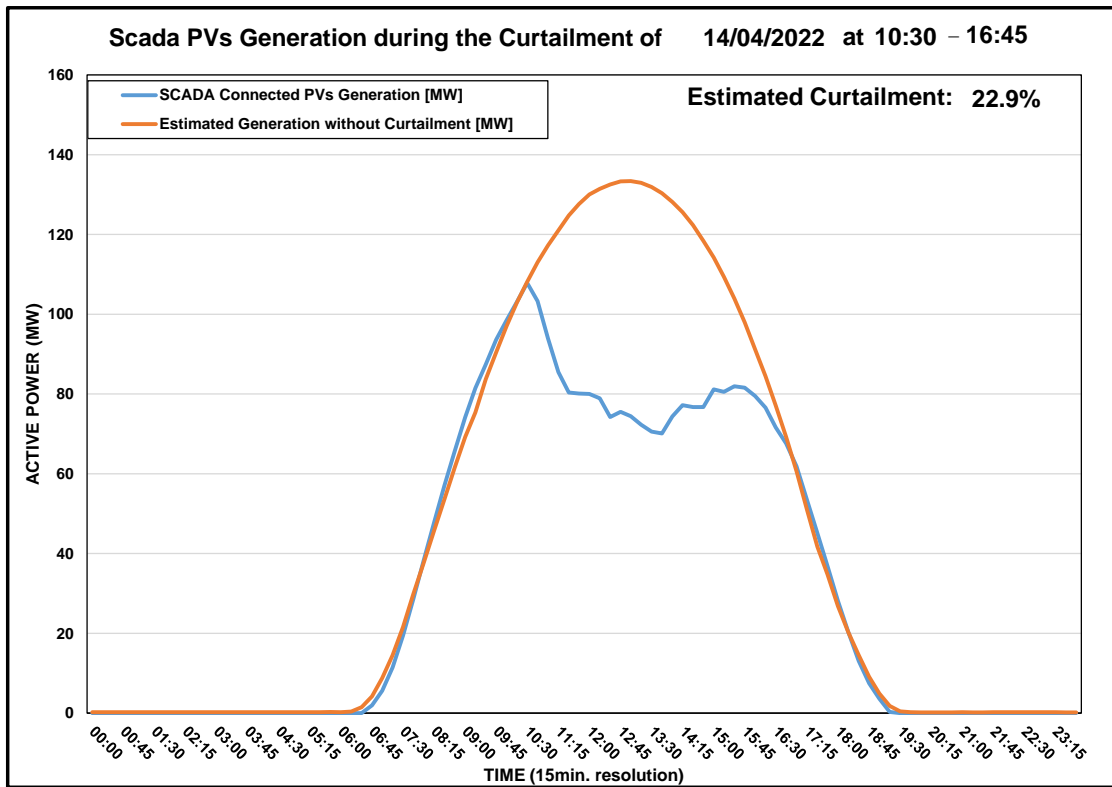


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	16/04/2022
Start of Curtailment	13:30
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	912.5 MWh
Total Estimated Curtailed Energy:	14.5 MWh
Percentage of Curtailed Energy	1.6%

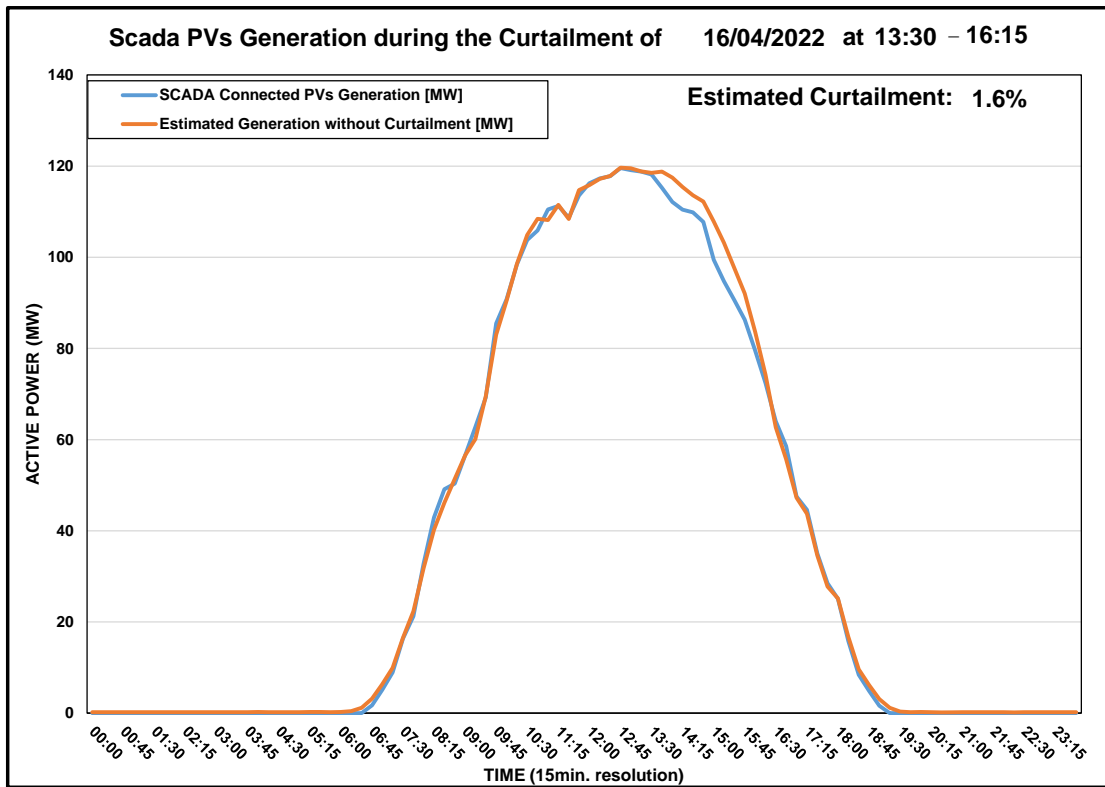


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	17/04/2022
Start of Curtailment	11:15
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	675.7 MWh
Total Estimated Curtailed Energy:	90.6 MWh
Percentage of Curtailed Energy	13.4%

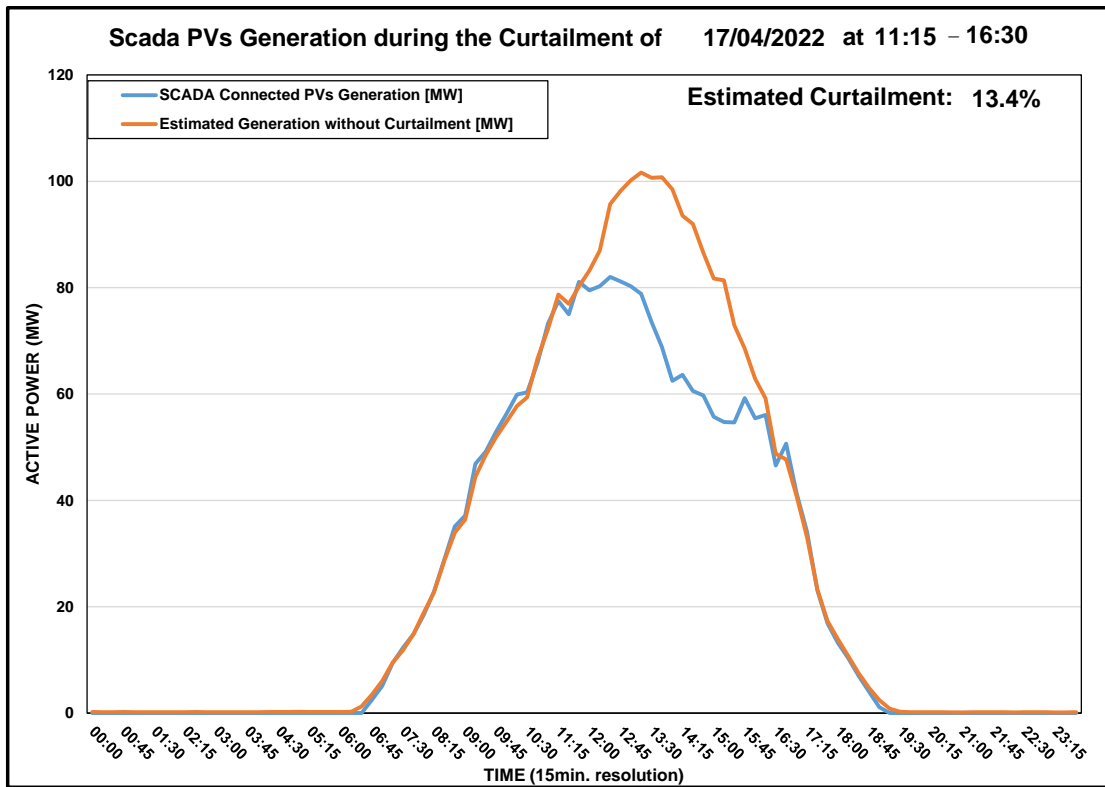


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	19/04/2022
Start of Curtailment	13:00
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	902 MWh
Total Estimated Curtailed Energy:	34.4 MWh
Percentage of Curtailed Energy	3.8%

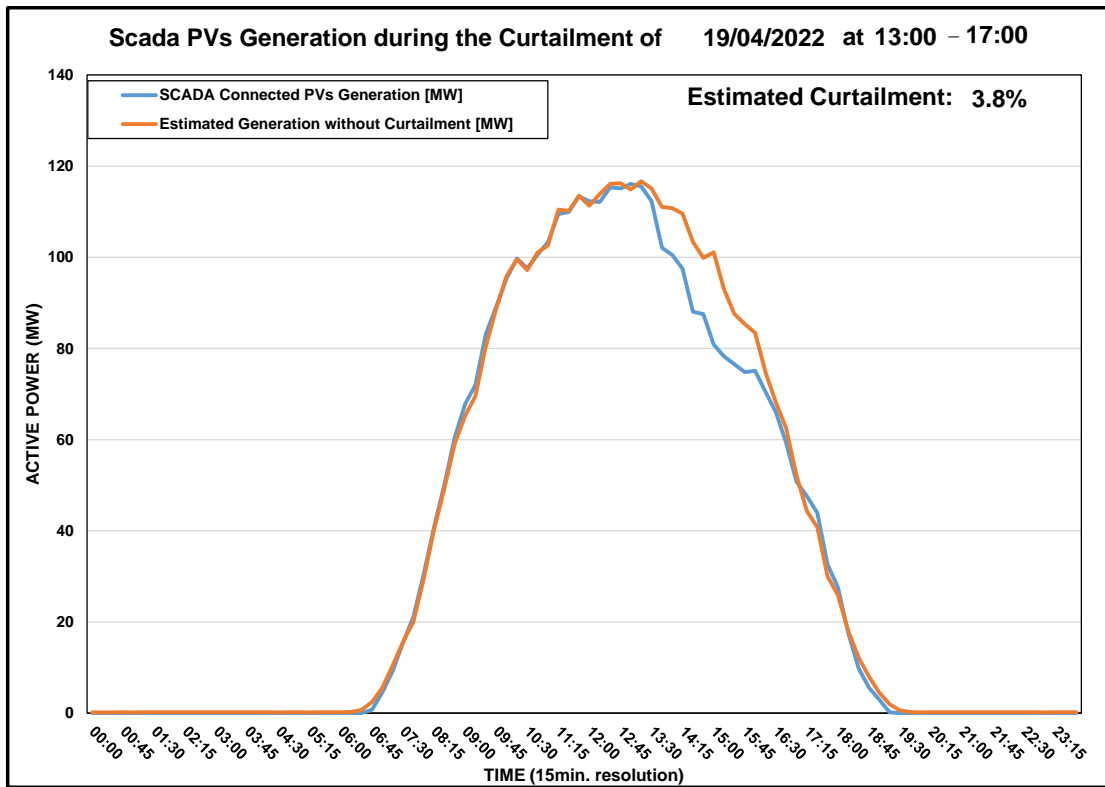


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	21/04/2022
Start of Curtailment	13:45
End of Curtailment	17:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	986.5 MWh
Total Estimated Curtailed Energy:	59.4 MWh
Percentage of Curtailed Energy	6.0%

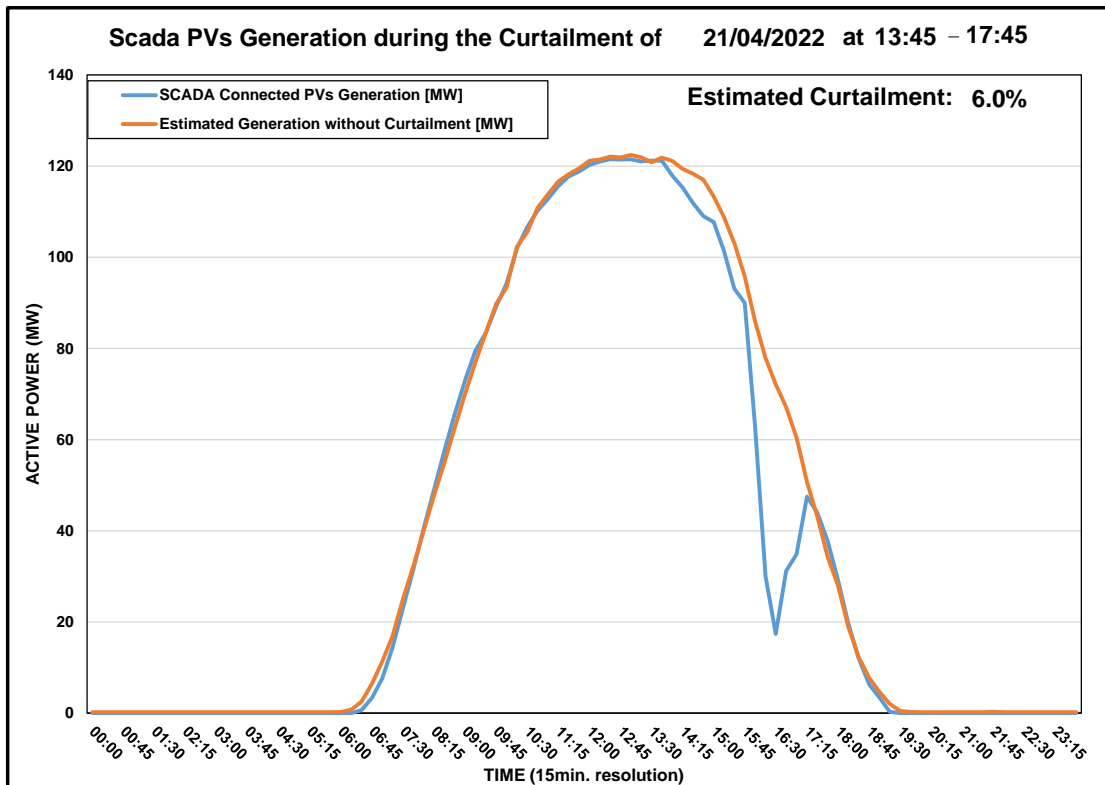


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	24/04/2022
Start of Curtailment	12:15
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	819.1 MWh
Total Estimated Curtailed Energy:	25.2 MWh
Percentage of Curtailed Energy	3.1%

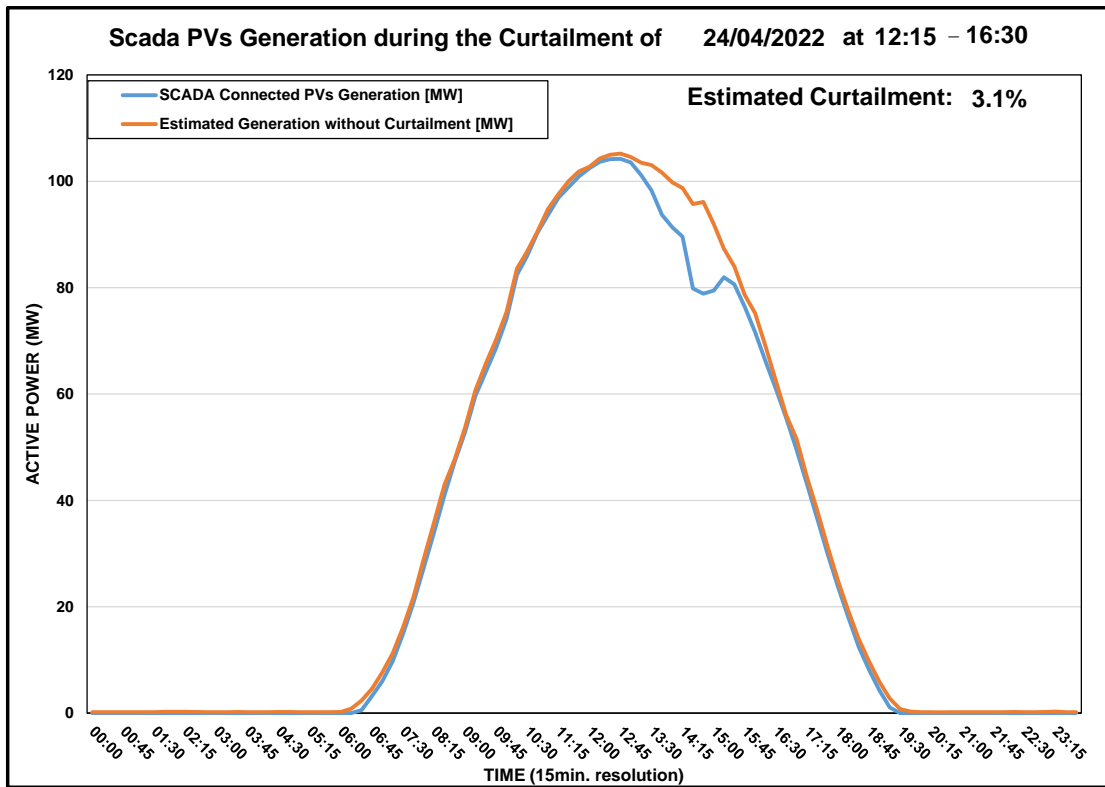


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	25/04/2022
Start of Curtailment	12:00
End of Curtailment	18:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	917.4 MWh
Total Estimated Curtailed Energy:	47.7 MWh
Percentage of Curtailed Energy	5.2%

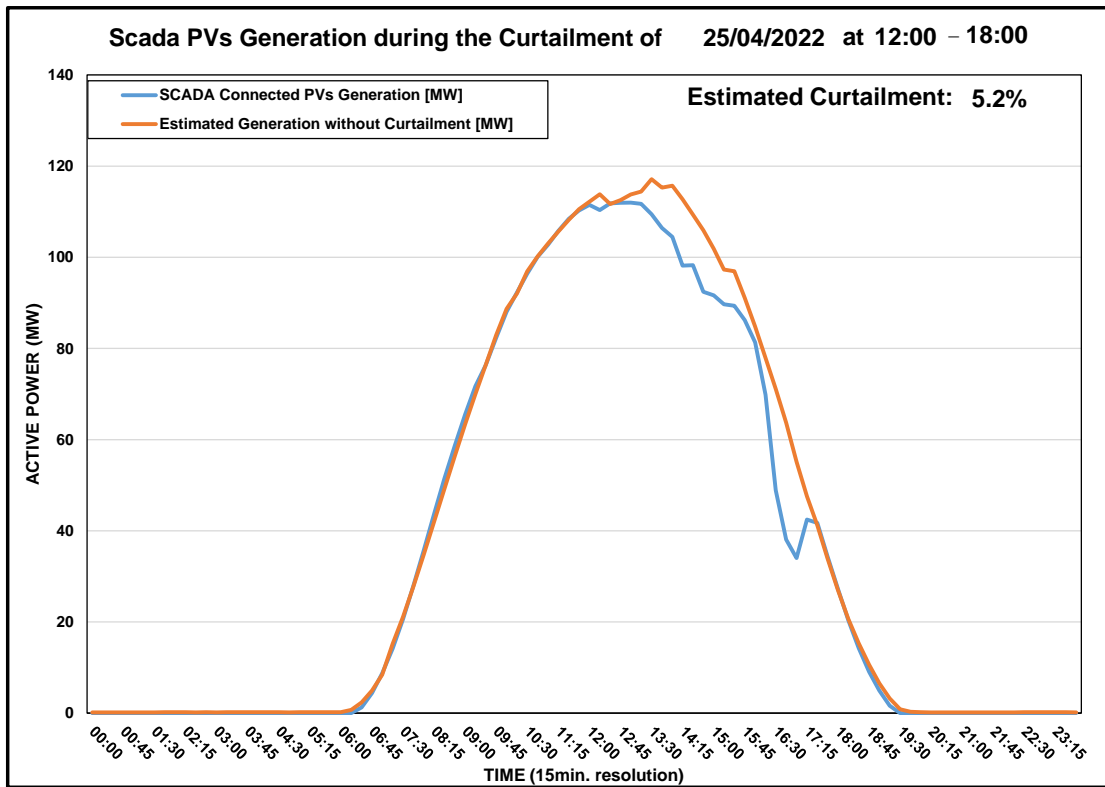


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	06/05/2022
Start of Curtailment	09:45
End of Curtailment	17:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1023.3 MWh
Total Estimated Curtailed Energy:	244.3 MWh
Percentage of Curtailed Energy	23.9%

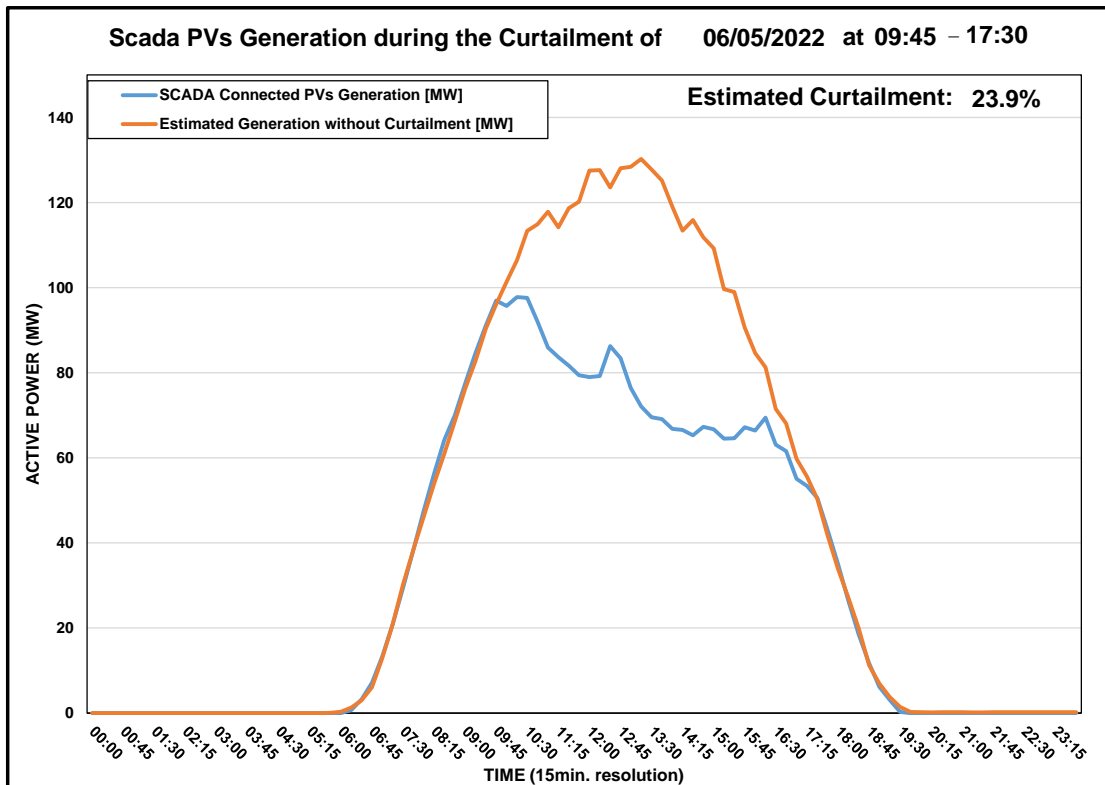


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	07/05/2022
Start of Curtailment	10:00
End of Curtailment	18:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system / Scheduled work on the Transmission System
Total Estimated Energy of the day:	1015.3 MWh
Total Estimated Curtailed Energy:	377.1 MWh
Percentage of Curtailed Energy	37.1%

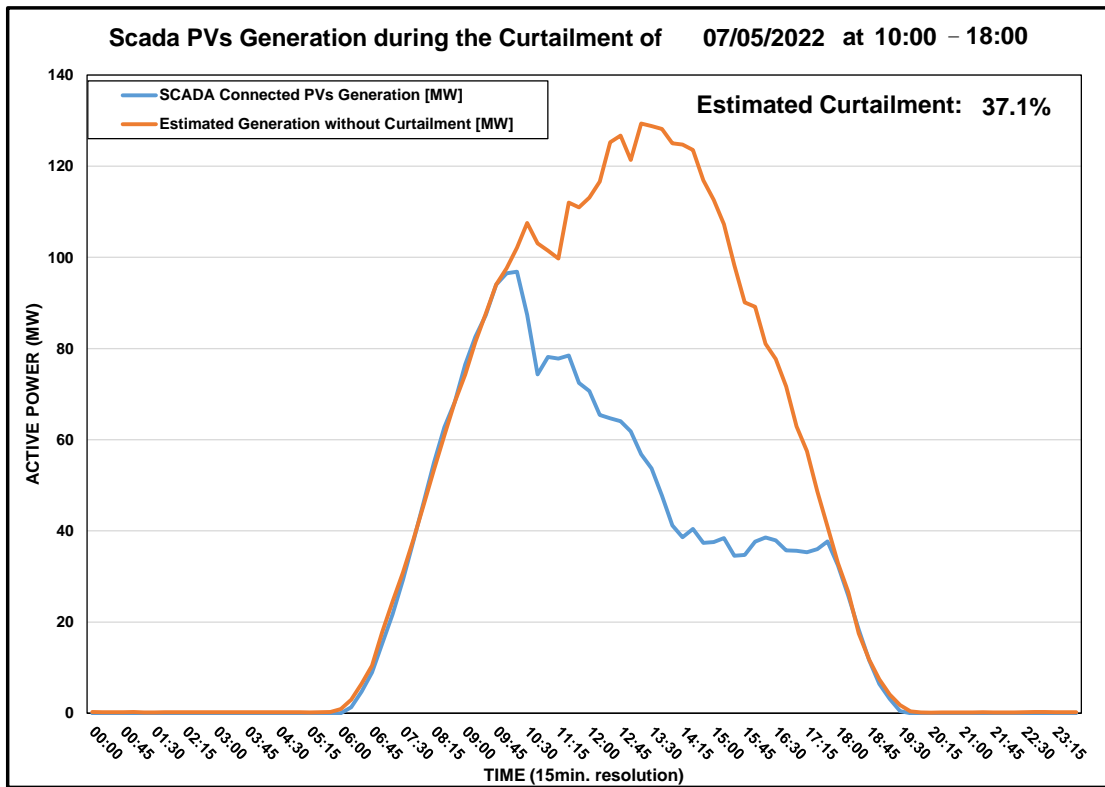


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	08/05/2022
Start of Curtailment	09:30
End of Curtailment	17:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1071 MWh
Total Estimated Curtailed Energy:	244.8 MWh
Percentage of Curtailed Energy	22.9%

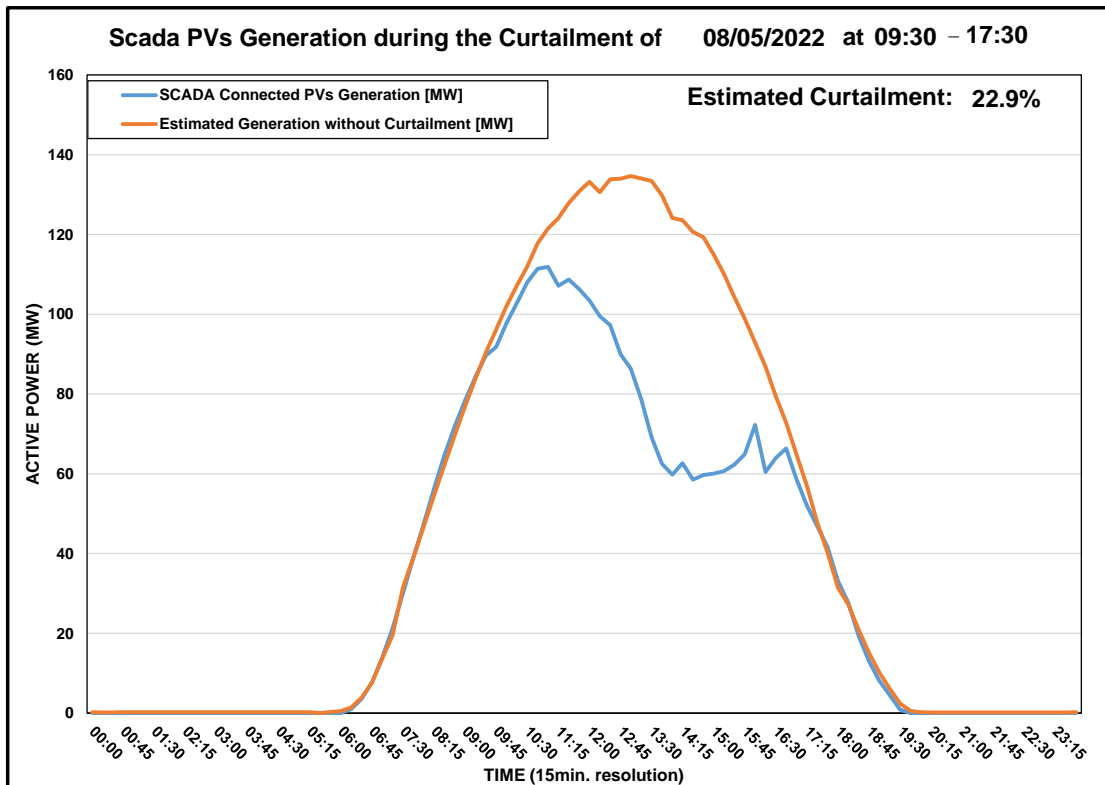


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	09/05/2022
Start of Curtailment	15:00
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	860.9 MWh
Total Estimated Curtailed Energy:	30 MWh
Percentage of Curtailed Energy	3.5%

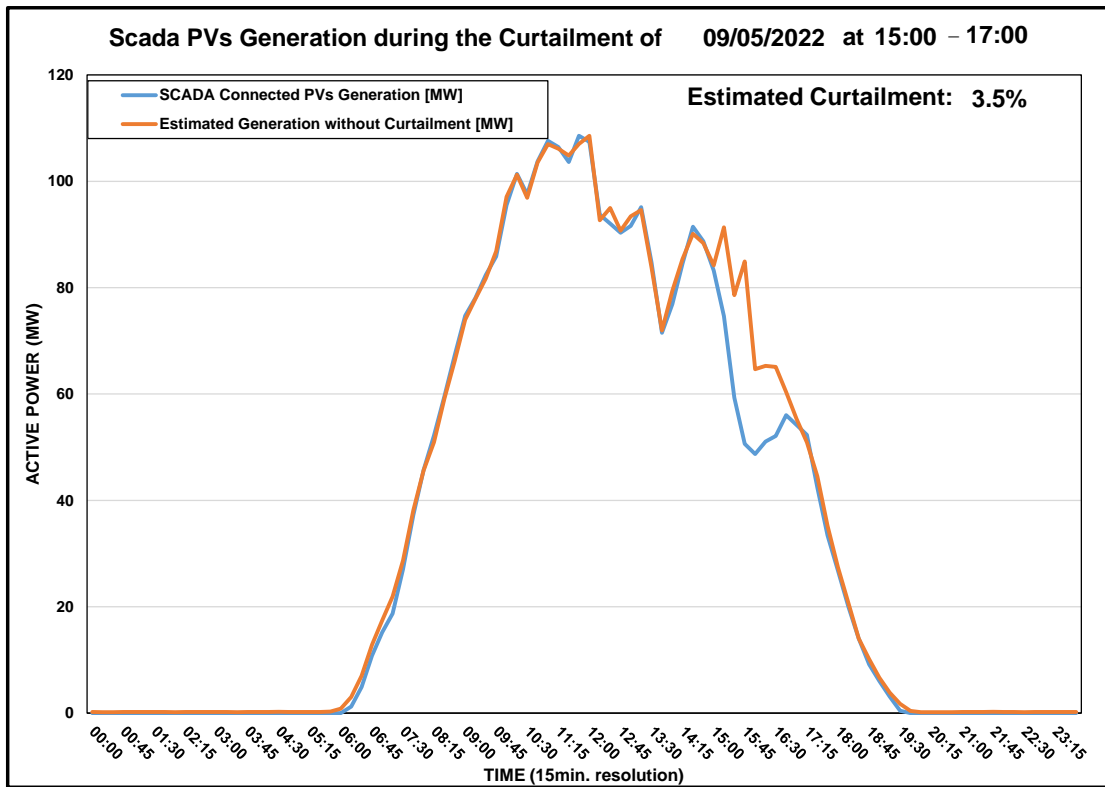


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	15/05/2022
Start of Curtailment	10:45
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	842.9 MWh
Total Estimated Curtailed Energy:	191.7 MWh
Percentage of Curtailed Energy	22.7%

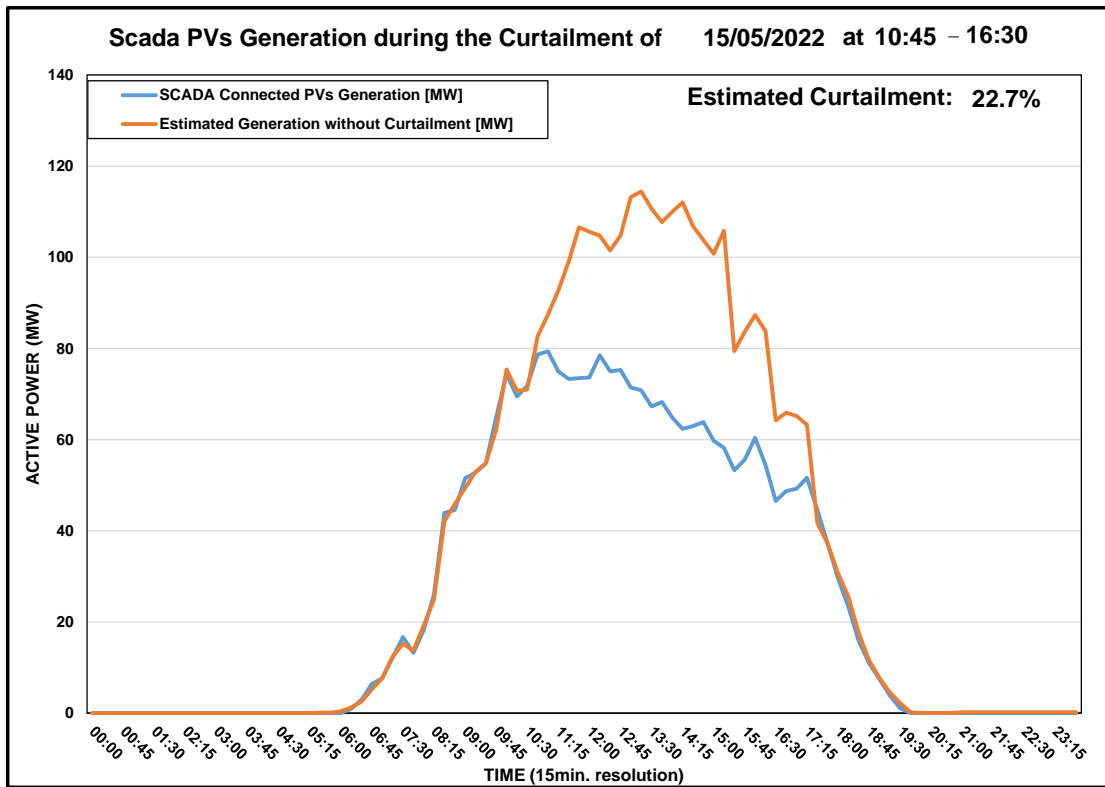


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	22/05/2022
Start of Curtailment	10:15
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	932.4 MWh
Total Estimated Curtailed Energy:	170.7 MWh
Percentage of Curtailed Energy	18.3%

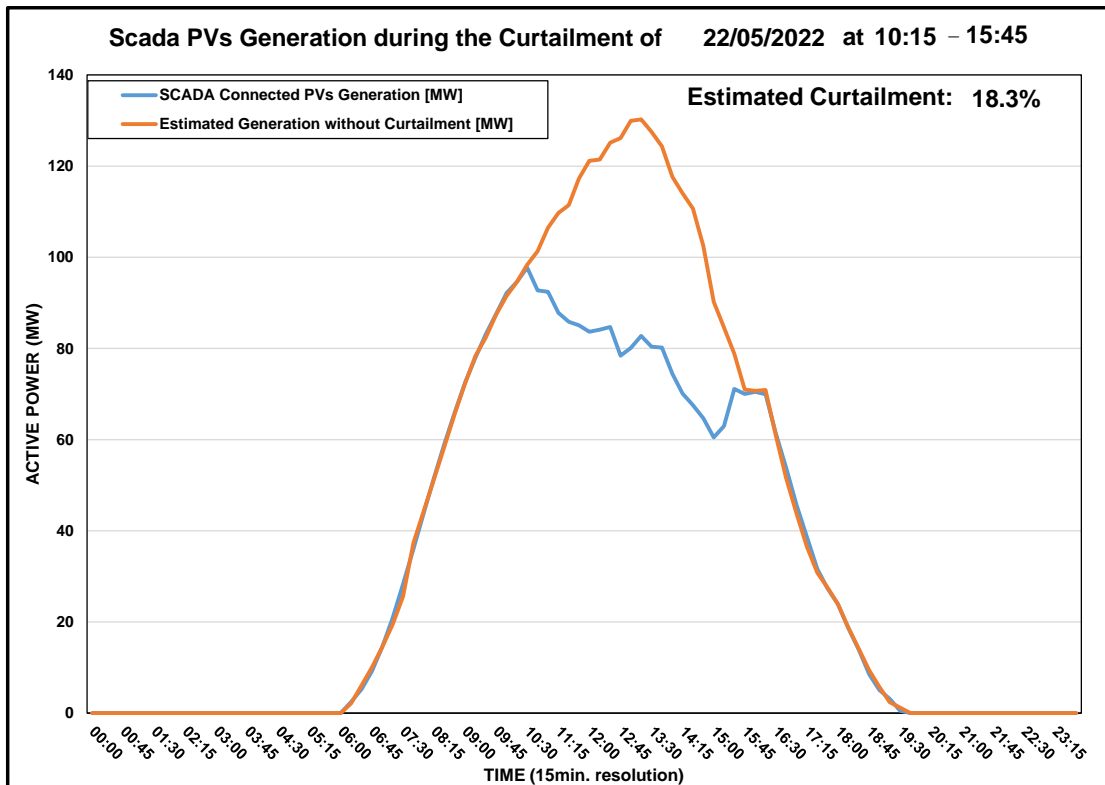


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	23/05/2022
Start of Curtailment	11:45
End of Curtailment	17:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1058.3 MWh
Total Estimated Curtailed Energy:	144.8 MWh
Percentage of Curtailed Energy	13.7%

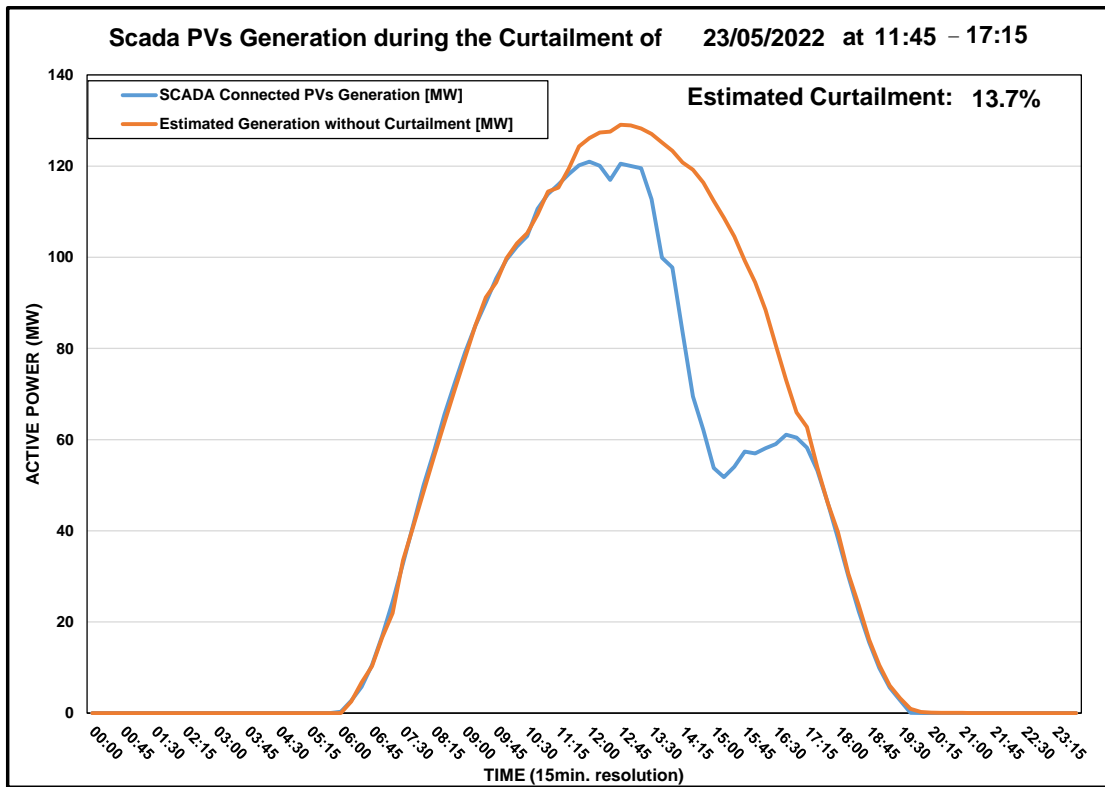


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	05/06/2022
Start of Curtailment	13:30
End of Curtailment	17:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	920.4 MWh
Total Estimated Curtailed Energy:	29.6 MWh
Percentage of Curtailed Energy	3.2%

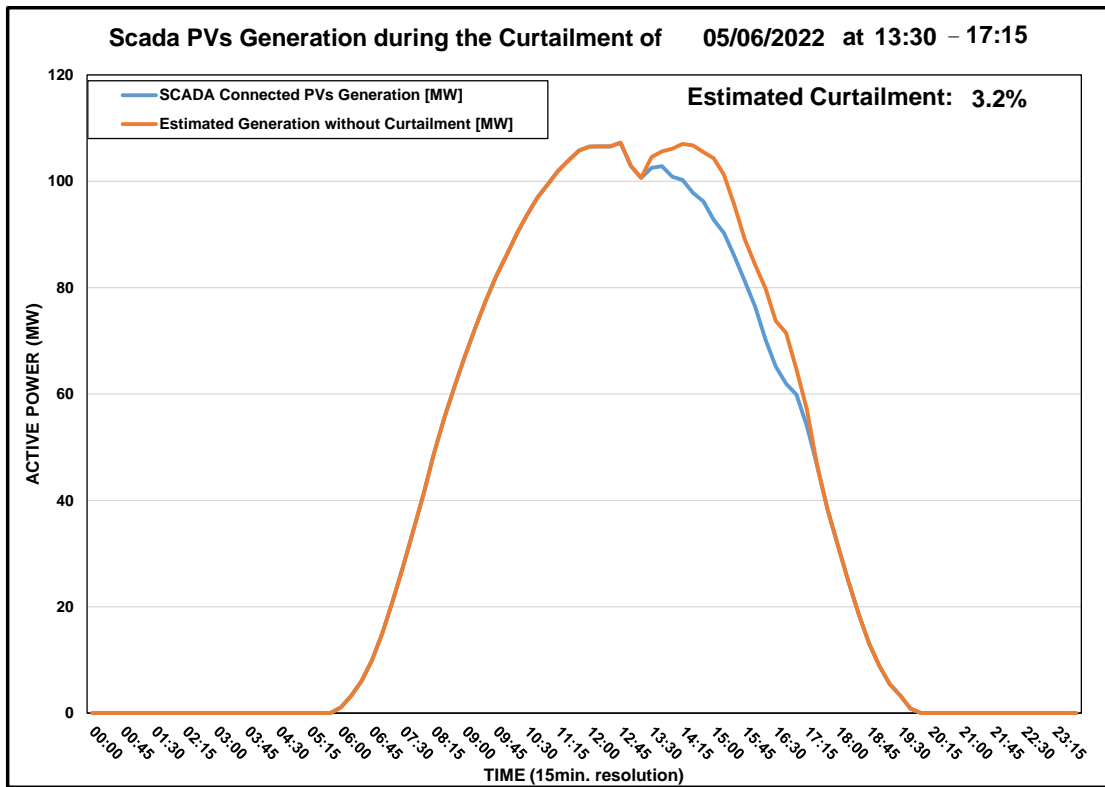


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	12/06/2022
Start of Curtailment	10:00
End of Curtailment	16:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	883.6 MWh
Total Estimated Curtailed Energy:	121.1 MWh
Percentage of Curtailed Energy	13.7%

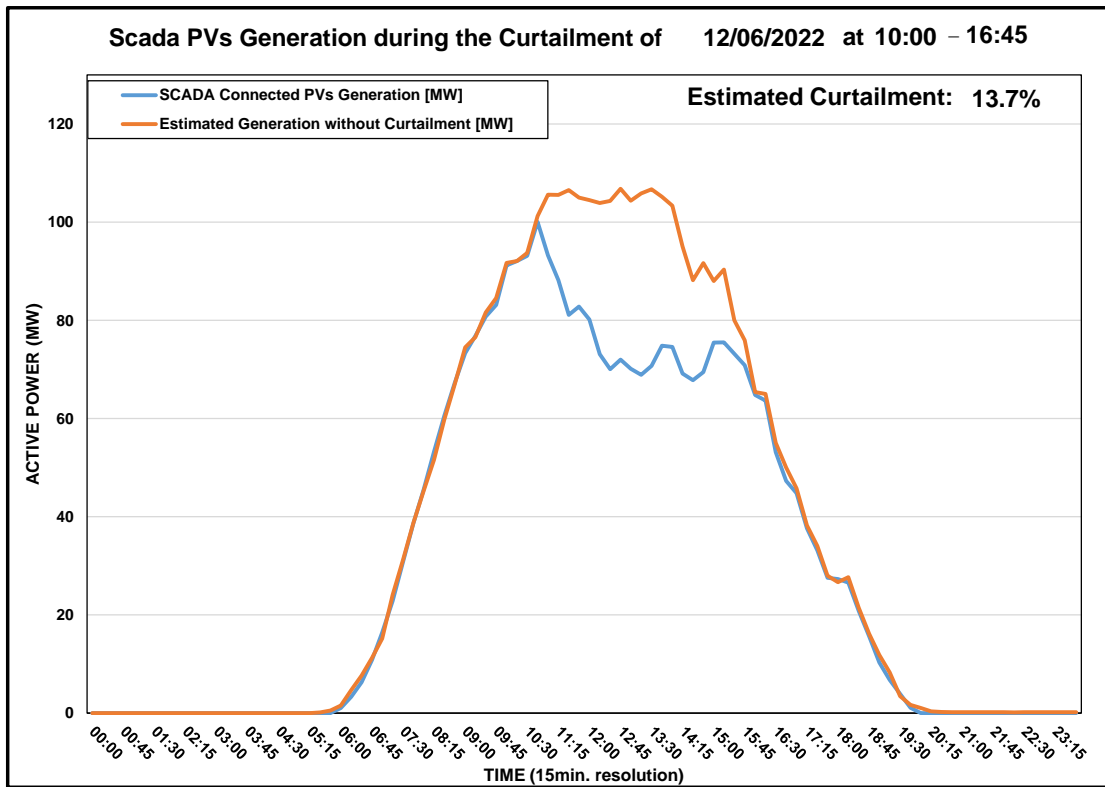


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	13/06/2022
Start of Curtailment	10:30
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	907.4 MWh
Total Estimated Curtailed Energy:	102.1 MWh
Percentage of Curtailed Energy	11.3%

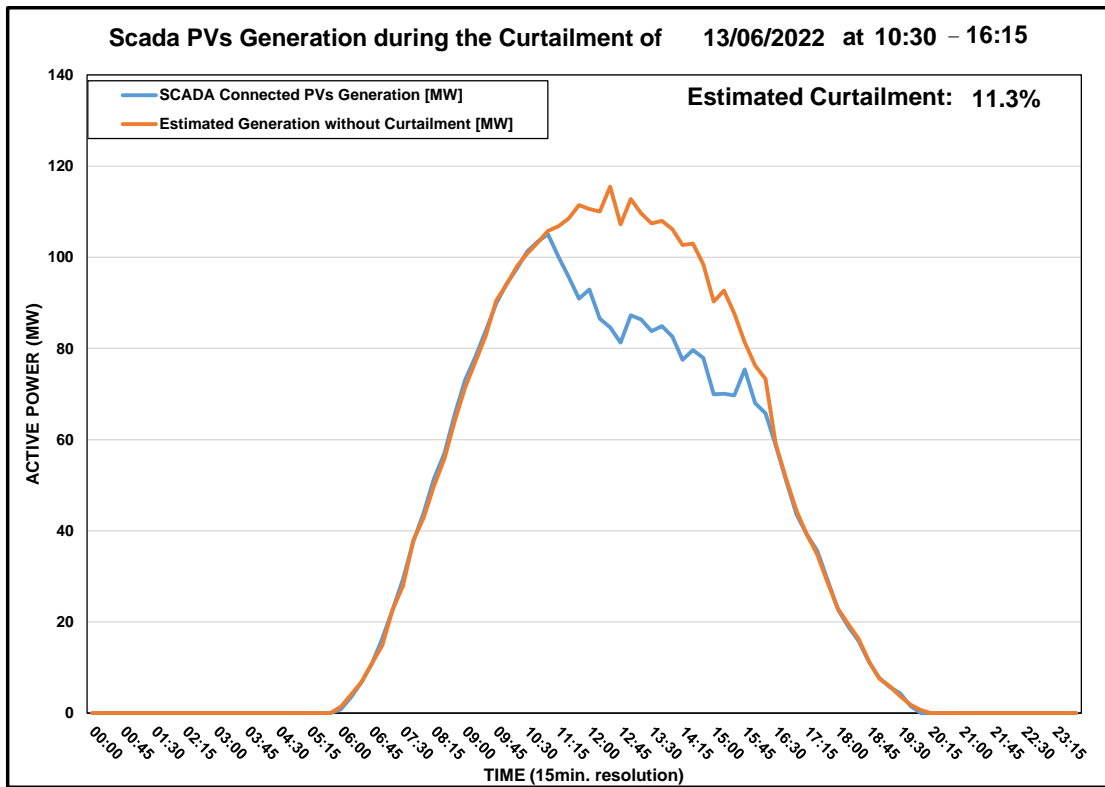


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	19/06/2022
Start of Curtailment	10:15
End of Curtailment	17:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1019.9 MWh
Total Estimated Curtailed Energy:	84.9 MWh
Percentage of Curtailed Energy	8.3%

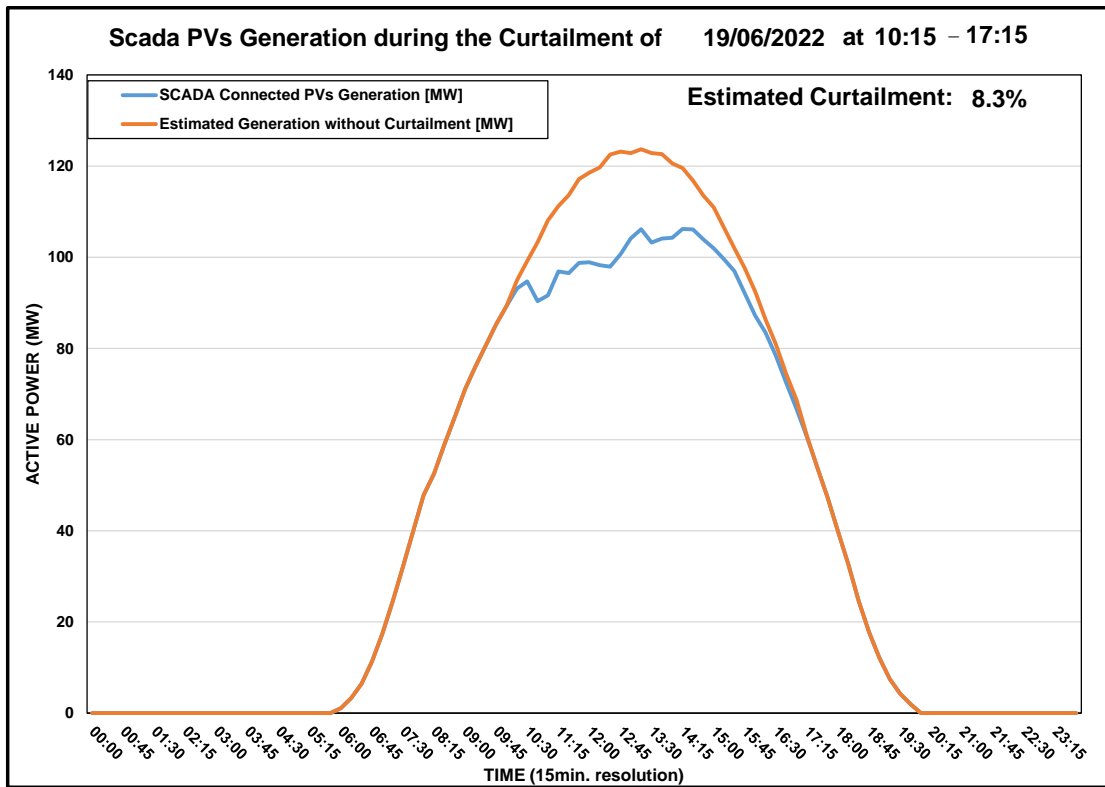


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	25/06/2022
Start of Curtailment	08:30
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1125.4 MWh
Total Estimated Curtailed Energy:	385.6 MWh
Percentage of Curtailed Energy	34.3%

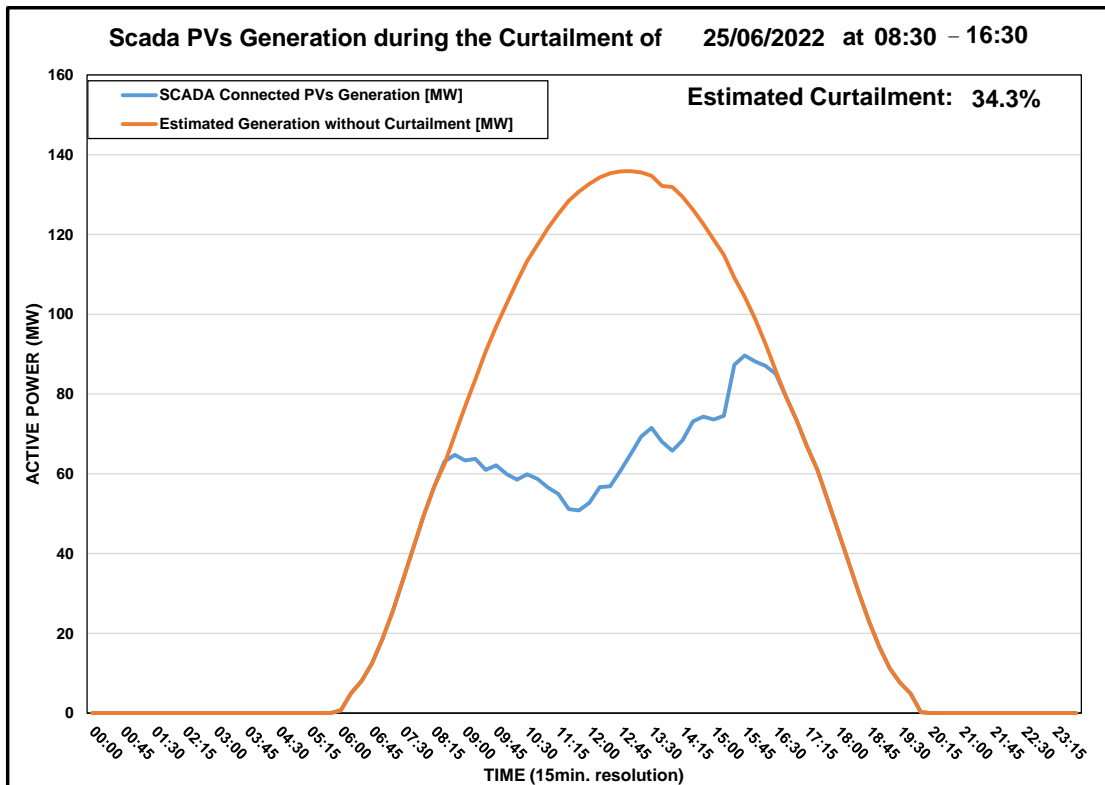


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	26/06/2022
Start of Curtailment	10:00
End of Curtailment	16:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1118.5 MWh
Total Estimated Curtailed Energy:	239 MWh
Percentage of Curtailed Energy	21.4%

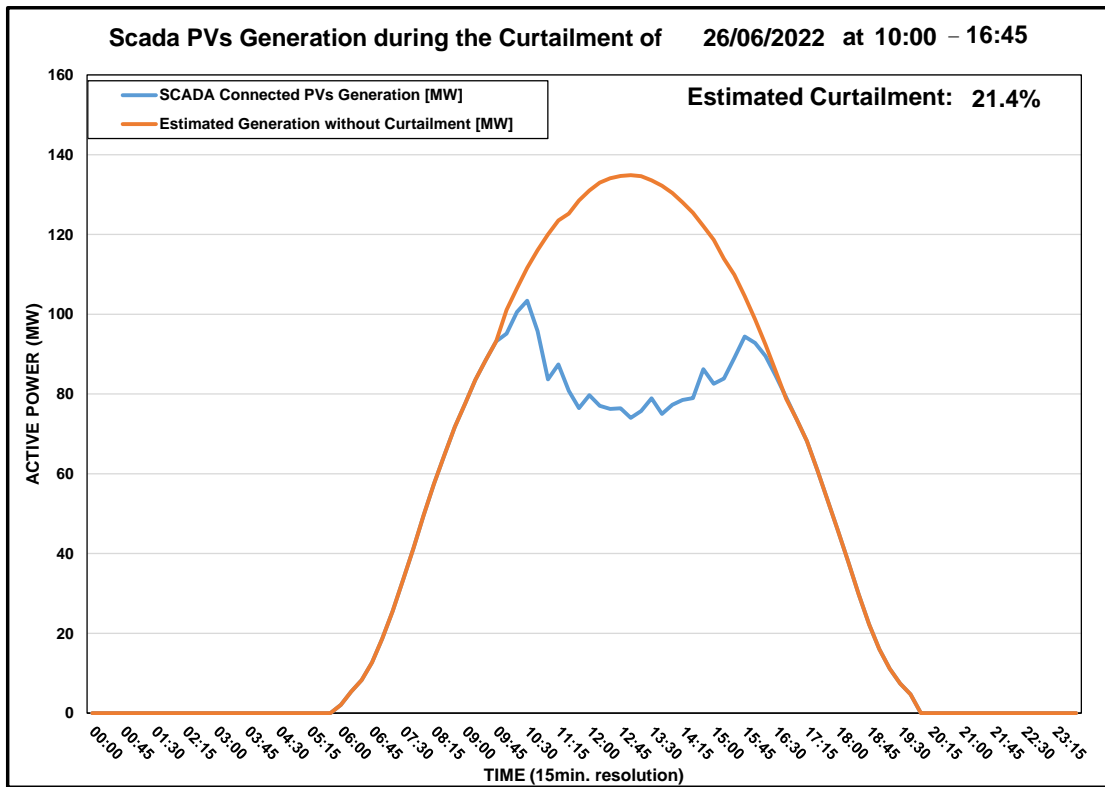


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	10/07/2022
Start of Curtailment	11:30
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	930.2 MWh
Total Estimated Curtailed Energy:	78.2 MWh
Percentage of Curtailed Energy	8.4%

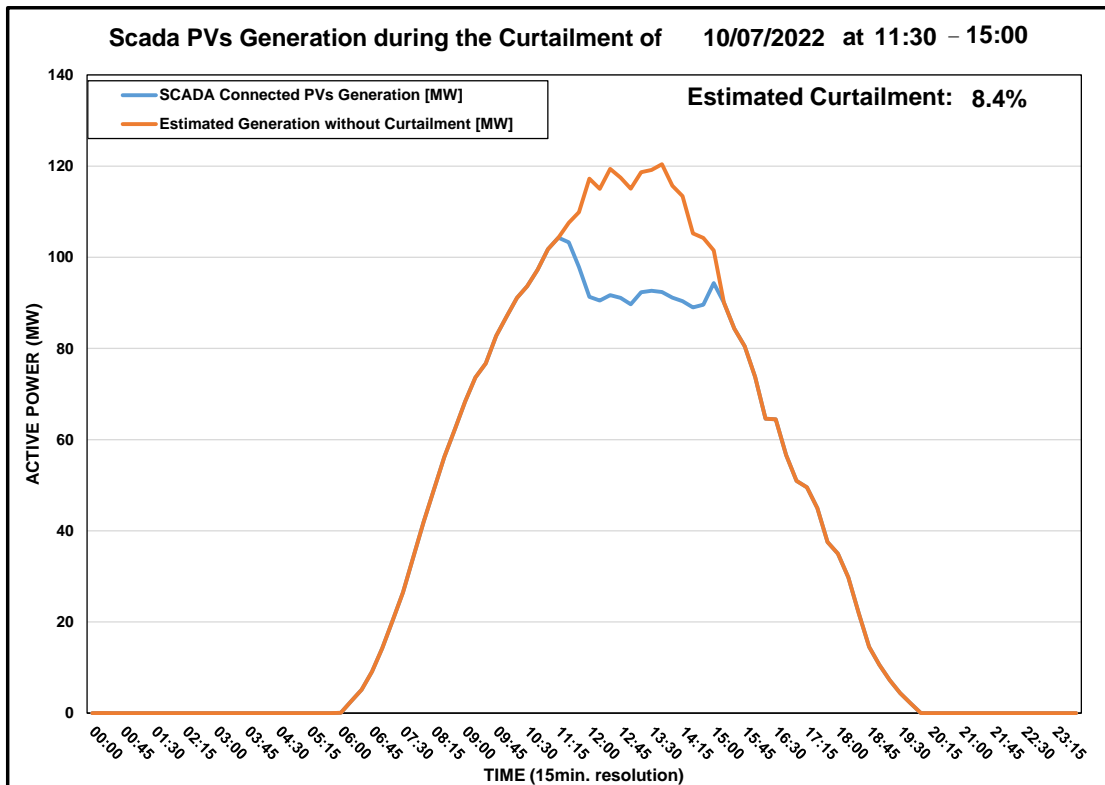


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	13/08/2022
Start of Curtailment	10:00
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1008.8 MWh
Total Estimated Curtailed Energy:	76.1 MWh
Percentage of Curtailed Energy	7.5%

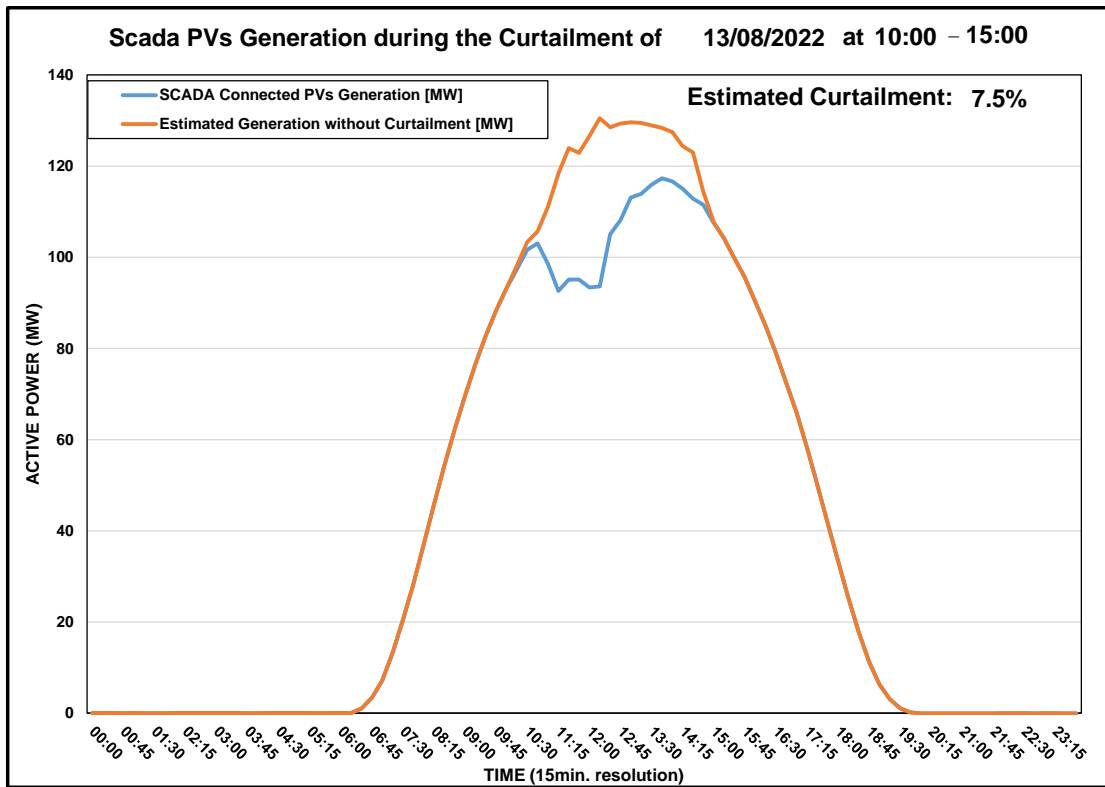


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	15/08/2022
Start of Curtailment	12:00
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	963.5 MWh
Total Estimated Curtailed Energy:	121.2 MWh
Percentage of Curtailed Energy	12.6%

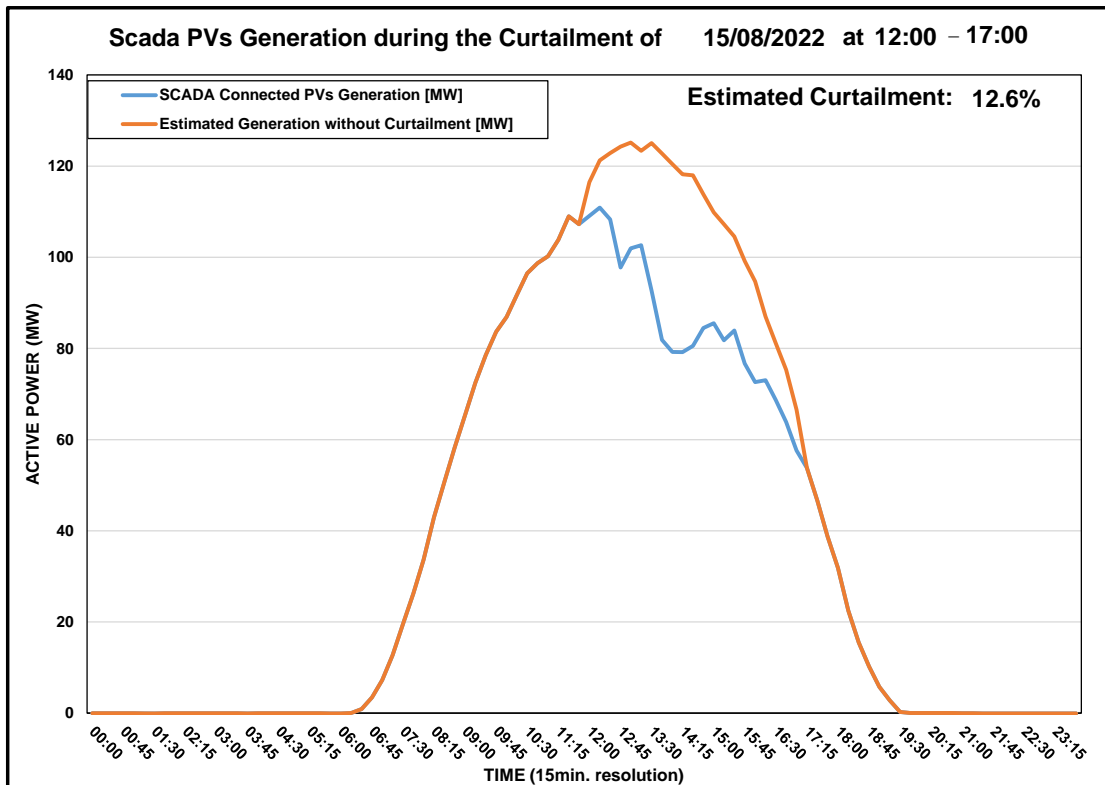


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	28/08/2022
Start of Curtailment	09:45
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	949.9 MWh
Total Estimated Curtailed Energy:	67.3 MWh
Percentage of Curtailed Energy	7.1%

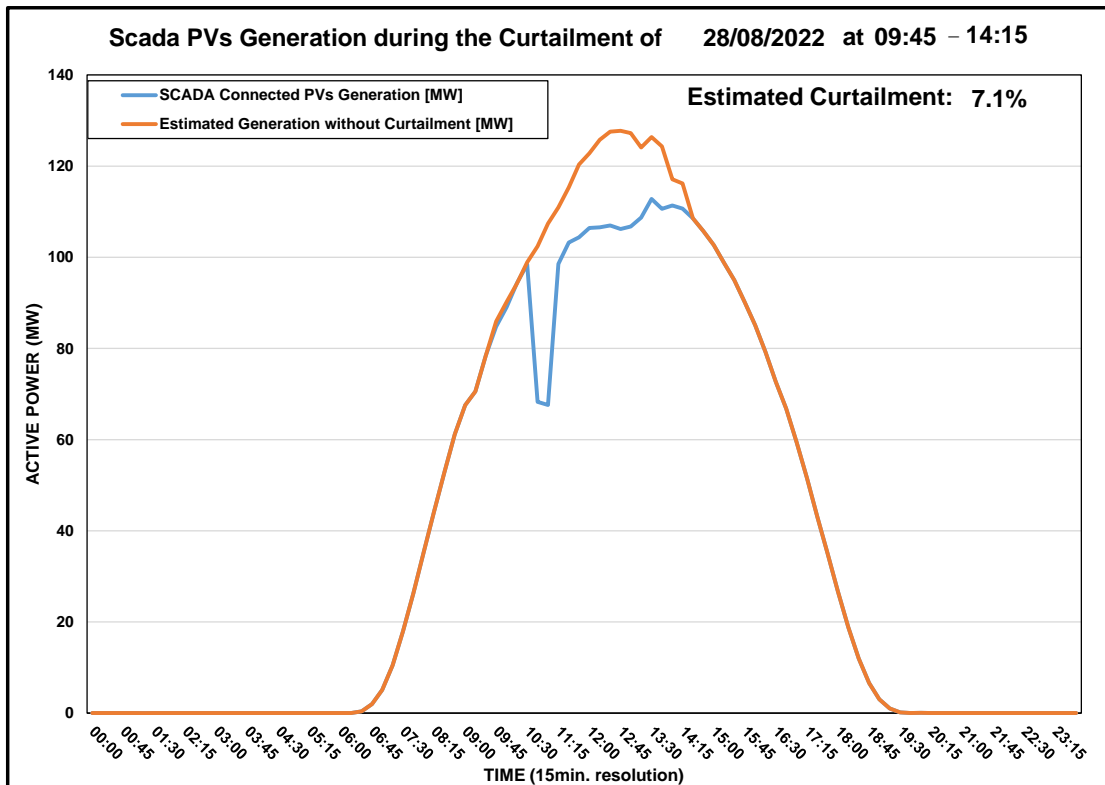


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	21/09/2022
Start of Curtailment	12:00
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	936 MWh
Total Estimated Curtailed Energy:	84.9 MWh
Percentage of Curtailed Energy	9.1%

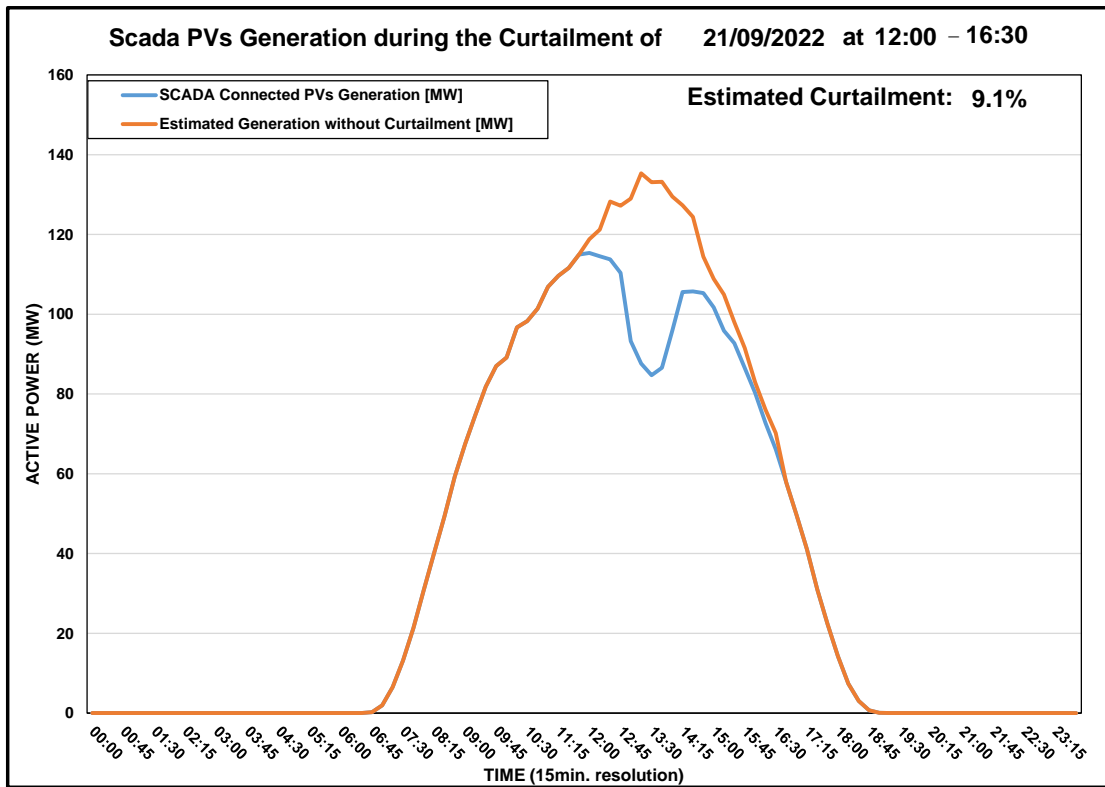


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	22/09/2022
Start of Curtailment	13:00
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	940 MWh
Total Estimated Curtailed Energy:	19.3 MWh
Percentage of Curtailed Energy	2.1%

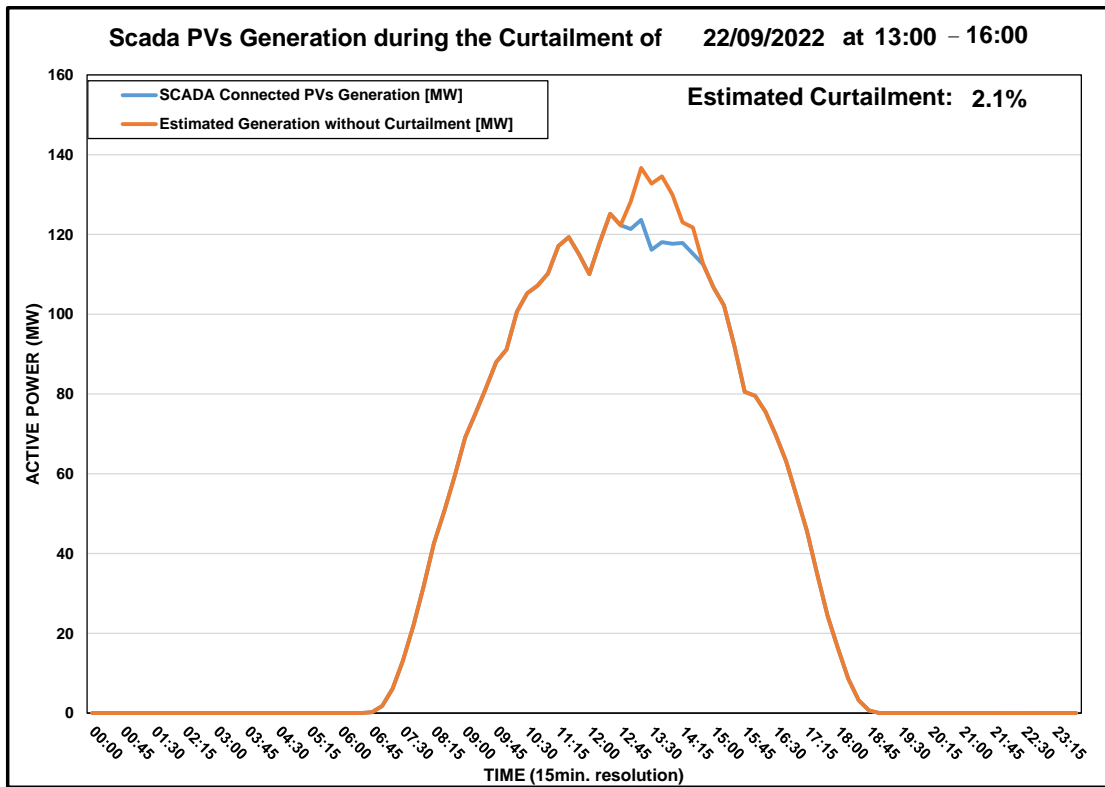


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	23/09/2022
Start of Curtailment	11:15
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	981.1 MWh
Total Estimated Curtailed Energy:	117.4 MWh
Percentage of Curtailed Energy	12.0%

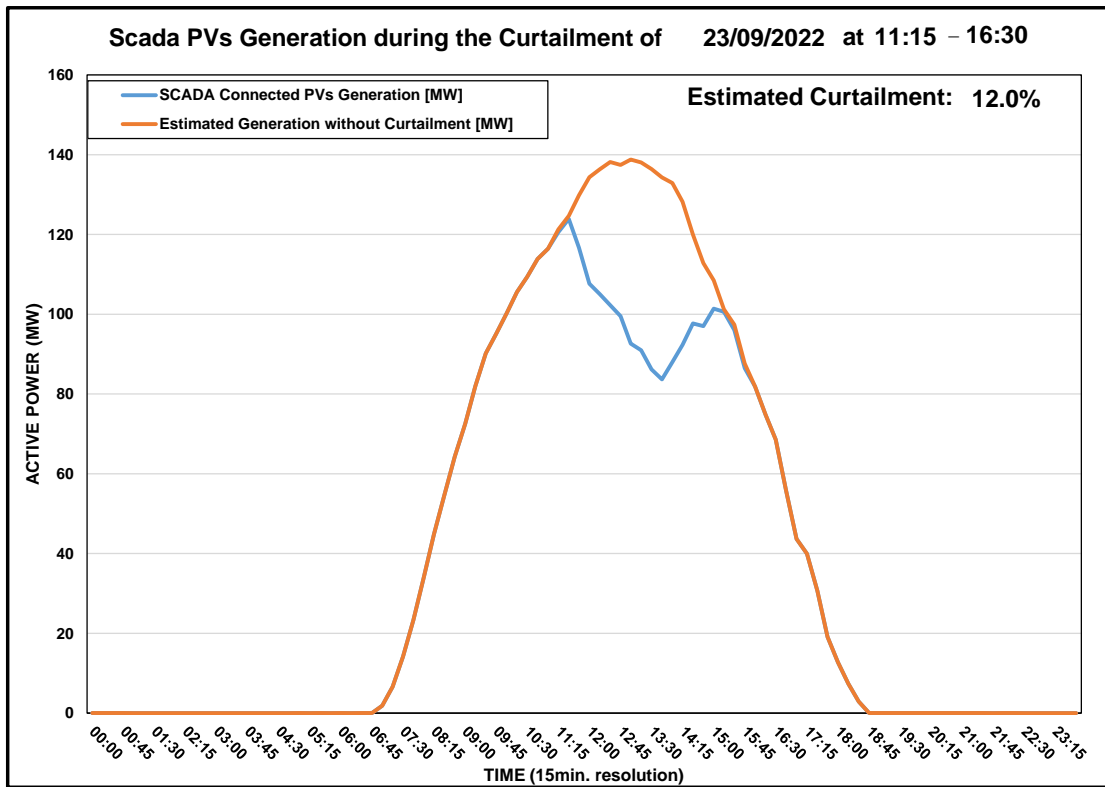


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	24/09/2022
Start of Curtailment	09:45
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	977.6 MWh
Total Estimated Curtailed Energy:	144.4 MWh
Percentage of Curtailed Energy	14.8%

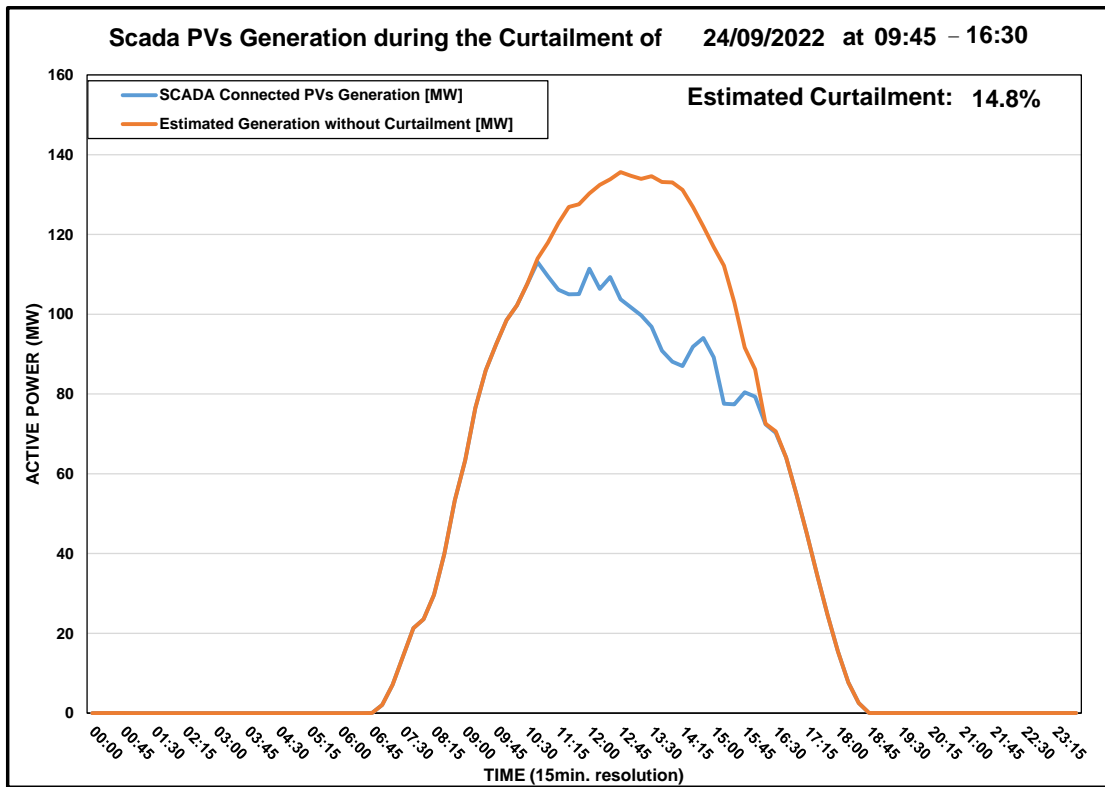


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	25/09/2022
Start of Curtailment	09:00
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1012.9 MWh
Total Estimated Curtailed Energy:	245.6 MWh
Percentage of Curtailed Energy	24.2%

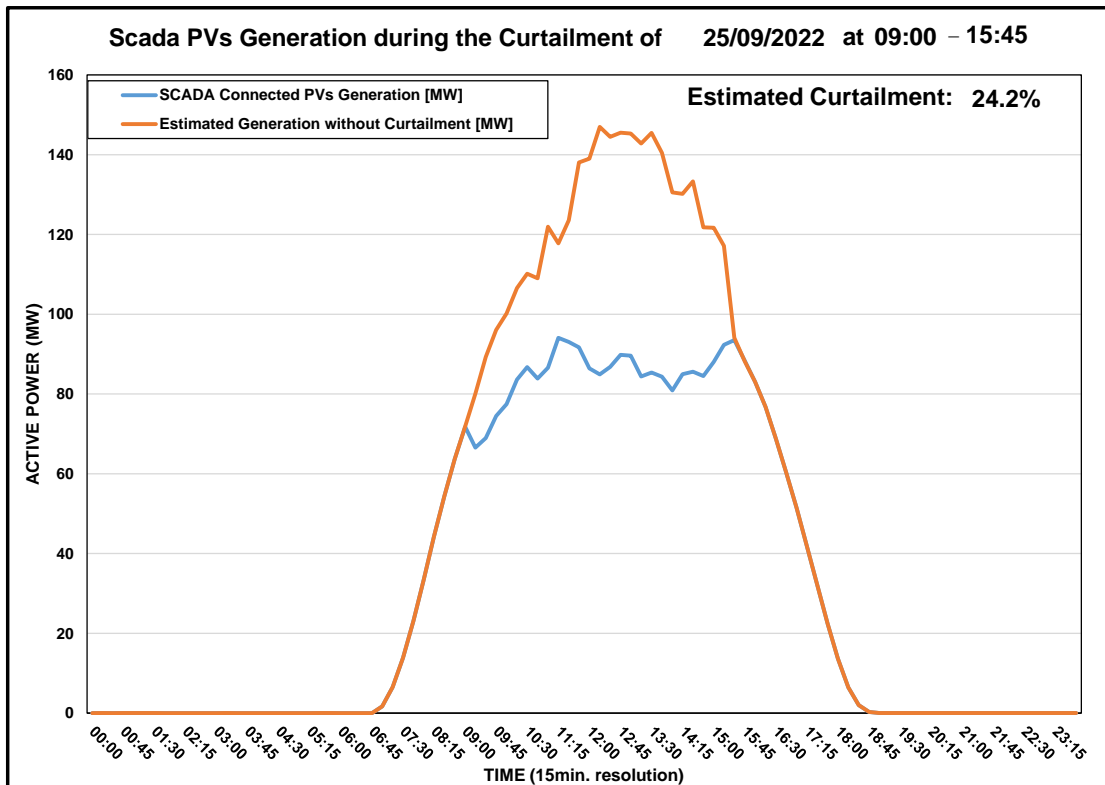


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	28/09/2022
Start of Curtailment	13:45
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	810.8 MWh
Total Estimated Curtailed Energy:	1.6 MWh
Percentage of Curtailed Energy	0.2%

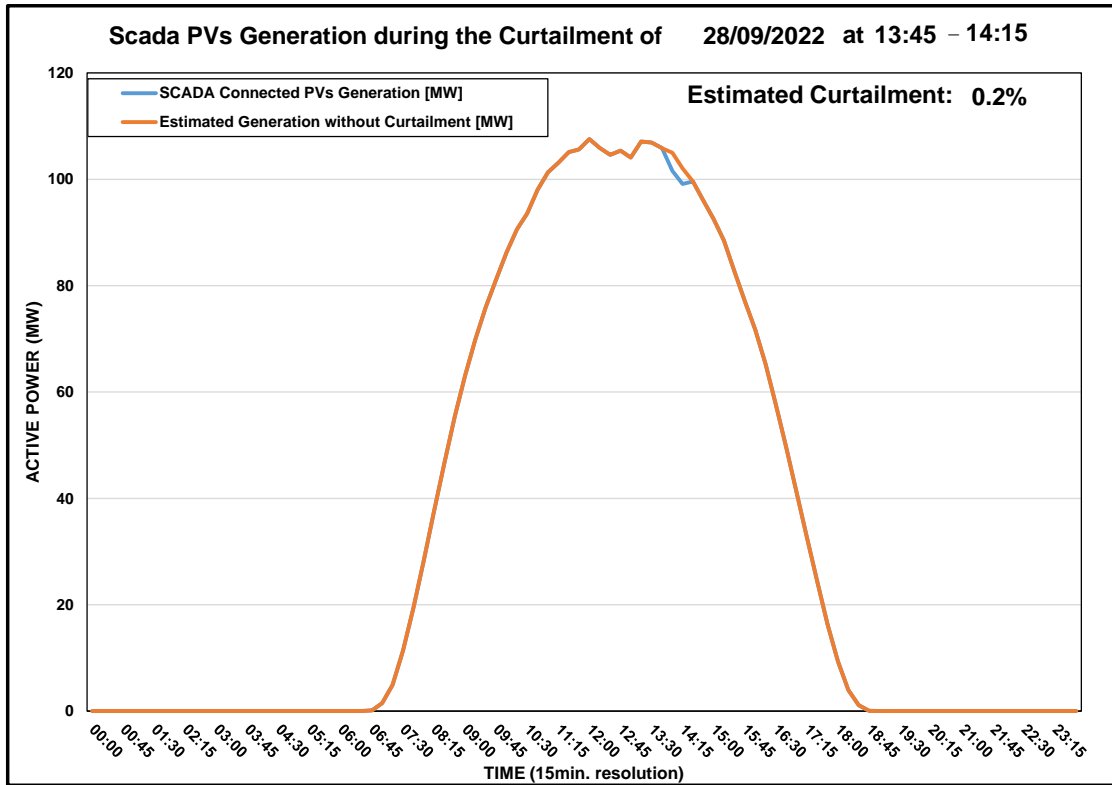


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	07/10/2022
Start of Curtailment	12:45
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	768.6 MWh
Total Estimated Curtailed Energy:	28.3 MWh
Percentage of Curtailed Energy	3.7%

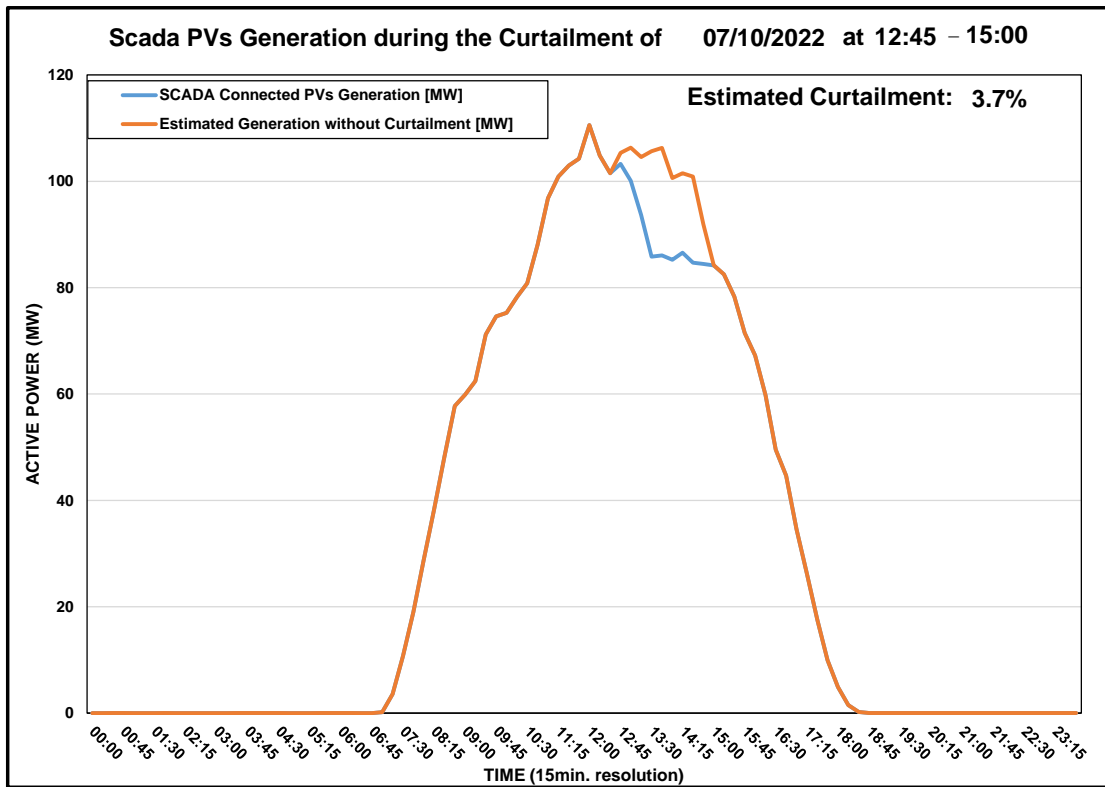


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	08/10/2022
Start of Curtailment	09:30
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	846.2 MWh
Total Estimated Curtailed Energy:	325.7 MWh
Percentage of Curtailed Energy	38.5%

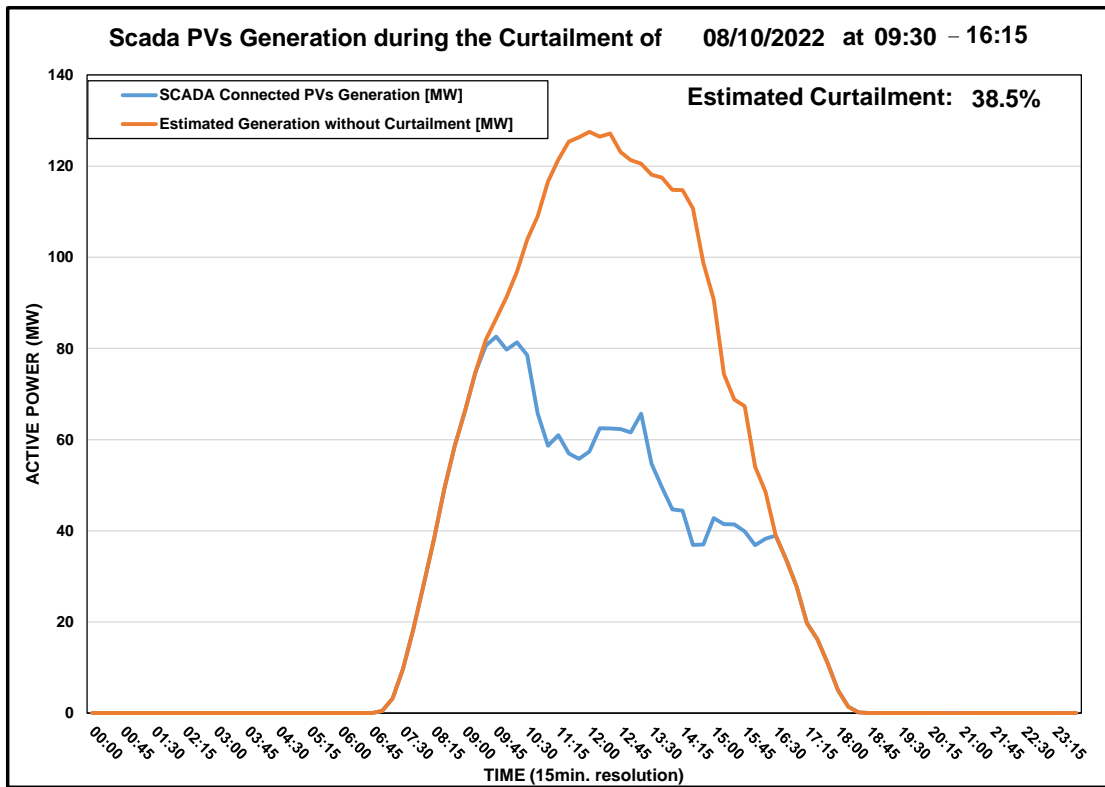


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	09/10/2022
Start of Curtailment	09:45
End of Curtailment	16:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	841.2 MWh
Total Estimated Curtailed Energy:	269.1 MWh
Percentage of Curtailed Energy	32.0%

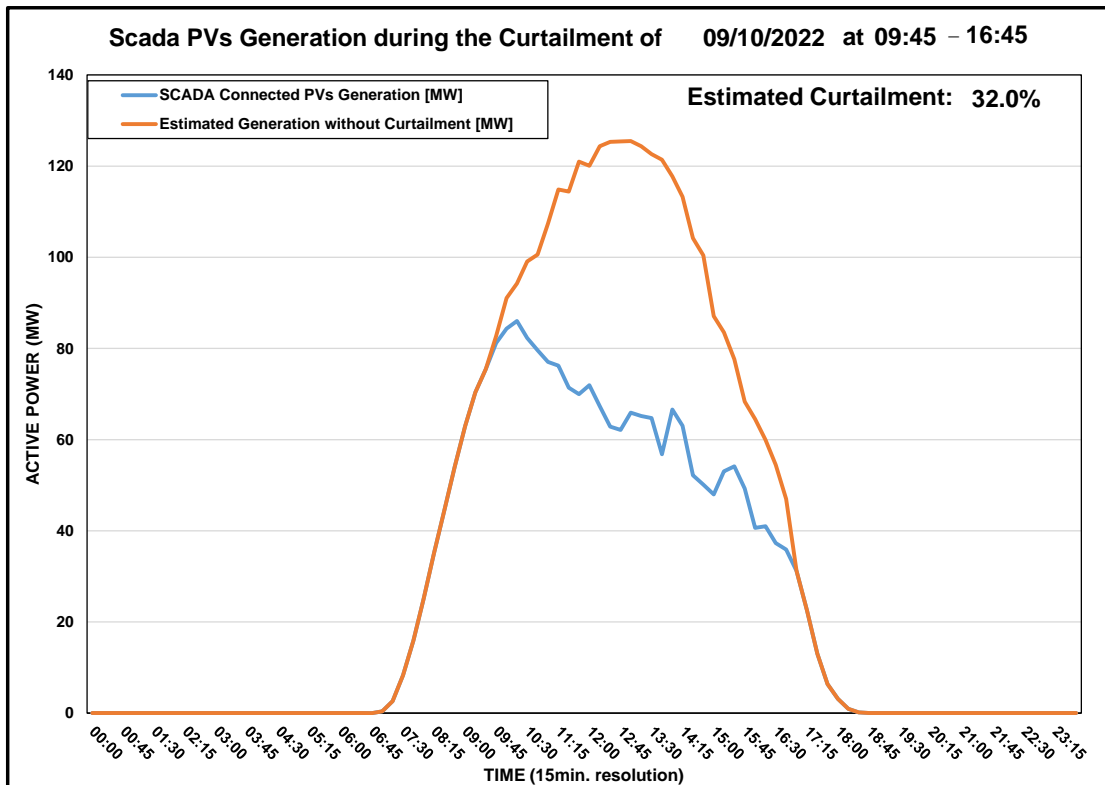


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	13/10/2022
Start of Curtailment	12:15
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	897.1 MWh
Total Estimated Curtailed Energy:	54.4 MWh
Percentage of Curtailed Energy	6.1%

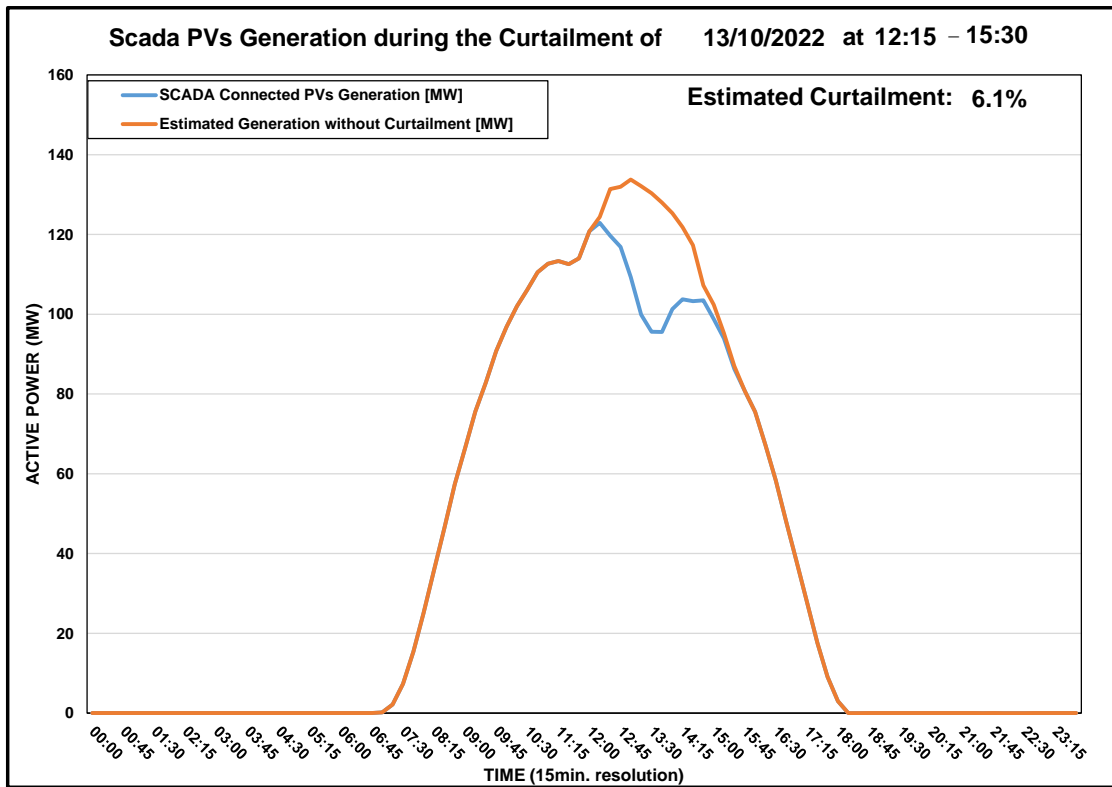


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	15/10/2022
Start of Curtailment	11:45
End of Curtailment	12:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	709.5 MWh
Total Estimated Curtailed Energy:	11.3 MWh
Percentage of Curtailed Energy	1.6%

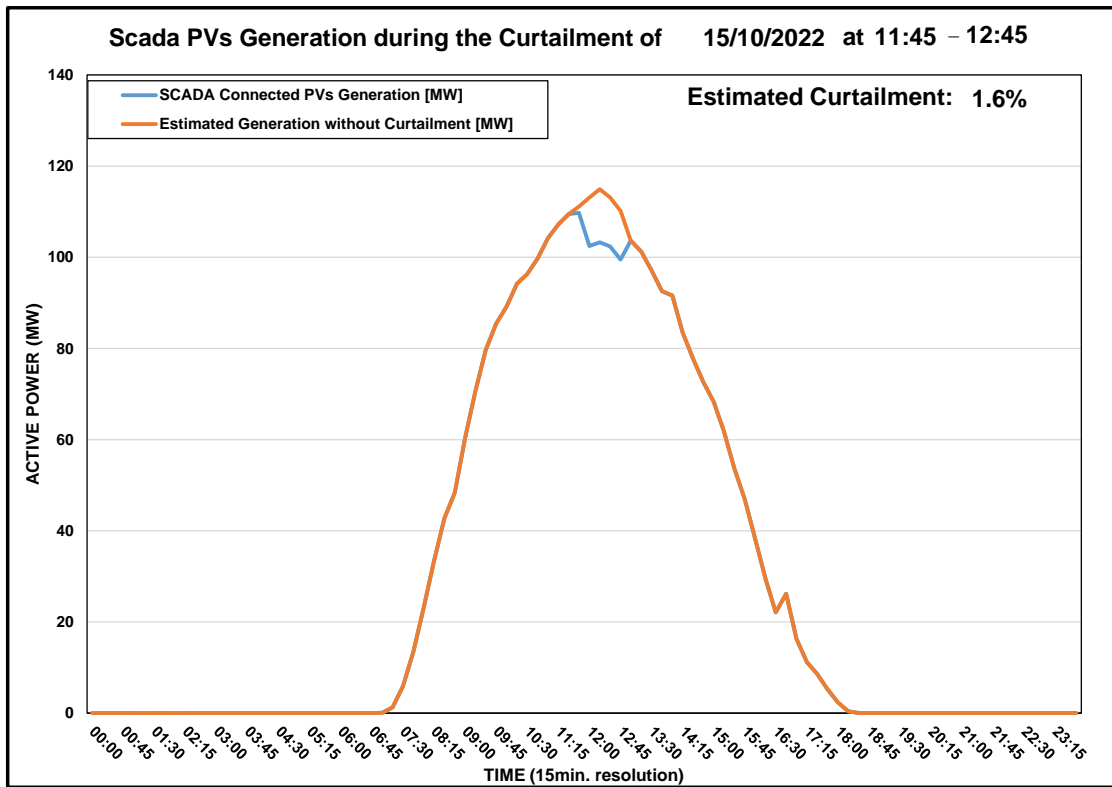


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	18/10/2022
Start of Curtailment	10:30
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	787.5 MWh
Total Estimated Curtailed Energy:	218.8 MWh
Percentage of Curtailed Energy	27.8%

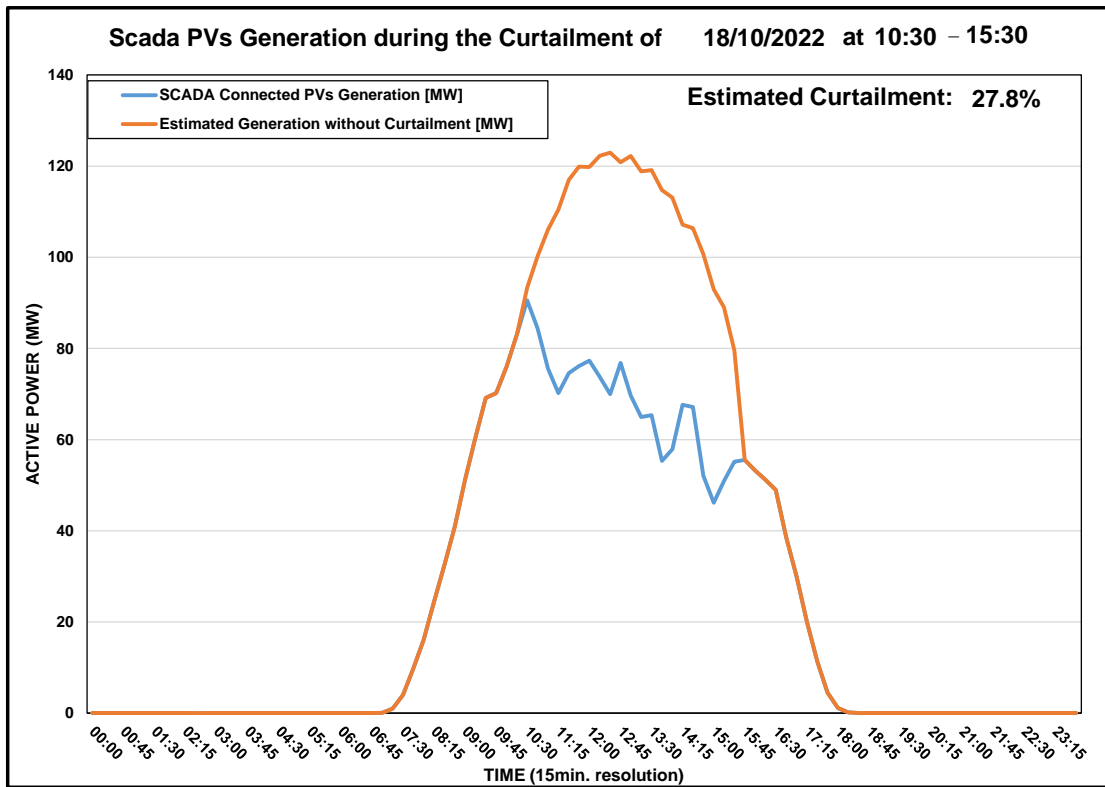


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	20/10/2022
Start of Curtailment	13:00
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	502.6 MWh
Total Estimated Curtailed Energy:	18.1 MWh
Percentage of Curtailed Energy	3.6%

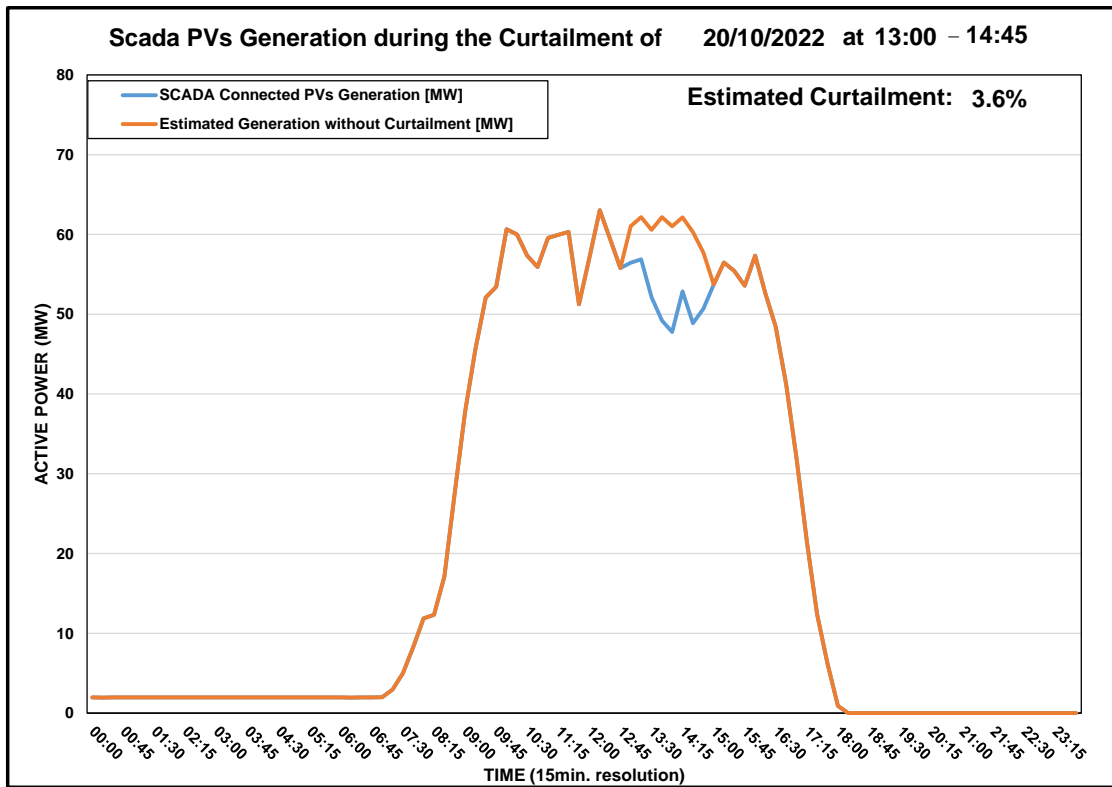


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	22/10/2022
Start of Curtailment	12:00
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	883.8 MWh
Total Estimated Curtailed Energy:	31.2 MWh
Percentage of Curtailed Energy	3.5%

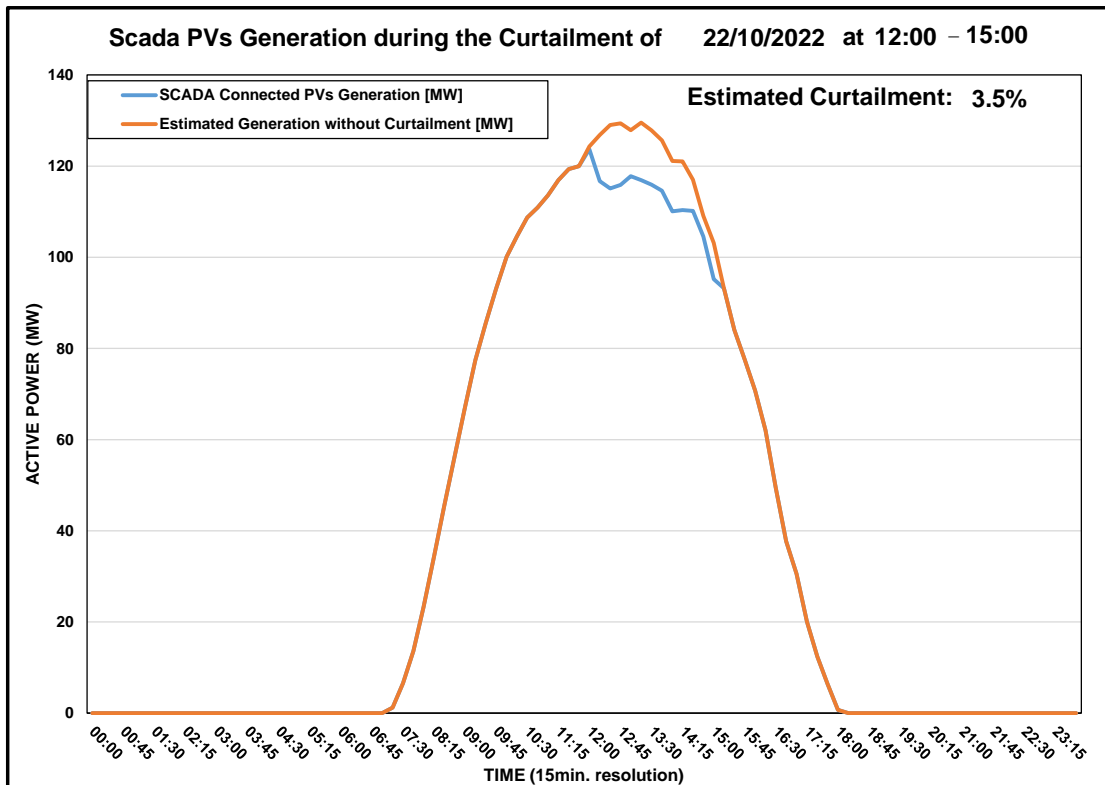


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	23/10/2022
Start of Curtailment	10:15
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	919.6 MWh
Total Estimated Curtailed Energy:	97.6 MWh
Percentage of Curtailed Energy	10.6%

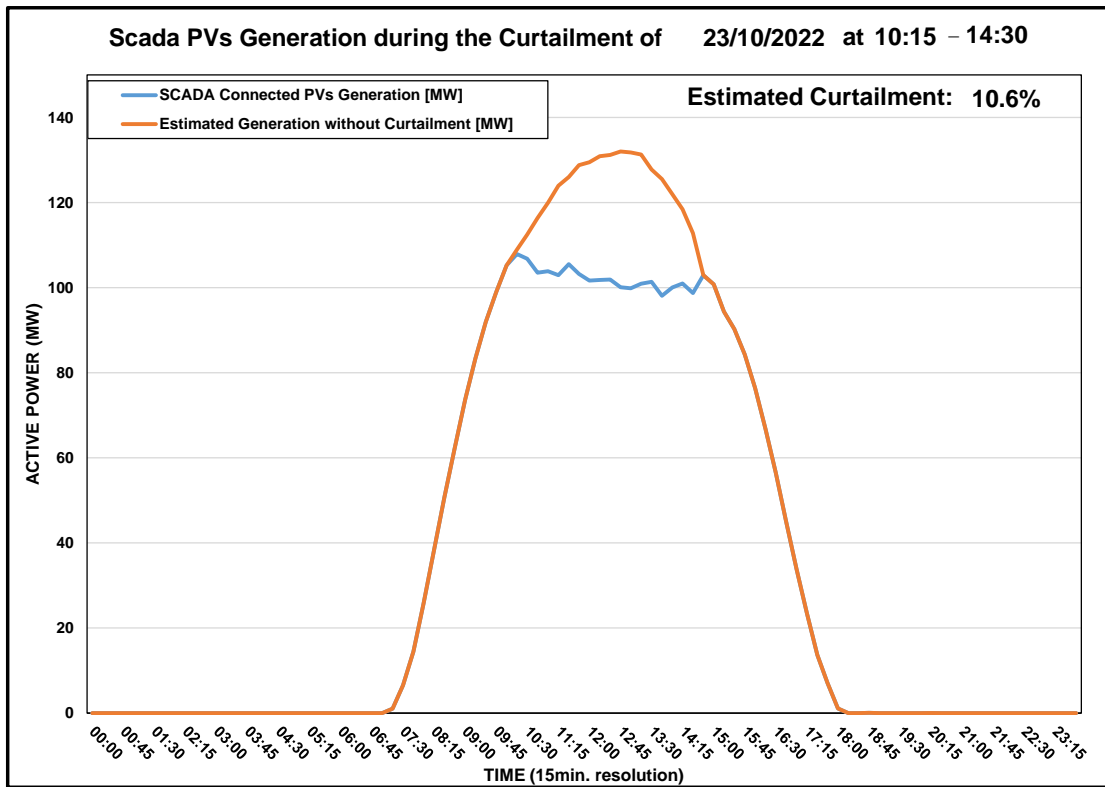


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	24/10/2022
Start of Curtailment	10:30
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	900.7 MWh
Total Estimated Curtailed Energy:	71.7 MWh
Percentage of Curtailed Energy	8.0%

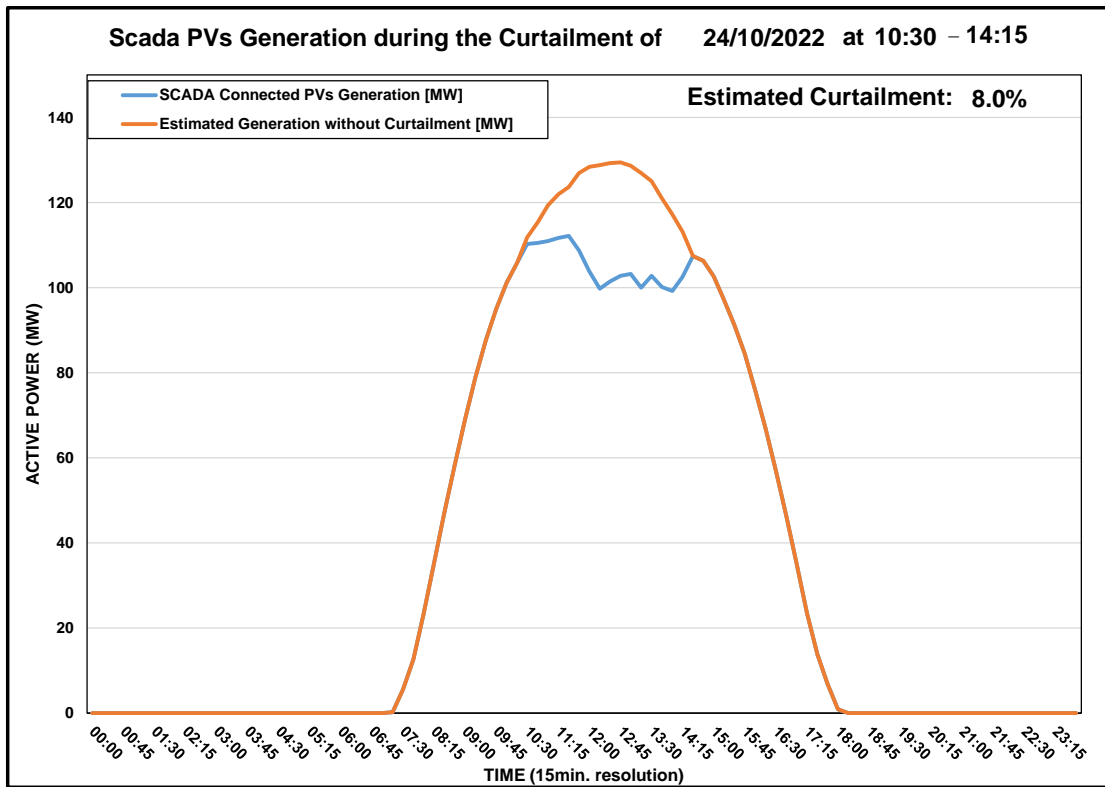


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	25/10/2022
Start of Curtailment	11:00
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	830.6 MWh
Total Estimated Curtailed Energy:	37.4 MWh
Percentage of Curtailed Energy	4.5%

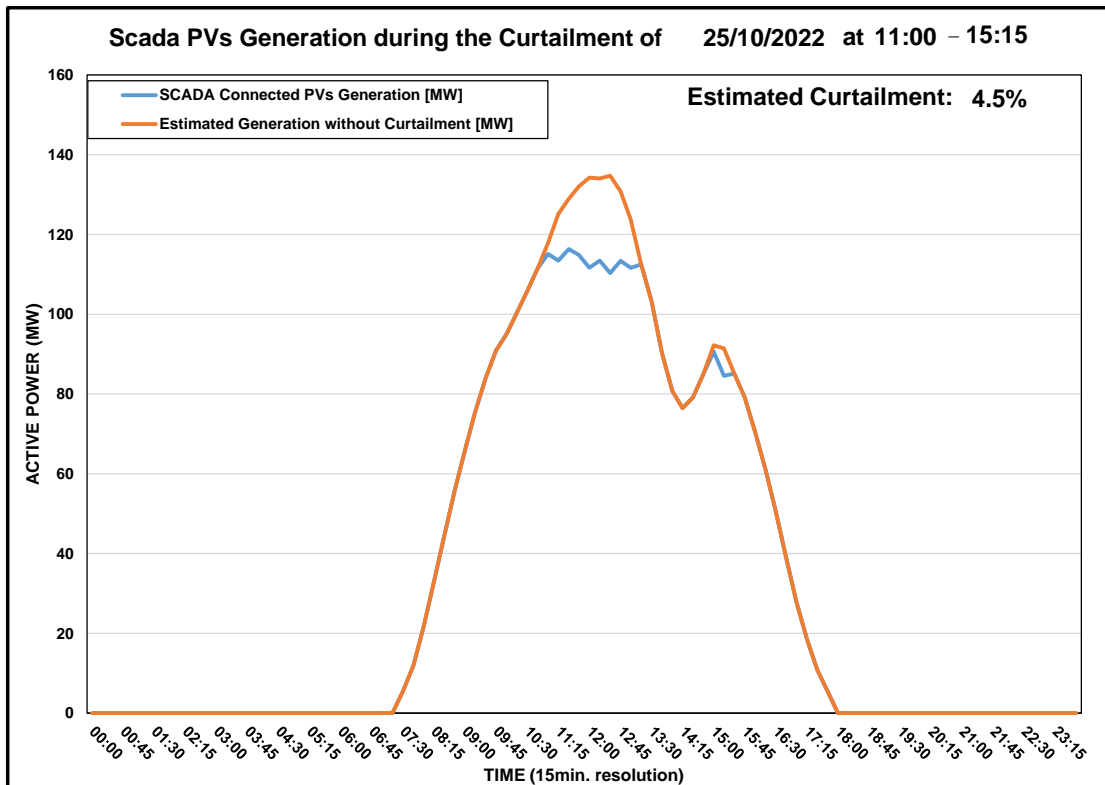


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	28/10/2022
Start of Curtailment	11:45
End of Curtailment	12:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	831.8 MWh
Total Estimated Curtailed Energy:	3.2 MWh
Percentage of Curtailed Energy	0.4%

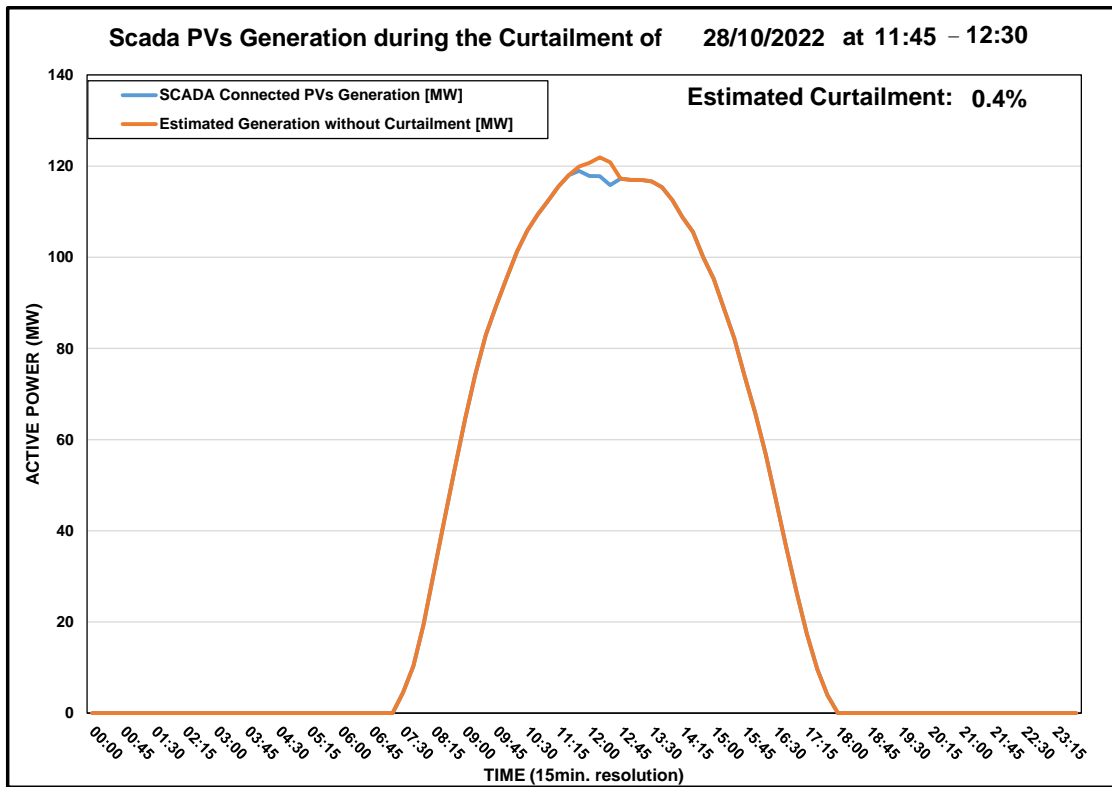


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	29/10/2022
Start of Curtailment	11:15
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	830 MWh
Total Estimated Curtailed Energy:	15.1 MWh
Percentage of Curtailed Energy	1.8%

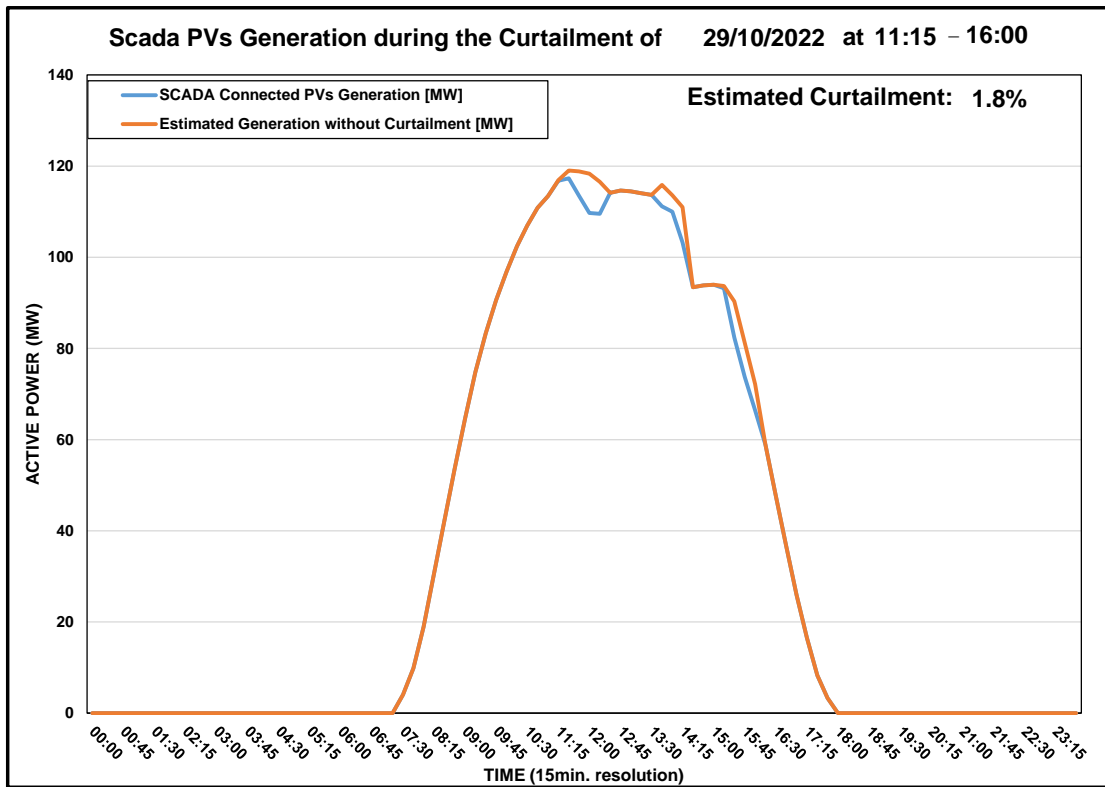


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	30/10/2022
Start of Curtailment	09:15
End of Curtailment	12:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	730.8 MWh
Total Estimated Curtailed Energy:	23.2 MWh
Percentage of Curtailed Energy	3.2%

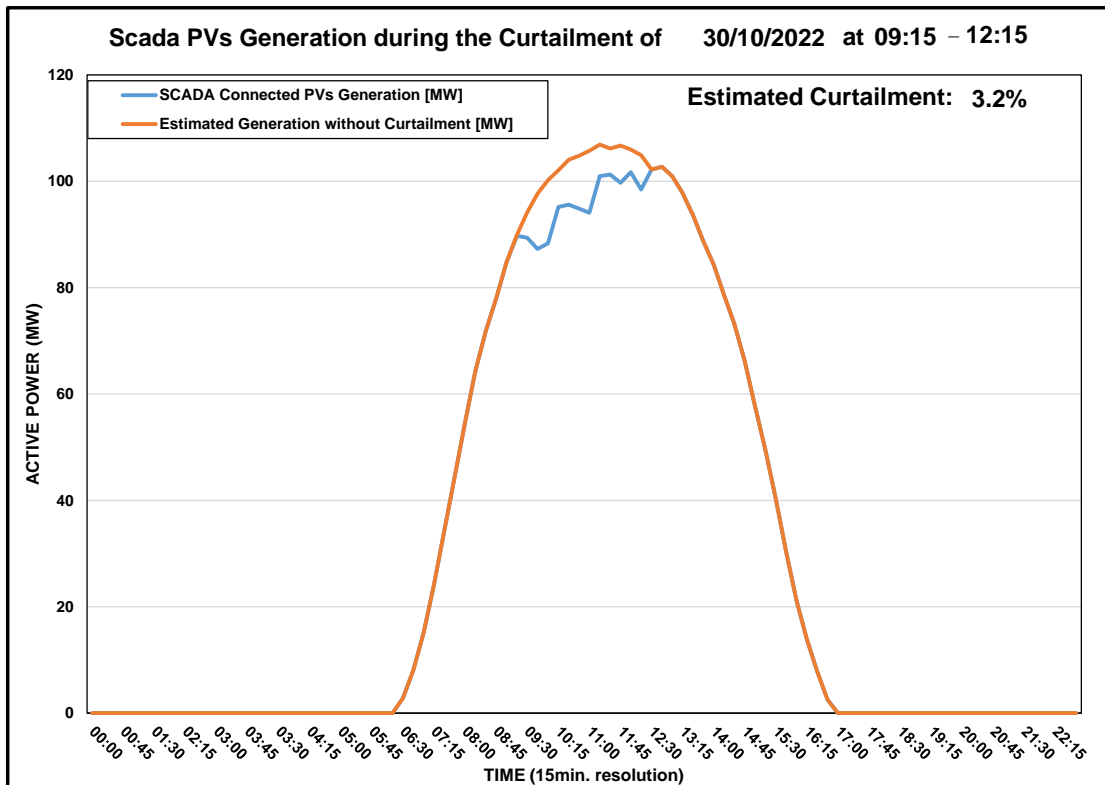


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	02/11/2022
Start of Curtailment	10:30
End of Curtailment	11:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	817 MWh
Total Estimated Curtailed Energy:	7.1 MWh
Percentage of Curtailed Energy	0.9%

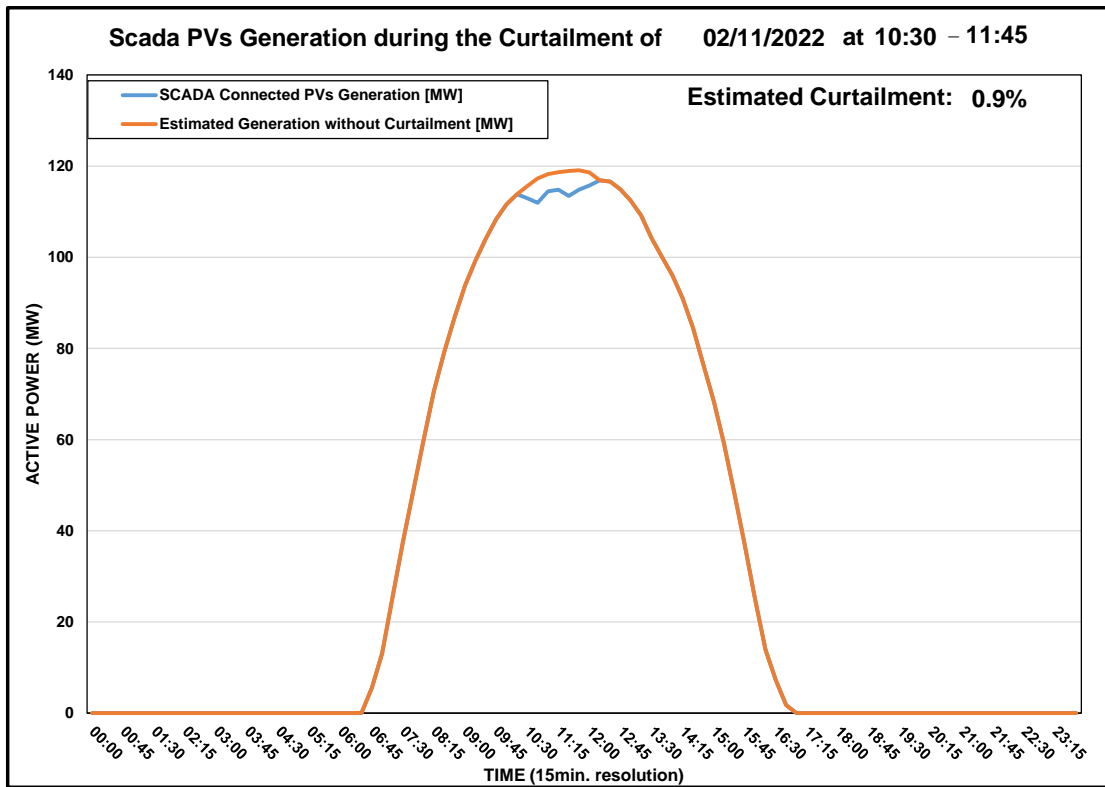


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	03/11/2022
Start of Curtailment	09:45
End of Curtailment	12:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	859.3 MWh
Total Estimated Curtailed Energy:	30.6 MWh
Percentage of Curtailed Energy	3.6%

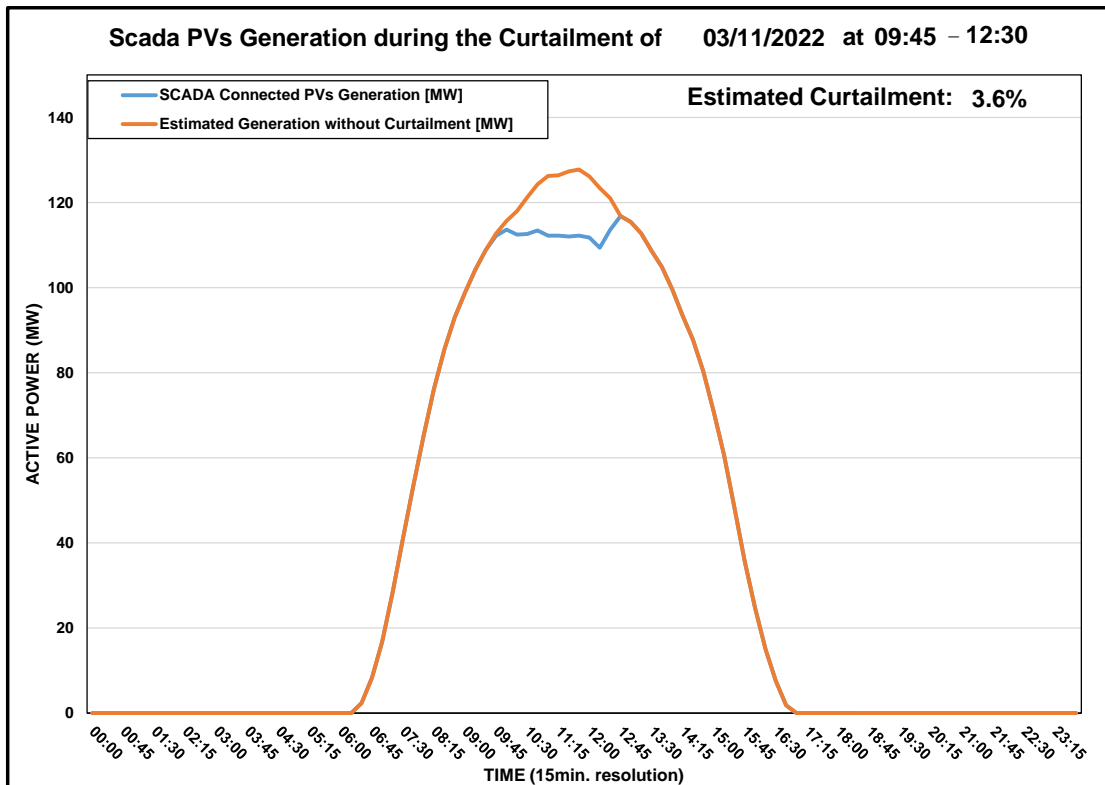


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	05/11/2022
Start of Curtailment	10:45
End of Curtailment	12:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	822.7 MWh
Total Estimated Curtailed Energy:	8.3 MWh
Percentage of Curtailed Energy	1.0%

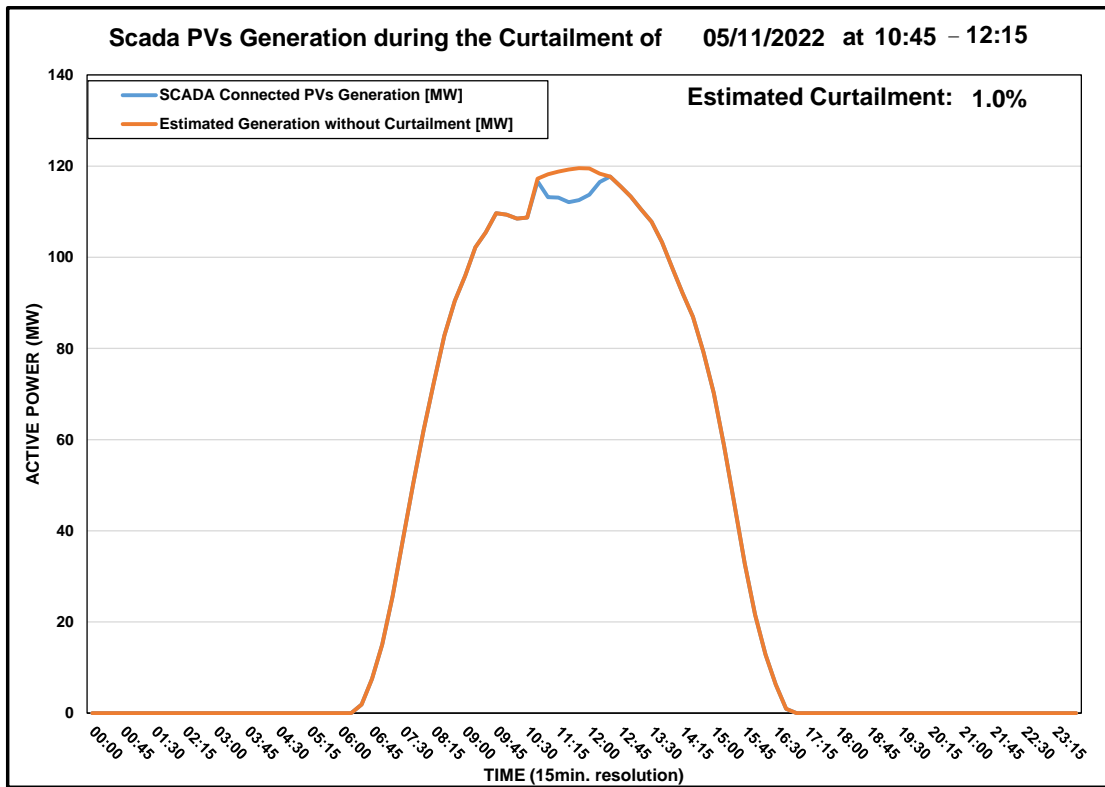


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	06/11/2022
Start of Curtailment	08:30
End of Curtailment	12:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	767.8 MWh
Total Estimated Curtailed Energy:	65.4 MWh
Percentage of Curtailed Energy	8.5%

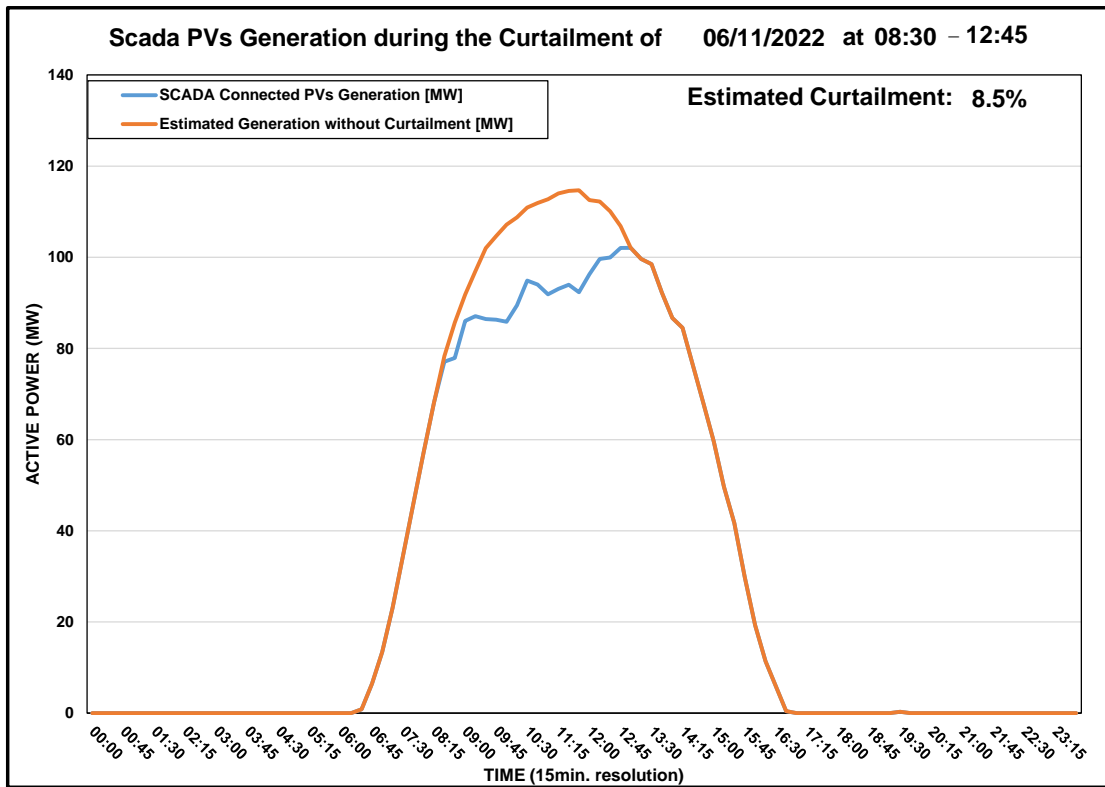


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	07/11/2022
Start of Curtailment	09:00
End of Curtailment	09:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	353.7 MWh
Total Estimated Curtailed Energy:	5.6 MWh
Percentage of Curtailed Energy	1.6%

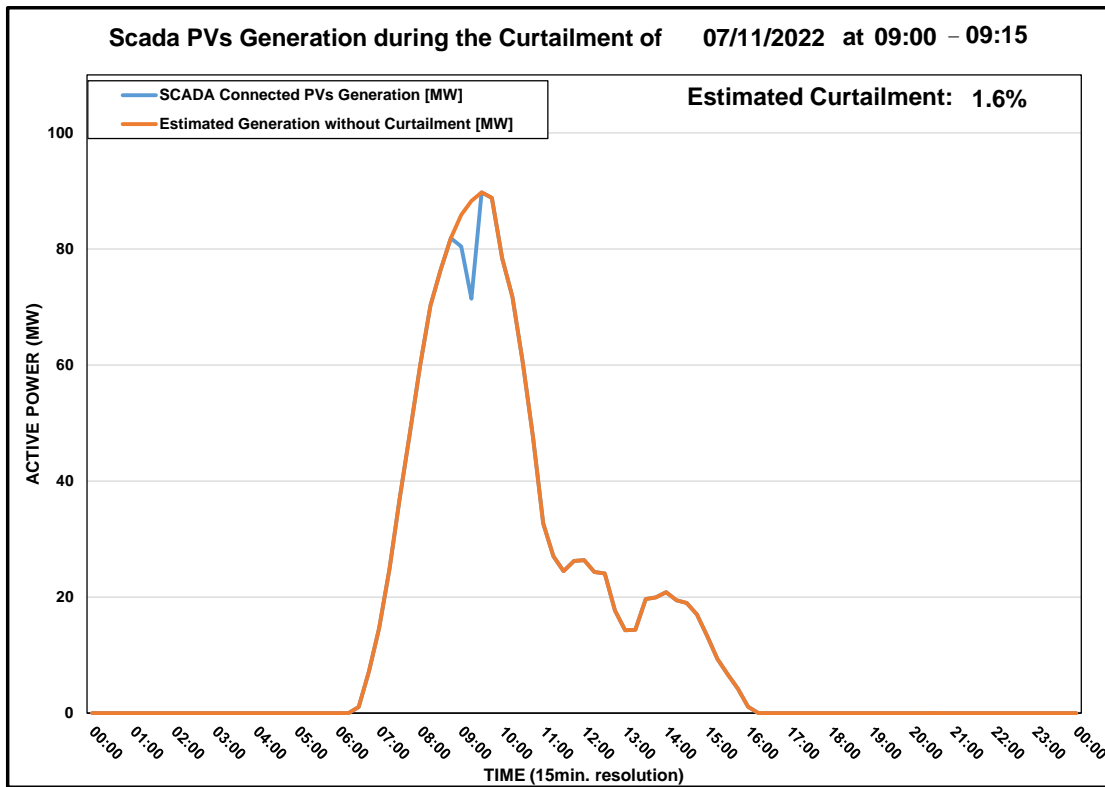


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	08/11/2022
Start of Curtailment	08:45
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	630.8 MWh
Total Estimated Curtailed Energy:	105.9 MWh
Percentage of Curtailed Energy	16.8%

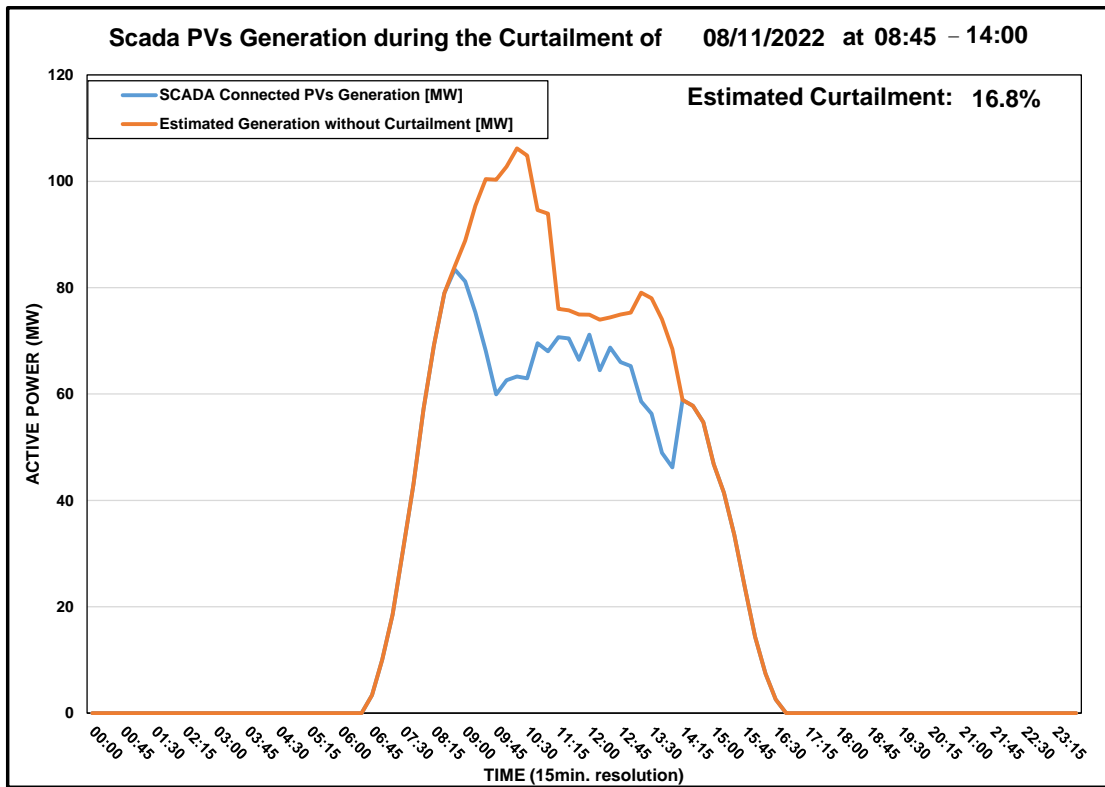


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	12/11/2022
Start of Curtailment	09:45
End of Curtailment	12:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	680.7 MWh
Total Estimated Curtailed Energy:	53.3 MWh
Percentage of Curtailed Energy	7.8%

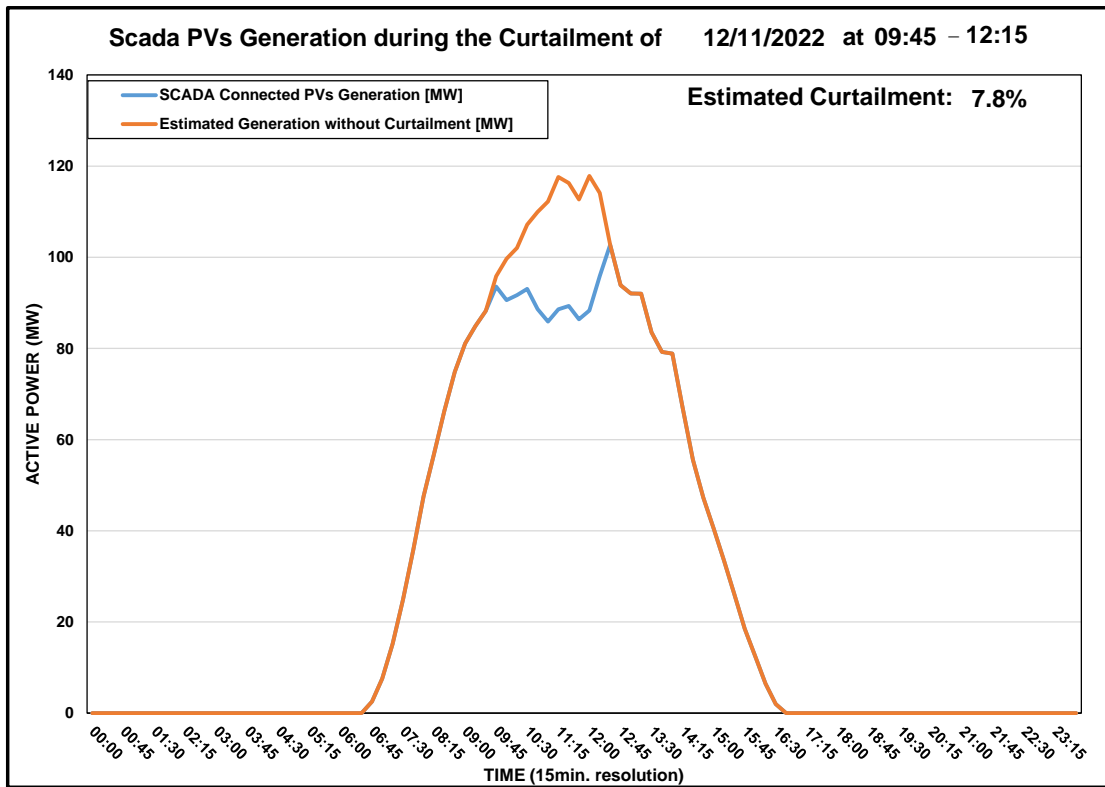


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	13/11/2022
Start of Curtailment	08:45
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	722.3 MWh
Total Estimated Curtailed Energy:	218.7 MWh
Percentage of Curtailed Energy	30.3%

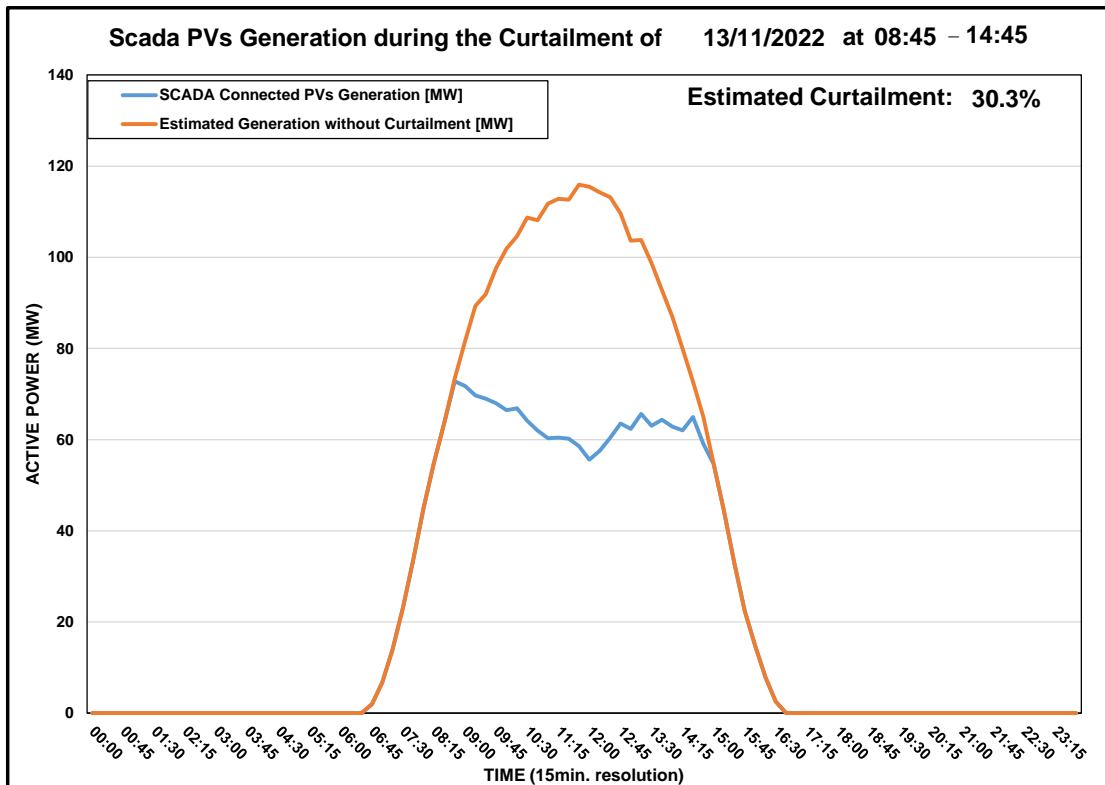


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	18/11/2022
Start of Curtailment	10:15
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	560.8 MWh
Total Estimated Curtailed Energy:	115.5 MWh
Percentage of Curtailed Energy	20.6%

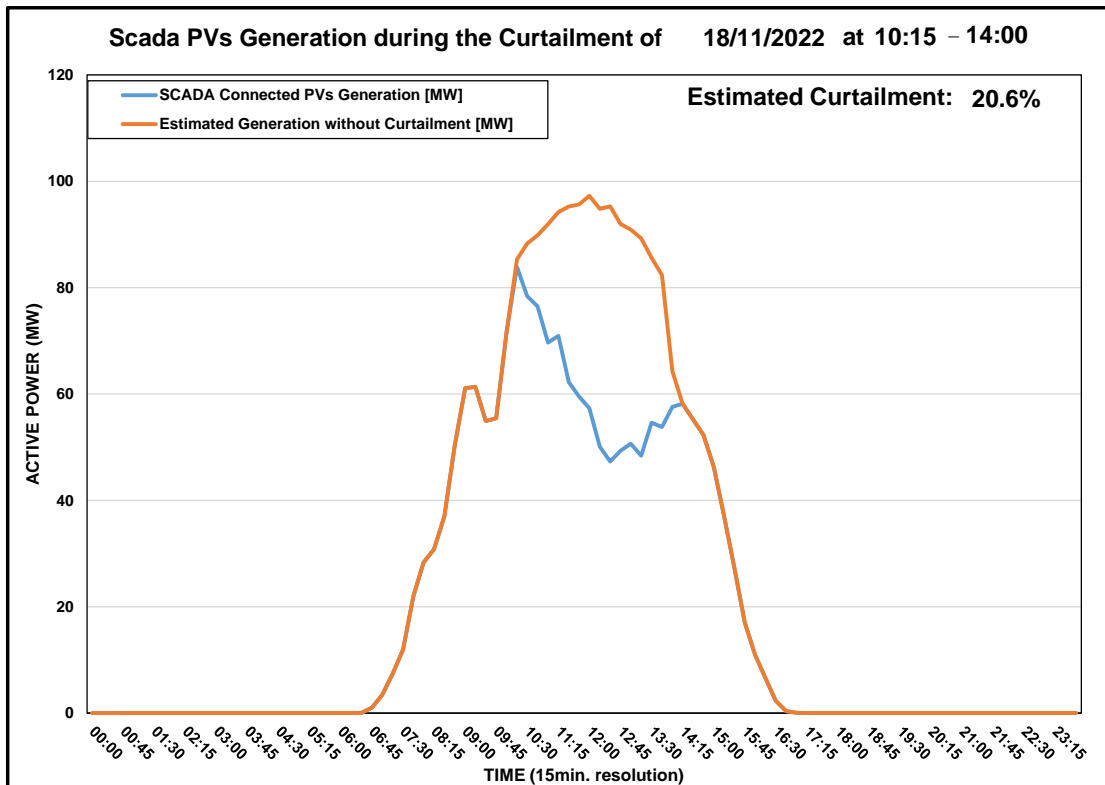


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	19/11/2022
Start of Curtailment	10:45
End of Curtailment	13:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	700.3 MWh
Total Estimated Curtailed Energy:	49.2 MWh
Percentage of Curtailed Energy	7.0%

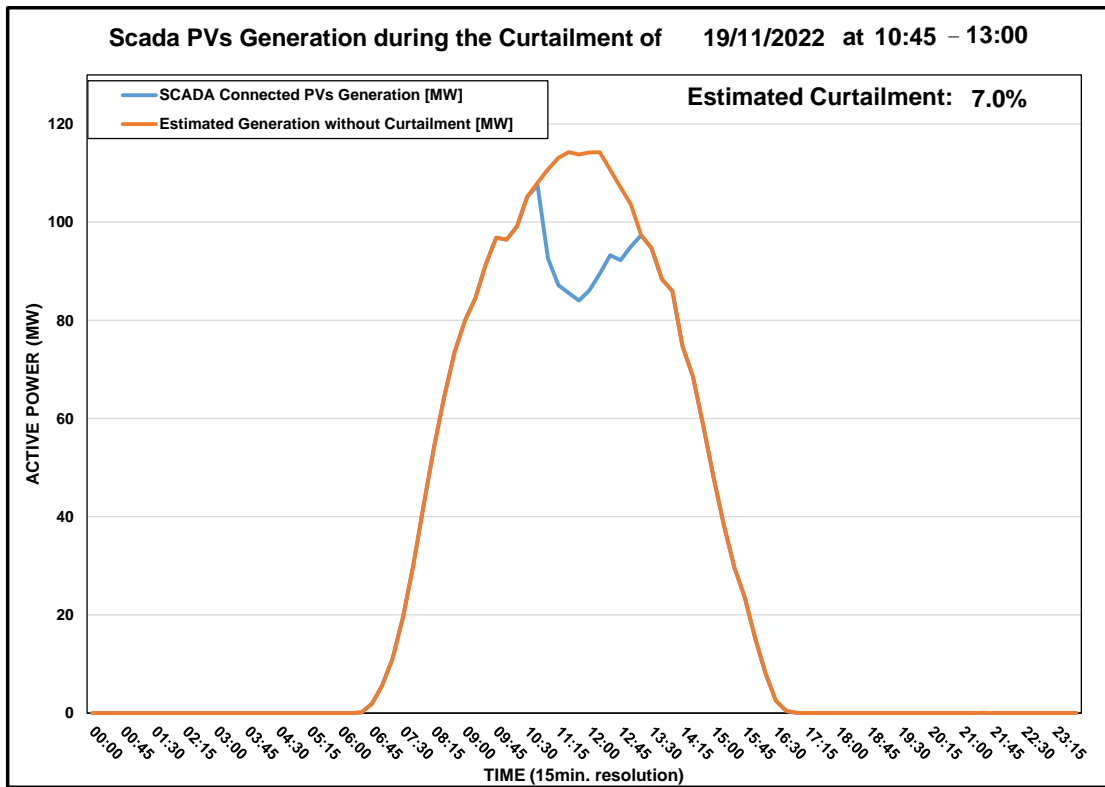


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	20/11/2022
Start of Curtailment	08:30
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	685 MWh
Total Estimated Curtailed Energy:	134.7 MWh
Percentage of Curtailed Energy	19.7%

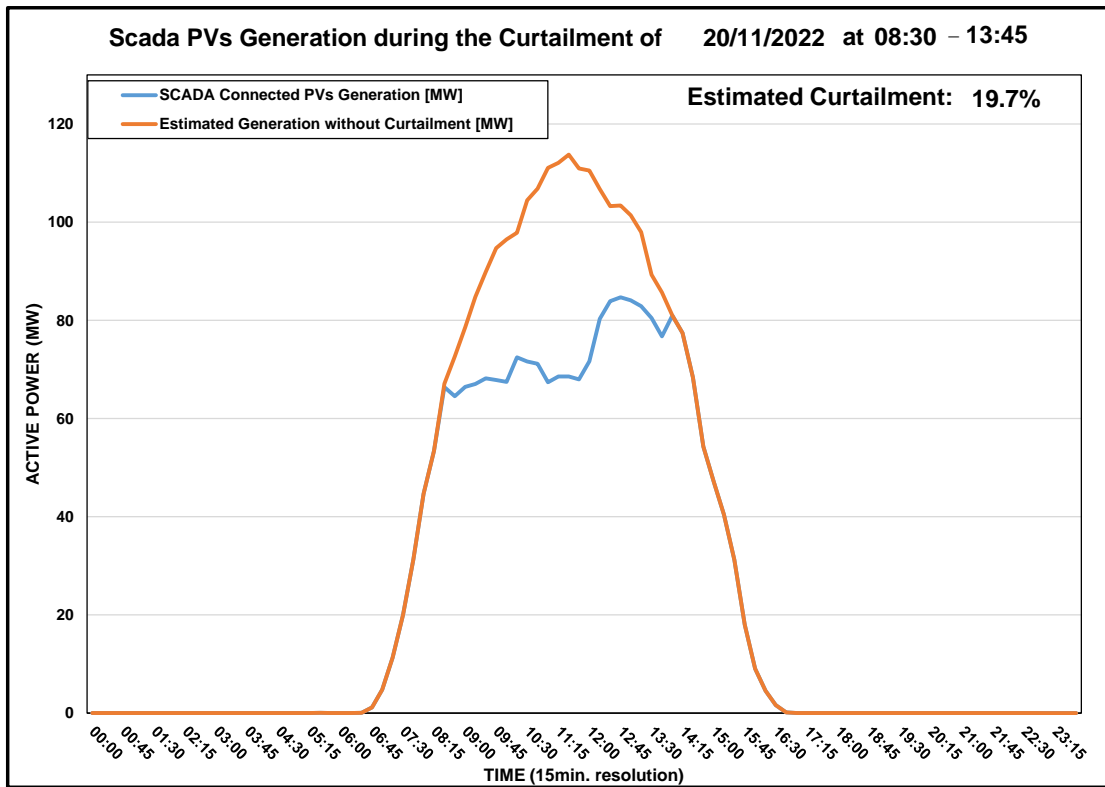


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	21/11/2022
Start of Curtailment	08:45
End of Curtailment	13:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	491 MWh
Total Estimated Curtailed Energy:	125 MWh
Percentage of Curtailed Energy	25.5%

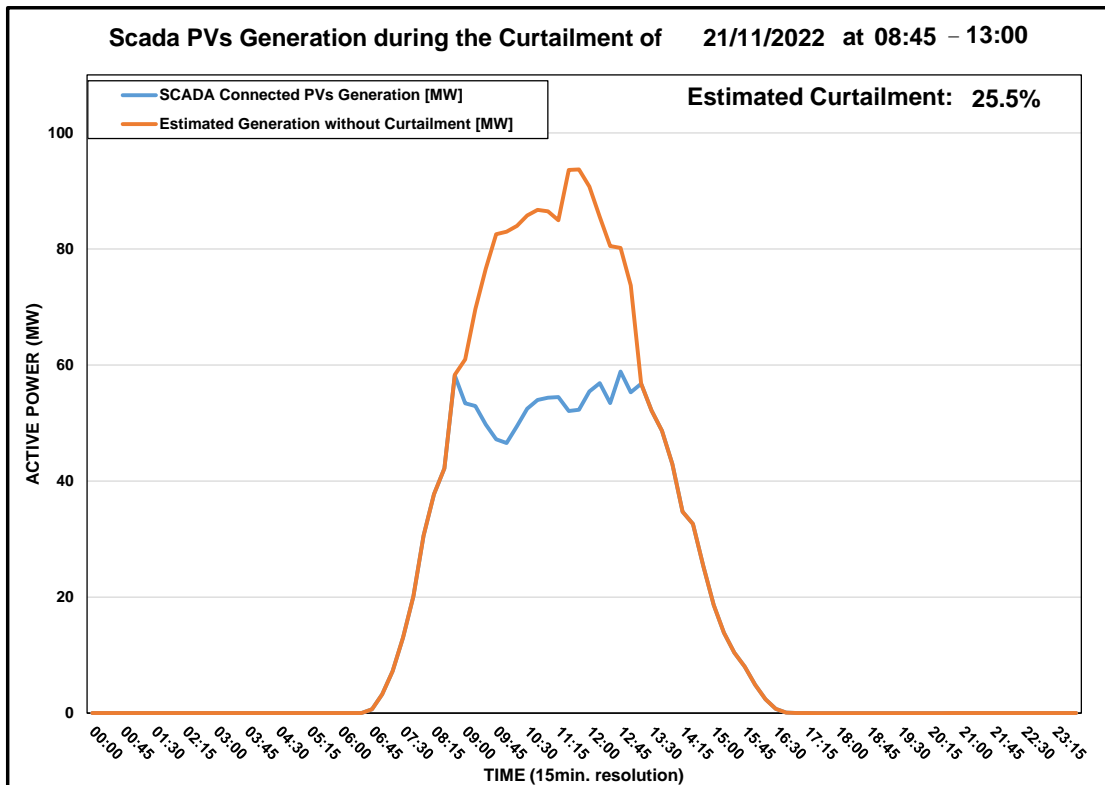


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	22/11/2022
Start of Curtailment	10:15
End of Curtailment	12:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	485.8 MWh
Total Estimated Curtailed Energy:	71.1 MWh
Percentage of Curtailed Energy	14.6%

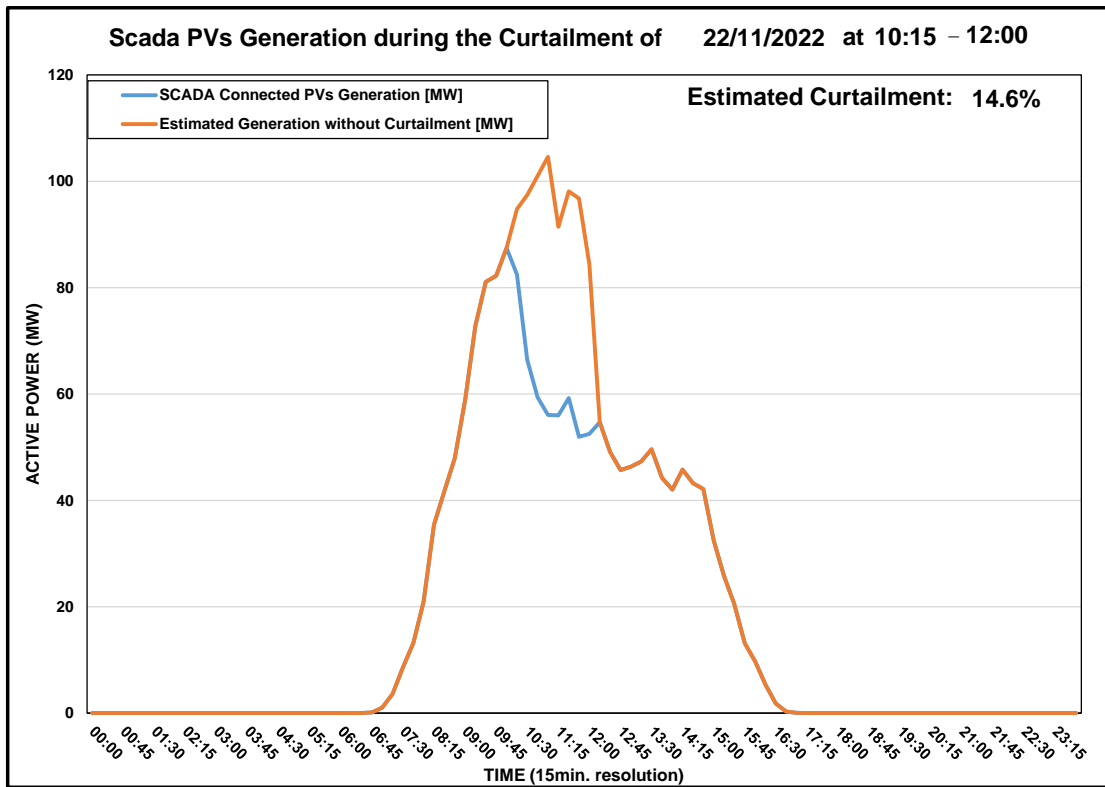


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	26/11/2022
Start of Curtailment	10:45
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	715.4 MWh
Total Estimated Curtailed Energy:	42.8 MWh
Percentage of Curtailed Energy	6.0%

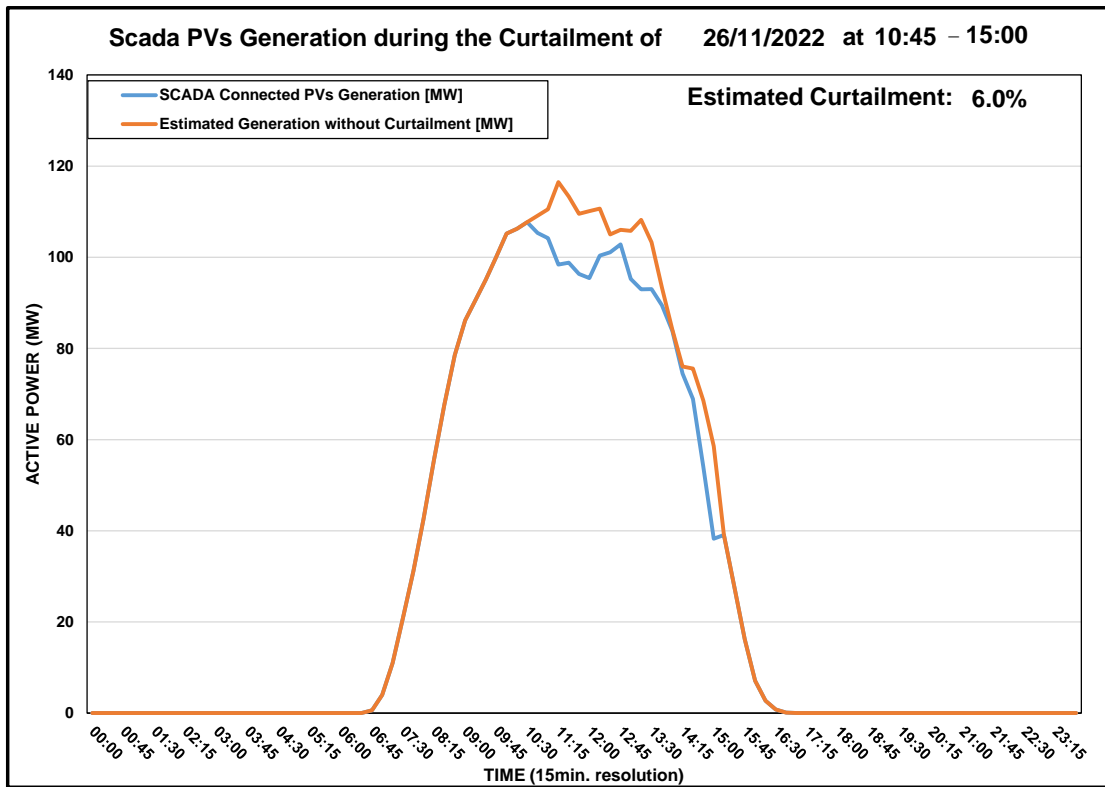


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	27/11/2022
Start of Curtailment	12:00
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	407.2 MWh
Total Estimated Curtailed Energy:	42.4 MWh
Percentage of Curtailed Energy	10.4%

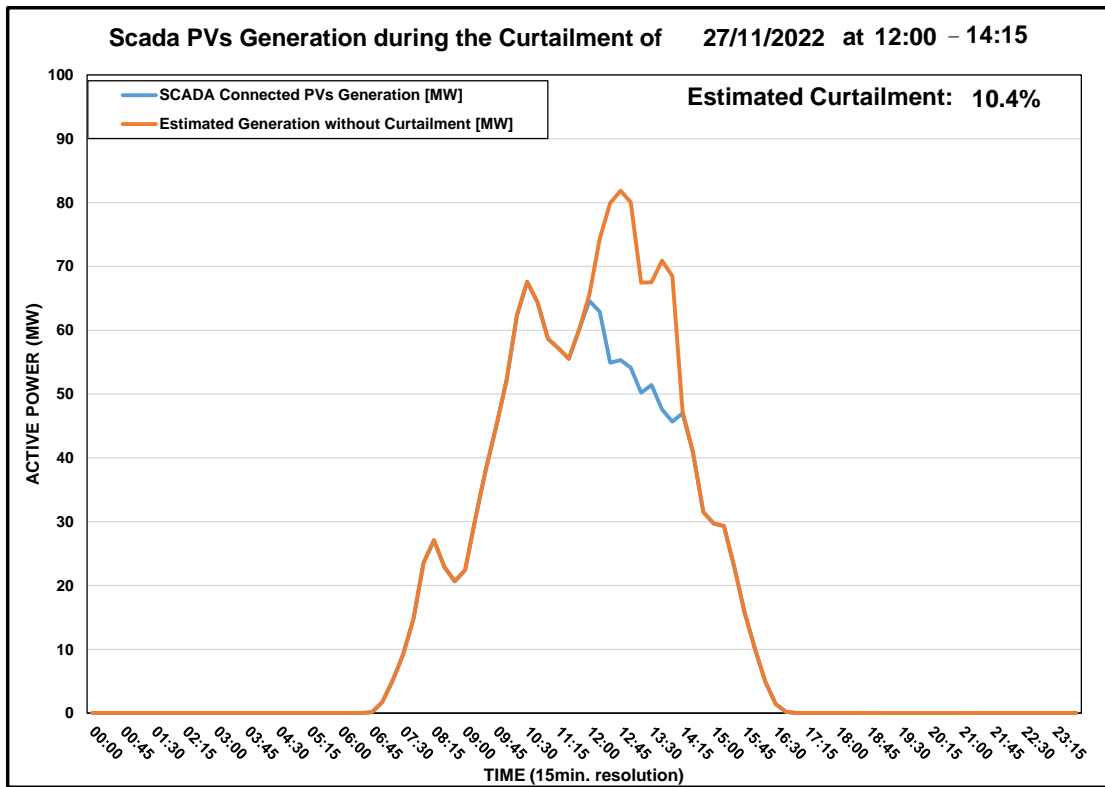


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	29/11/2022
Start of Curtailment	11:00
End of Curtailment	12:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	309 MWh
Total Estimated Curtailed Energy:	26.9 MWh
Percentage of Curtailed Energy	8.7%

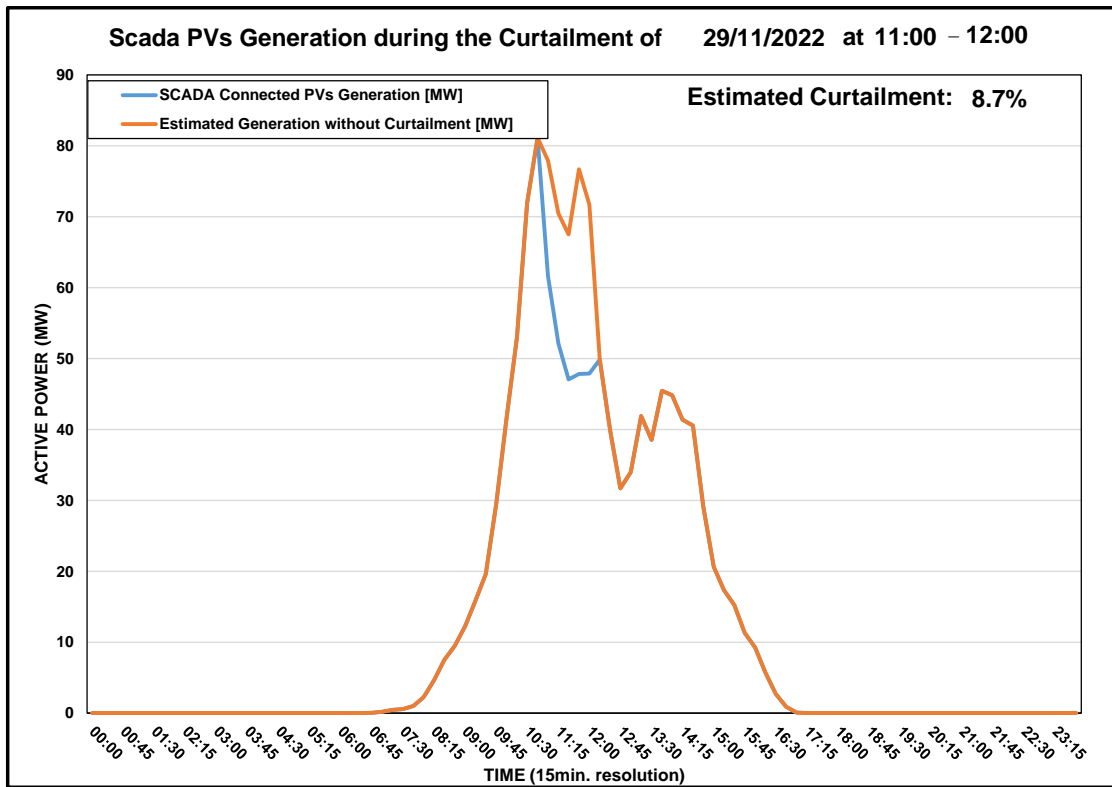


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	30/11/2022
Start of Curtailment	09:45
End of Curtailment	12:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	550.6 MWh
Total Estimated Curtailed Energy:	51.9 MWh
Percentage of Curtailed Energy	9.4%

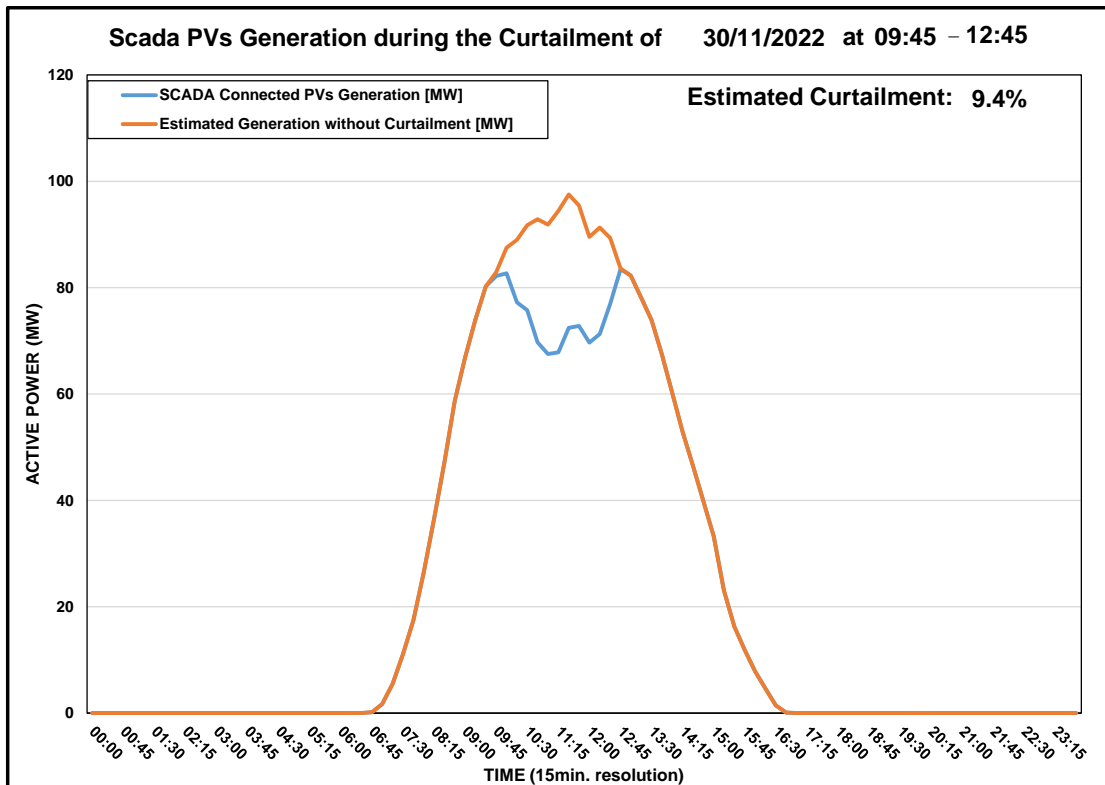


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	01/12/2022
Start of Curtailment	12:30
End of Curtailment	12:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	693.3 MWh
Total Estimated Curtailed Energy:	4.1 MWh
Percentage of Curtailed Energy	0.6%

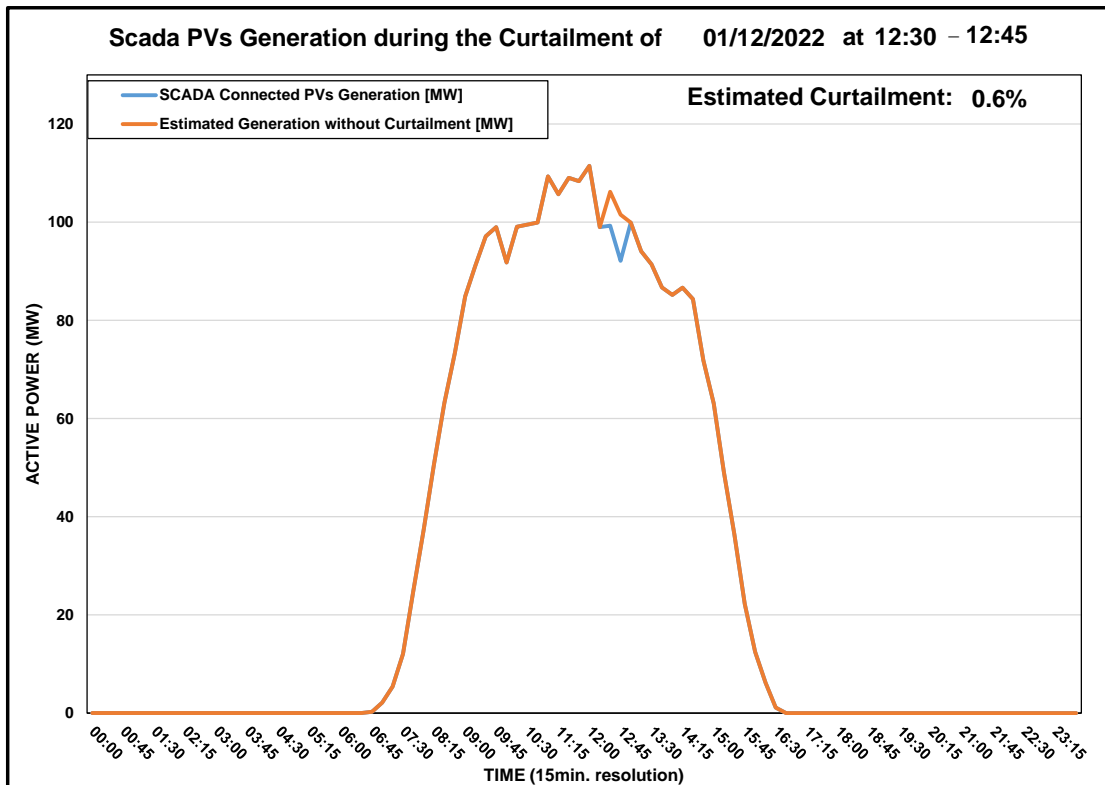


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	02/12/2022
Start of Curtailment	09:30
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	694.9 MWh
Total Estimated Curtailed Energy:	151.6 MWh
Percentage of Curtailed Energy	21.8%

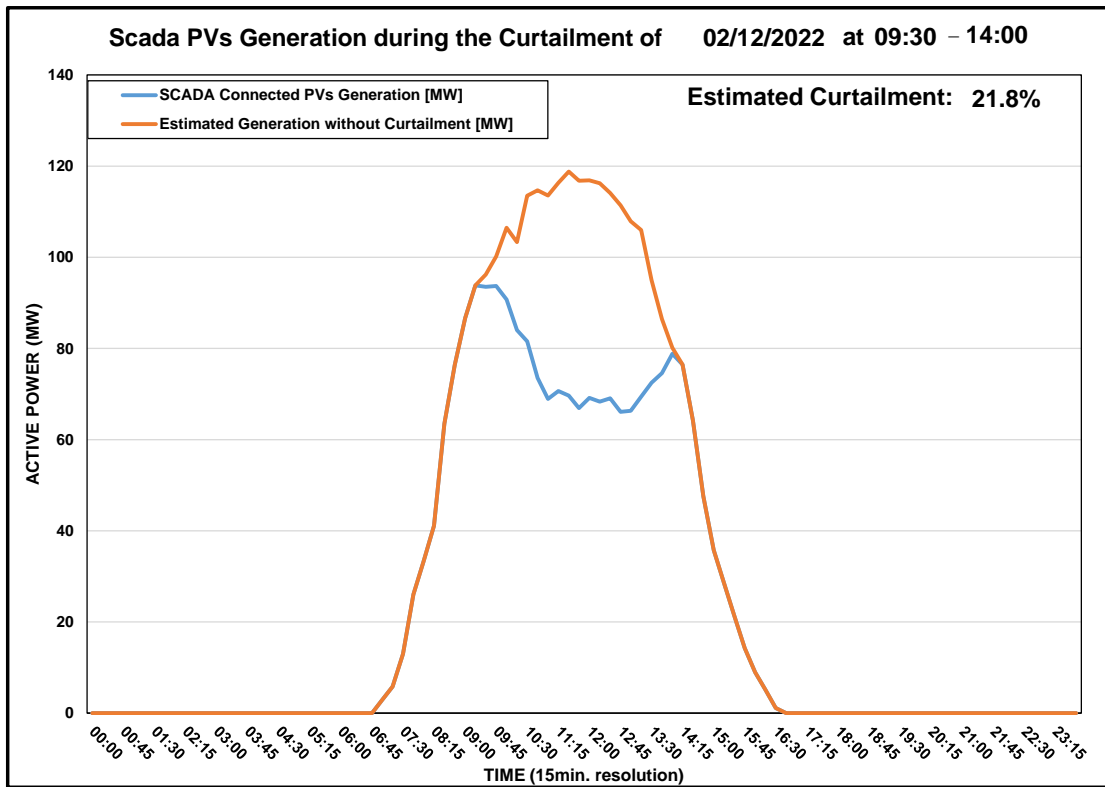


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	03/12/2022
Start of Curtailment	11:15
End of Curtailment	11:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	747.8 MWh
Total Estimated Curtailed Energy:	6.7 MWh
Percentage of Curtailed Energy	0.9%

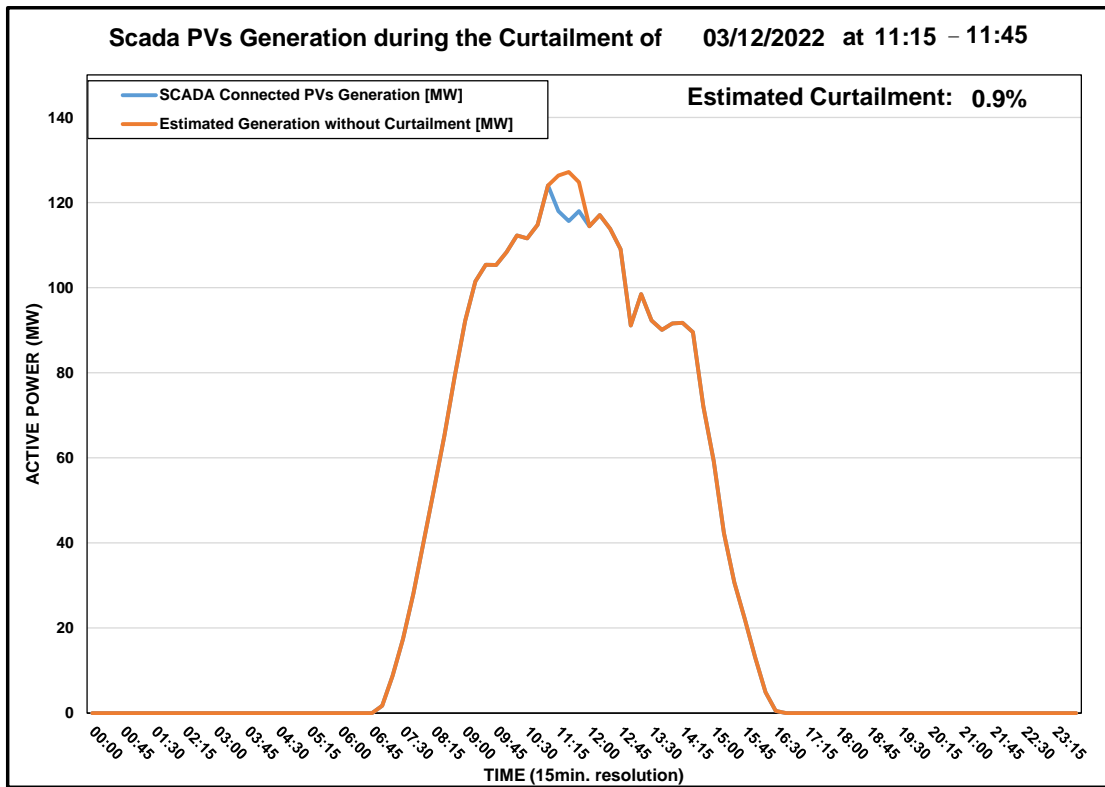


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	04/12/2022
Start of Curtailment	09:30
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	762 MWh
Total Estimated Curtailed Energy:	105.7 MWh
Percentage of Curtailed Energy	13.9%

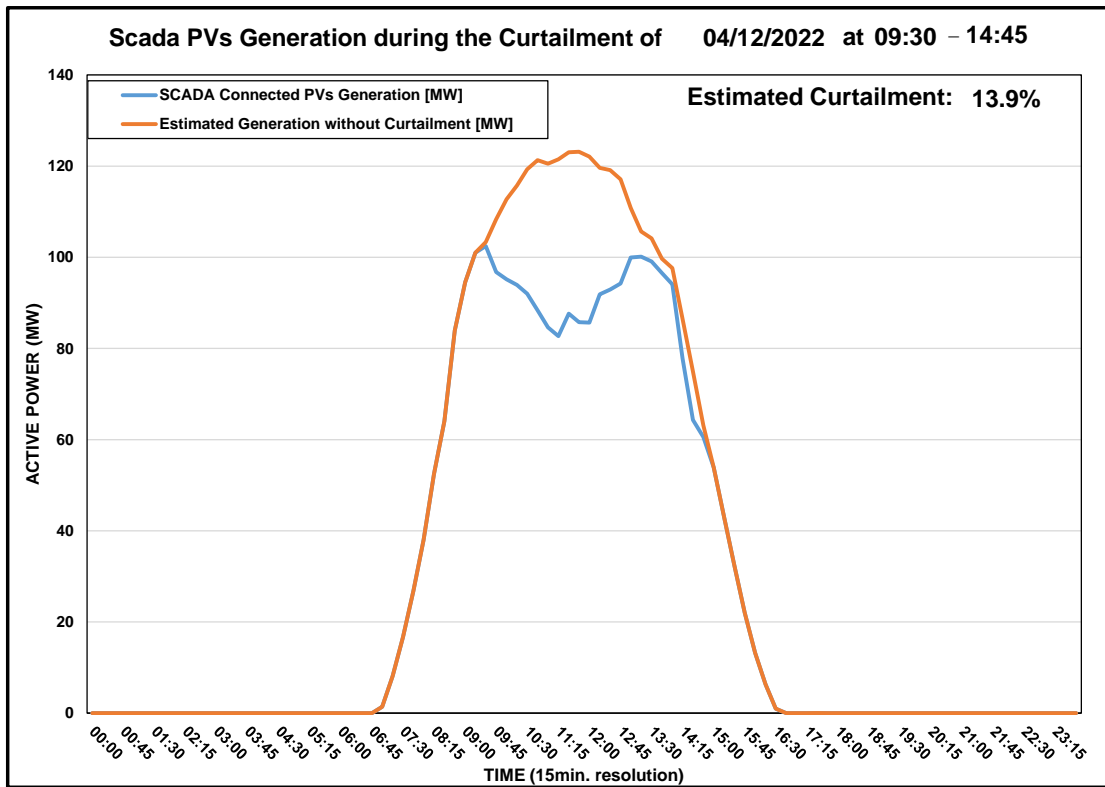


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	06/12/2022
Start of Curtailment	10:45
End of Curtailment	11:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	644.4 MWh
Total Estimated Curtailed Energy:	16.1 MWh
Percentage of Curtailed Energy	2.5%

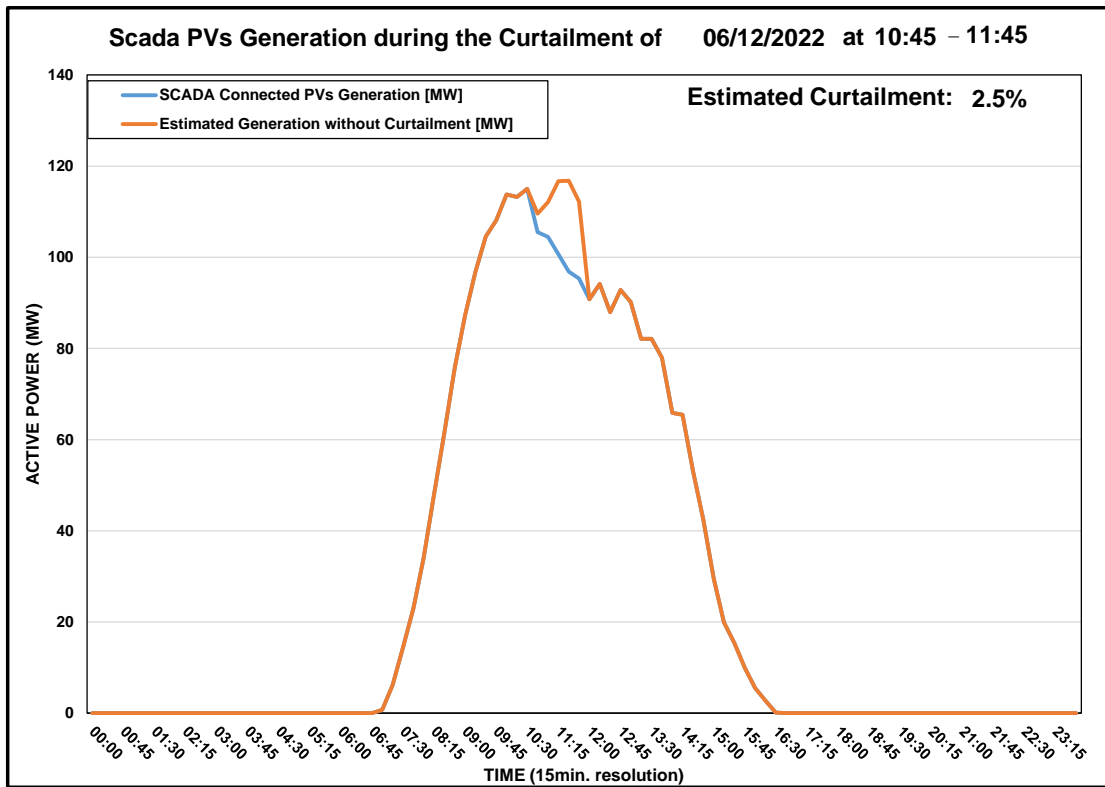


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	08/12/2022
Start of Curtailment	10:15
End of Curtailment	11:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	673.5 MWh
Total Estimated Curtailed Energy:	1.9 MWh
Percentage of Curtailed Energy	0.3%

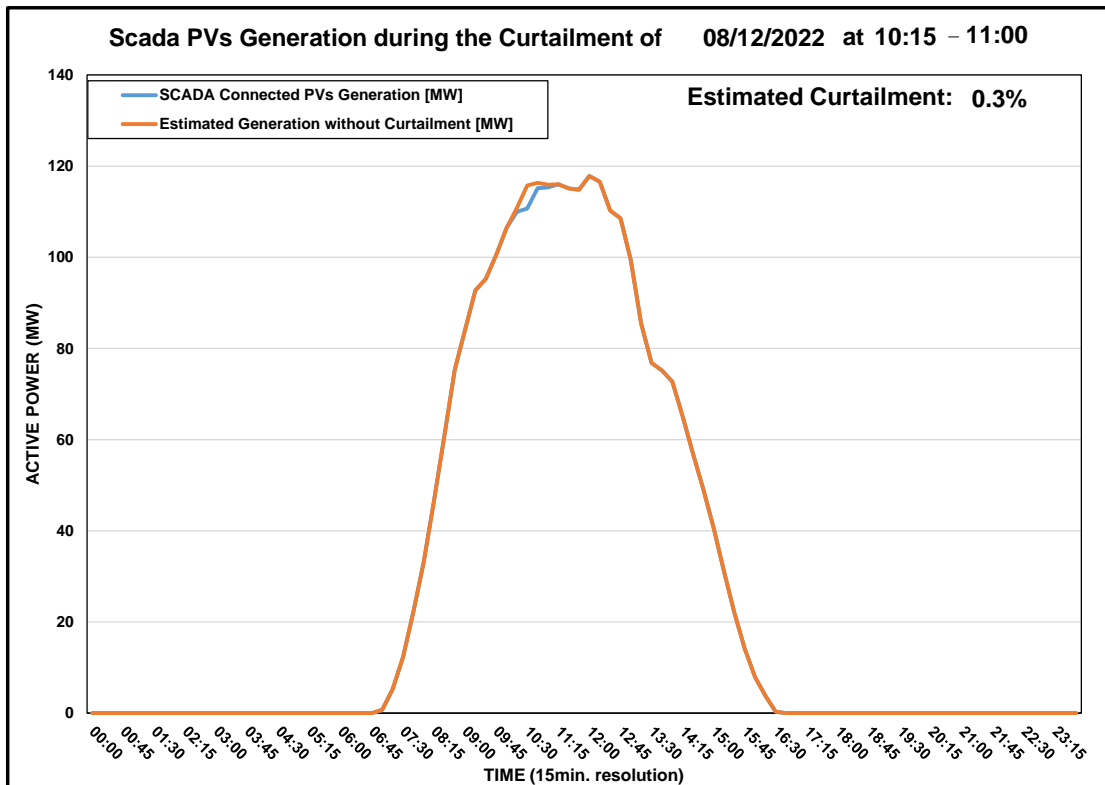


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	09/12/2022
Start of Curtailment	10:15
End of Curtailment	11:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	666.1 MWh
Total Estimated Curtailed Energy:	3.1 MWh
Percentage of Curtailed Energy	0.5%

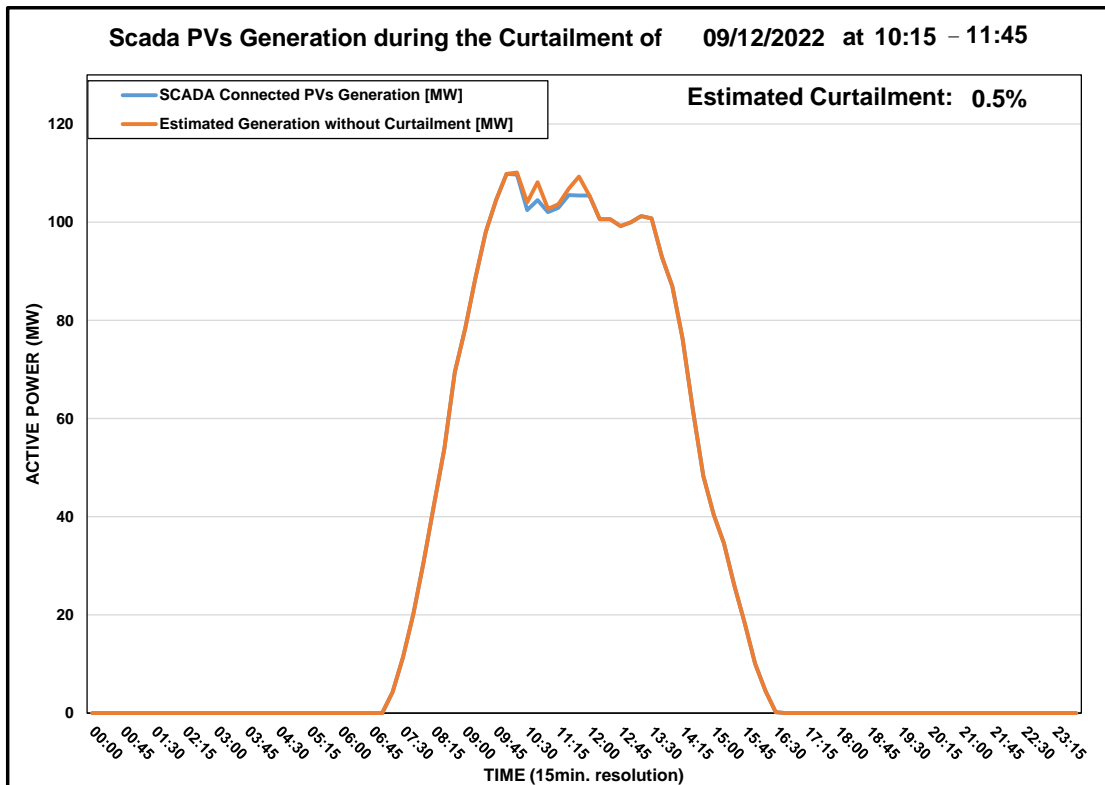


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	16/12/2022
Start of Curtailment	10:00
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	641.7 MWh
Total Estimated Curtailed Energy:	31 MWh
Percentage of Curtailed Energy	4.8%

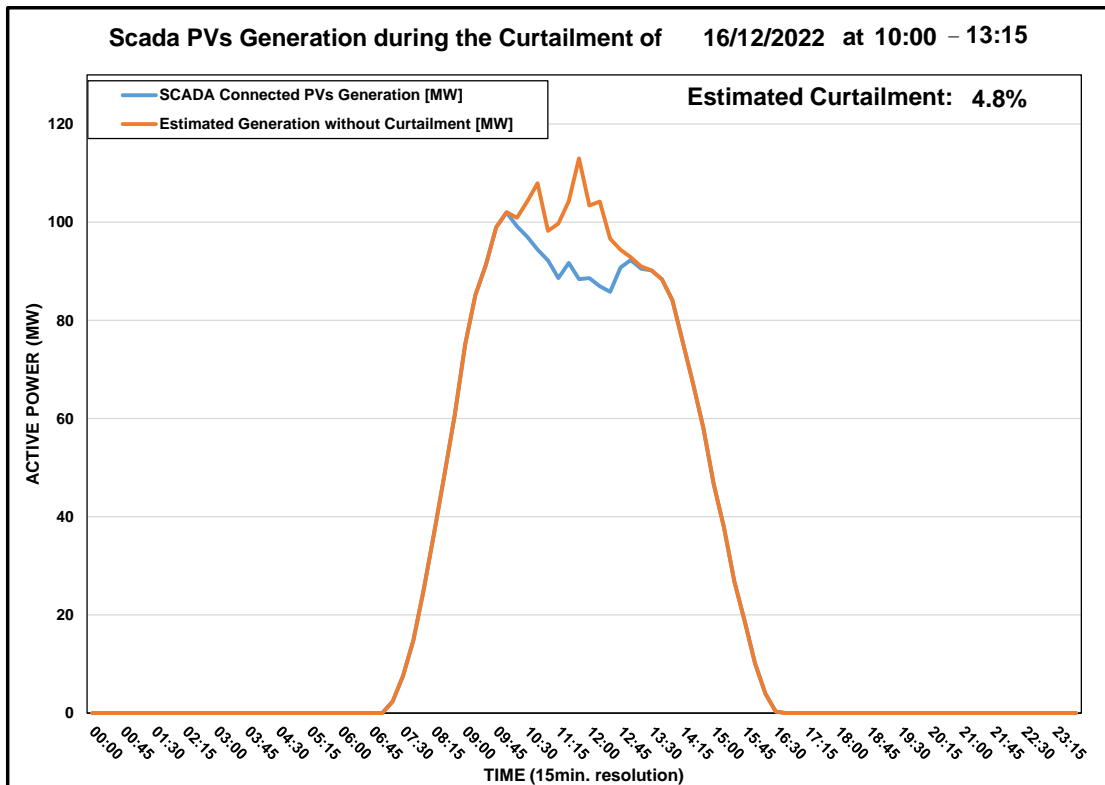


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	17/12/2022
Start of Curtailment	11:15
End of Curtailment	12:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	766.8 MWh
Total Estimated Curtailed Energy:	5.9 MWh
Percentage of Curtailed Energy	0.8%

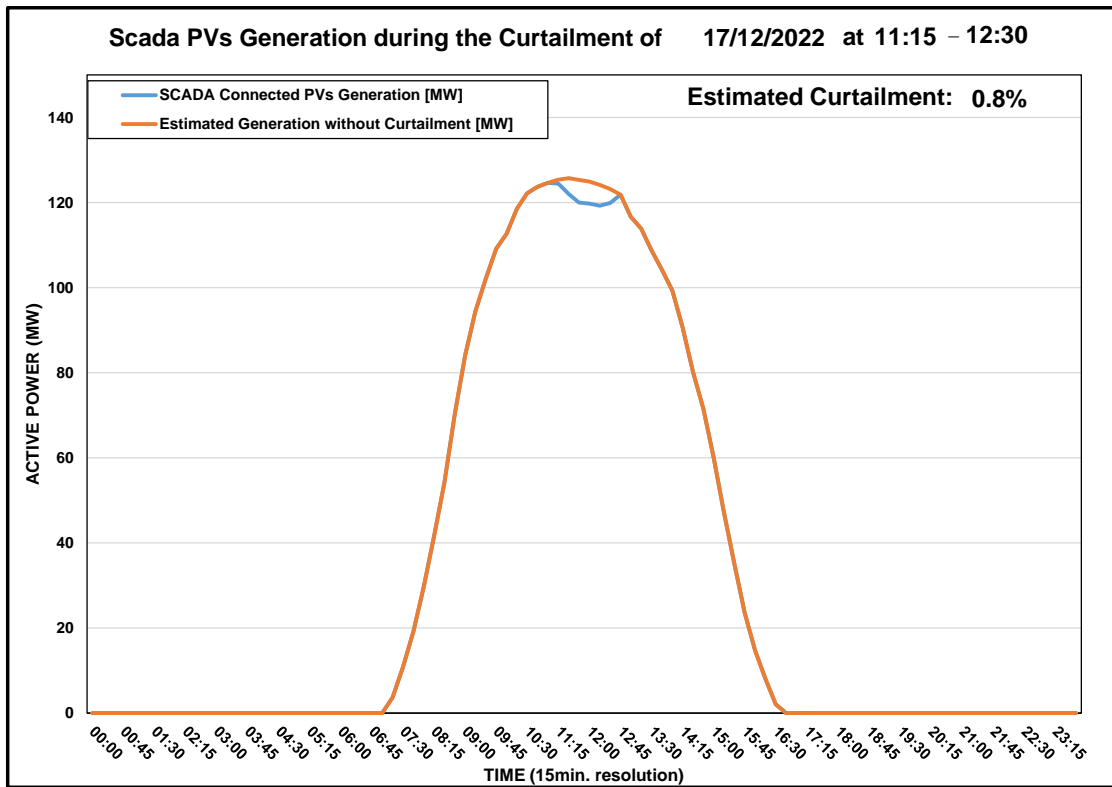


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	18/12/2022
Start of Curtailment	10:00
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	825.4 MWh
Total Estimated Curtailed Energy:	61.7 MWh
Percentage of Curtailed Energy	7.5%

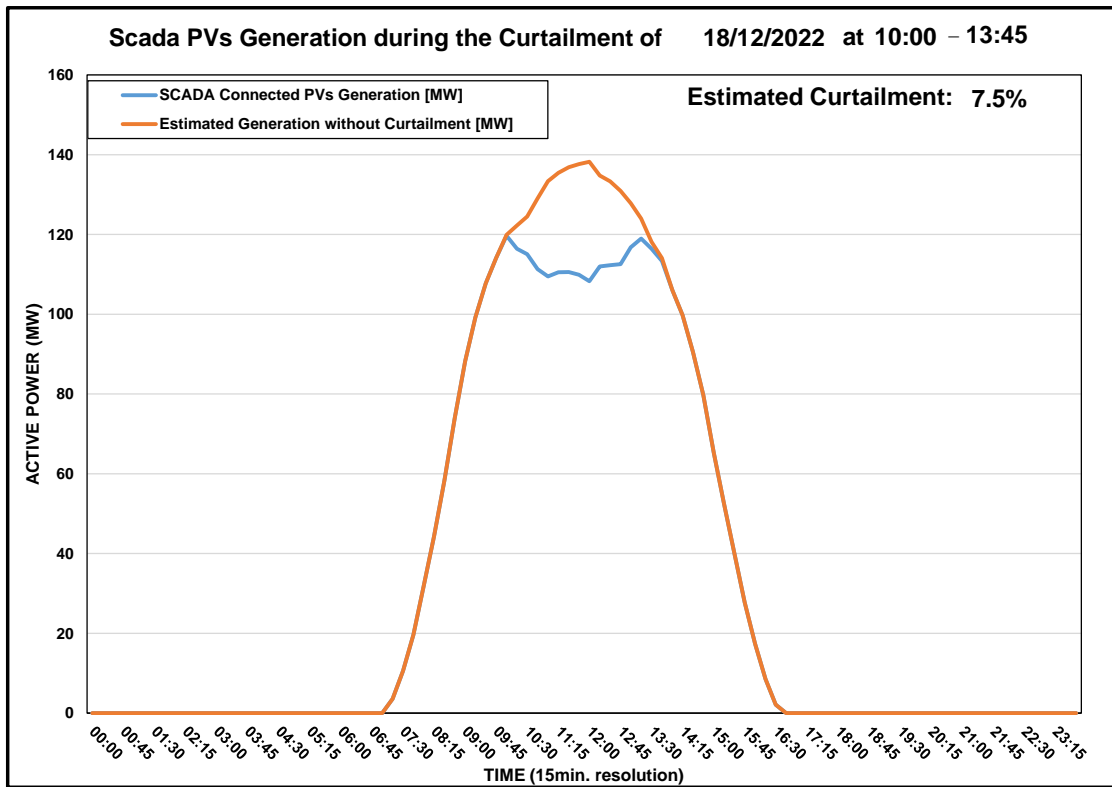


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	19/12/2022
Start of Curtailment	09:30
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	760.3 MWh
Total Estimated Curtailed Energy:	134.6 MWh
Percentage of Curtailed Energy	17.7%

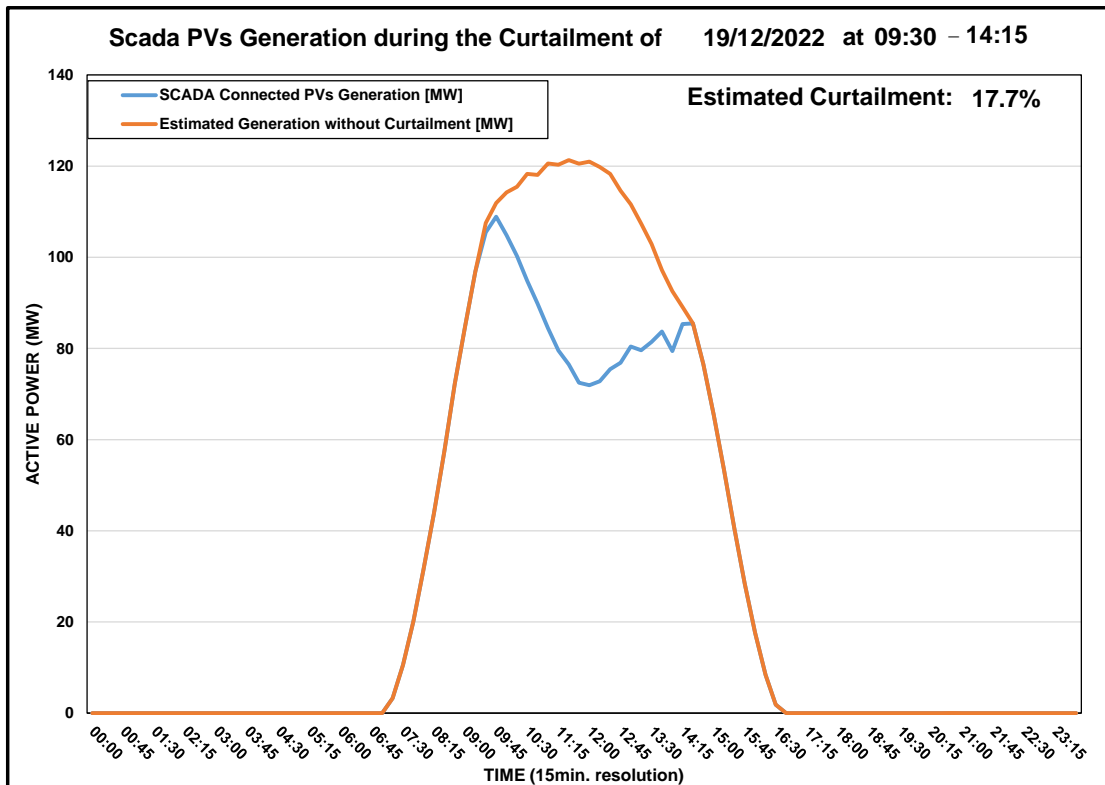


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	20/12/2022
Start of Curtailment	10:30
End of Curtailment	11:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	677.6 MWh
Total Estimated Curtailed Energy:	12 MWh
Percentage of Curtailed Energy	1.8%

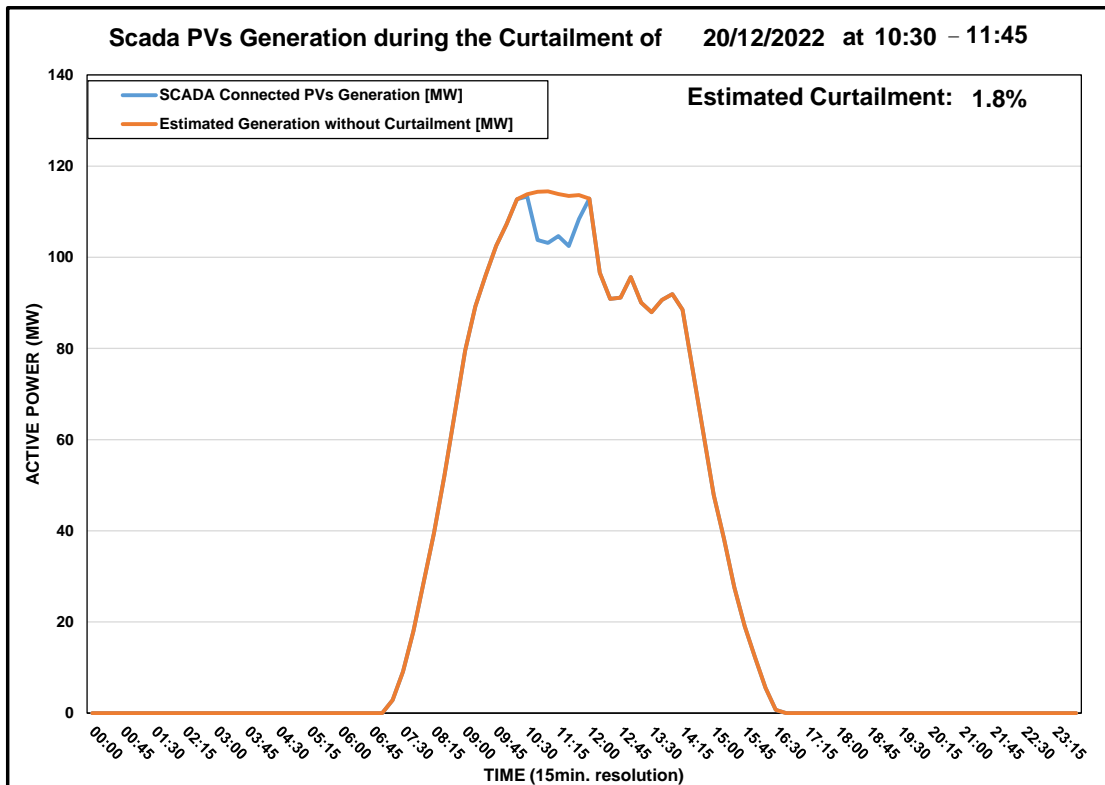


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	22/12/2022
Start of Curtailment	10:00
End of Curtailment	12:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	586.8 MWh
Total Estimated Curtailed Energy:	55 MWh
Percentage of Curtailed Energy	9.4%

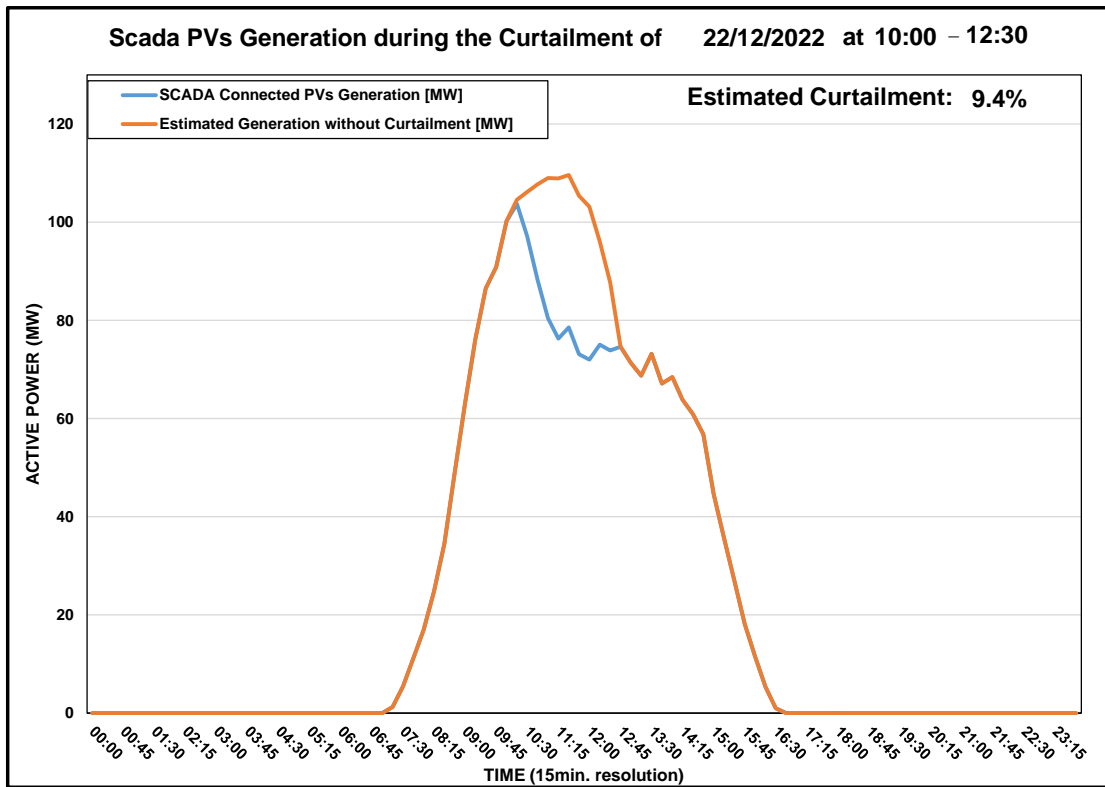


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	24/12/2022
Start of Curtailment	10:45
End of Curtailment	11:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	522 MWh
Total Estimated Curtailed Energy:	9.1 MWh
Percentage of Curtailed Energy	1.7%

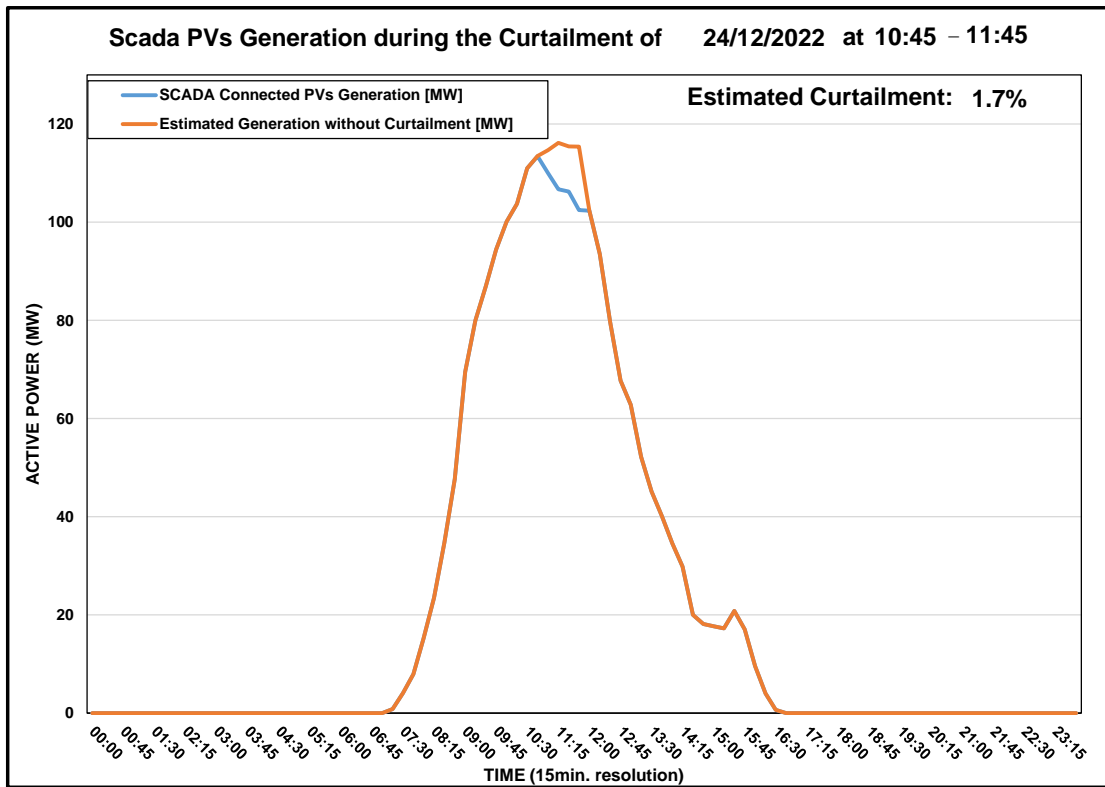


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	26/12/2022
Start of Curtailment	10:00
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	664.3 MWh
Total Estimated Curtailed Energy:	167.4 MWh
Percentage of Curtailed Energy	25.2%

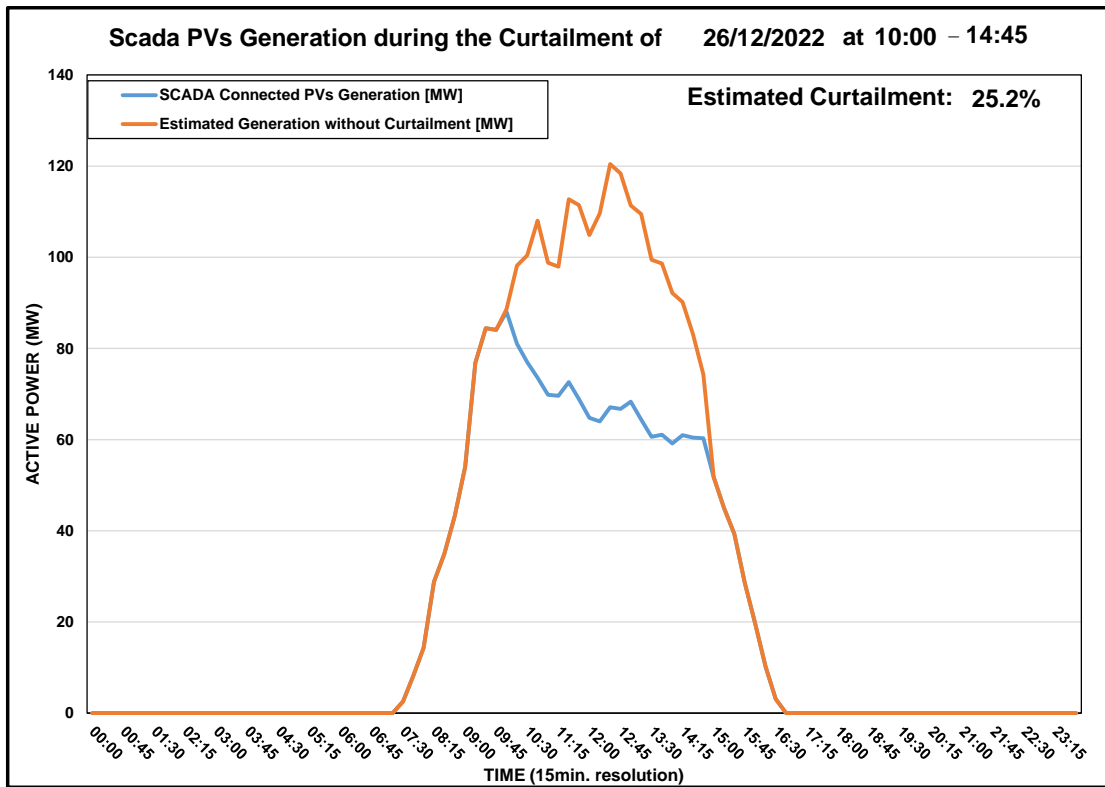


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	27/12/2022
Start of Curtailment	10:15
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	823.2 MWh
Total Estimated Curtailed Energy:	77.5 MWh
Percentage of Curtailed Energy	9.4%

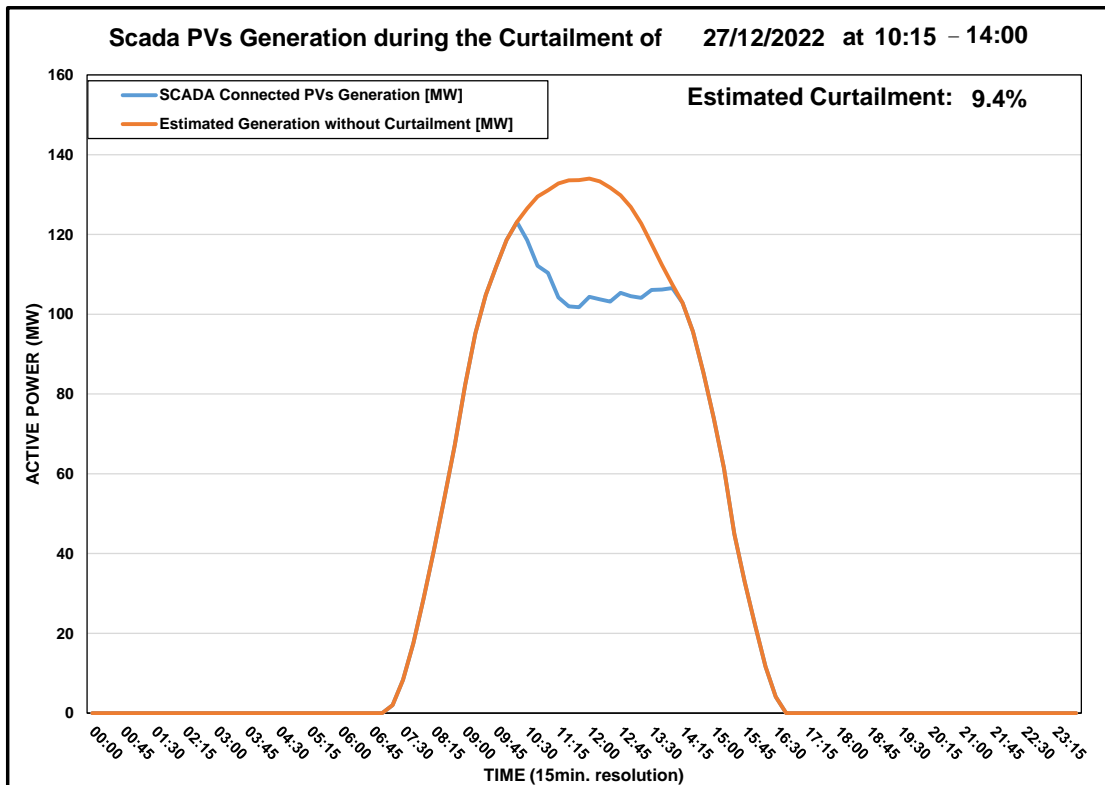


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	30/12/2022
Start of Curtailment	10:00
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	728.6 MWh
Total Estimated Curtailed Energy:	138.1 MWh
Percentage of Curtailed Energy	19.0%

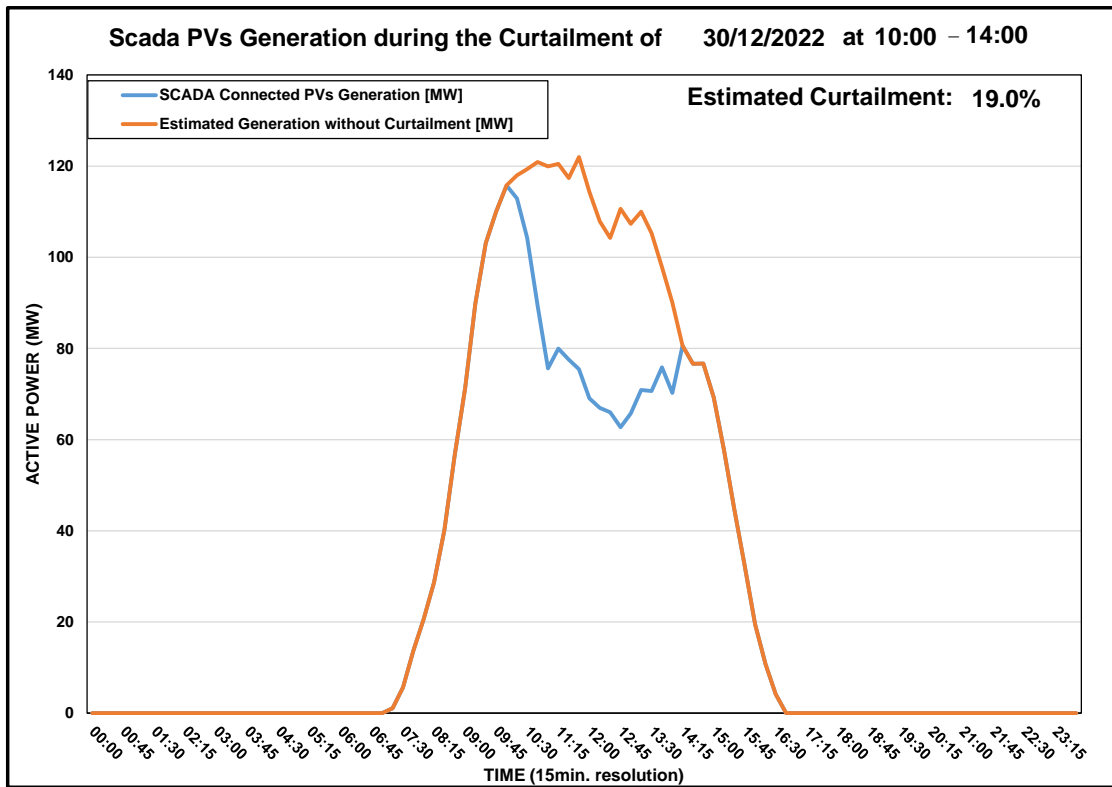

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	31/12/2022
Start of Curtailment	09:30
End of Curtailment	12:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	678 MWh
Total Estimated Curtailed Energy:	44.8 MWh
Percentage of Curtailed Energy	6.6%

